
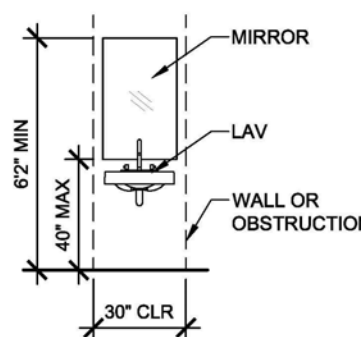
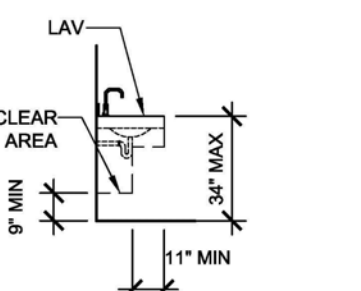
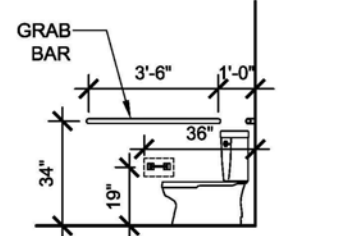


**ADA PLUMBING
FIXTURES**

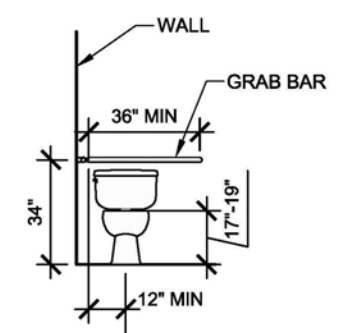


- NOTES:**
- REFER TO PLANS & ELEVATIONS FOR ACTUAL LAYOUT OF TOILET ROOMS AND QUANTITIES OF TOILET FIXTURES & ACCESSORIES.
 - THIS DRAWING IS FOR PURPOSES OF LOCATION OF TYPICAL ITEMS IN ADA TOILET/SHOWER ROOMS. REFER TO OTHER DRAWINGS & SPECIFICATIONS FOR COMPLETE DESCRIPTION OF ITEMS REQUIRED. ALL REQUIRED ITEMS MAY NOT BE SHOWN.


- GENERAL PARTITION NOTES:**
- REFER TO ROOM FINISH SCHEDULE FOR FINISH SURFACE TREATMENT AND CEILING HEIGHTS ASSOCIATED WITH PARTITIONS.
 - WOOD BLOCKING BETWEEN ALL STUDS TO REINFORCE GWB WALLS AT THE FOLLOWING ROOMS:
 - BEHIND ALL DOORS RECEIVING WALL MOUNTED BUMPERS (DOORS INDICATED AS SWING AGAINST WALL)
 - AT ALL WALLS SCHEDULED TO RECEIVE WALL HUNG CABINETS, SHELVING, FIXTURES, ACCESSORY AND BASE CABINETS.
 - STUD SPACING SHOWN ON PARTITION TYPES IS MINIMUM STANDARD.
 - PROVIDE ACOUSTIC SEALANT BENEATH ALL STUD RUNNERS AND AROUND ALL PENETRATIONS IN WALLS WITH SOUND BATTS.
 - ALL BATHROOMS, JANITOR CLOSETS, AND KITCHENS TO HAVE 5/8" MOISTURE RESISTANT GWB AND/OR TILE BACKER BOARD.

WALL TYPES

<p>1A</p> <p>UL#404 60 MIN</p>	<p>NOTE: PARTITION TO EXTEND TO GWB CEILING ABOVE. FIRE TAPE AND CAULK AS REQUIRED AT PENETRATIONS AND EXISTING GWB CEILINGS</p>	<p>1B</p> <p>UL--</p>	<p>NOTE: PARTITION TO EXTEND TO GWB CEILING ABOVE. PROVIDE ACOUSTIC SEALANT/CAULK AS REQUIRED</p>	<p>1B.1</p> <p>UL--</p>	<p>NOTE: PARTITION TO EXTEND TO GWB CEILING ABOVE. PROVIDE ACOUSTIC SEALANT/CAULK AS REQUIRED</p>	<p>1C</p> <p>UL#334 120 MIN</p>	<p>NOTE: PARTITION TO EXTEND TO GWB CEILING ABOVE. FIRE TAPE AND CAULK AS REQUIRED AT PENETRATIONS AND EXISTING GWB CEILINGS</p>
<p>EX1</p> <p>UL-- 60 MIN</p>	<p>NOTE: FIELD VERIFY EXTERIOR WALL CONDITIONS UPON DEMOLITION. PROVIDE 1 HOUR FIRE RATING FROM INSIDE ONLY IN ACCORDANCE WITH IBC SECTION 704.5 PER IBC TABLE 720.1 (2) ITEM NUMBER 16-1.1/16-1.2</p>	<p>EX2</p> <p>UL-- 60 MIN</p>	<p>NOTE: FIELD VERIFY EXTERIOR WALL CONDITIONS UPON DEMOLITION. PROVIDE 1 HOUR FIRE RATING FROM INSIDE ONLY IN ACCORDANCE WITH IBC SECTION 704.5 PER IBC TABLE 720.1 (2) ITEM NUMBER 16-1.1/16-1.2</p>	<p>C1</p> <p>UL-- 60 MIN</p>	<p>TYPICAL CEILING ASSEMBLY:</p> <p>NOTE: ALL TYPICAL CEILING ASSEMBLIES TO PROVIDE 1 HOUR FIRE SEPARATION. PROVIDE 1 CONTINUOUS LAYER 5/8" TYPE X GWB.</p>	<p>CHASE</p> <p>UL-- 60 MIN</p>	<p>TYPICAL CHASE ASSEMBLY:</p> <p>NOTE: CHASE ASSEMBLY TO BE PROTECTED WITH 1 HOUR FIRE SEPARATION. PROVIDE 2 CONTINUOUS LAYER 5/8" TYPE X GWB.</p>

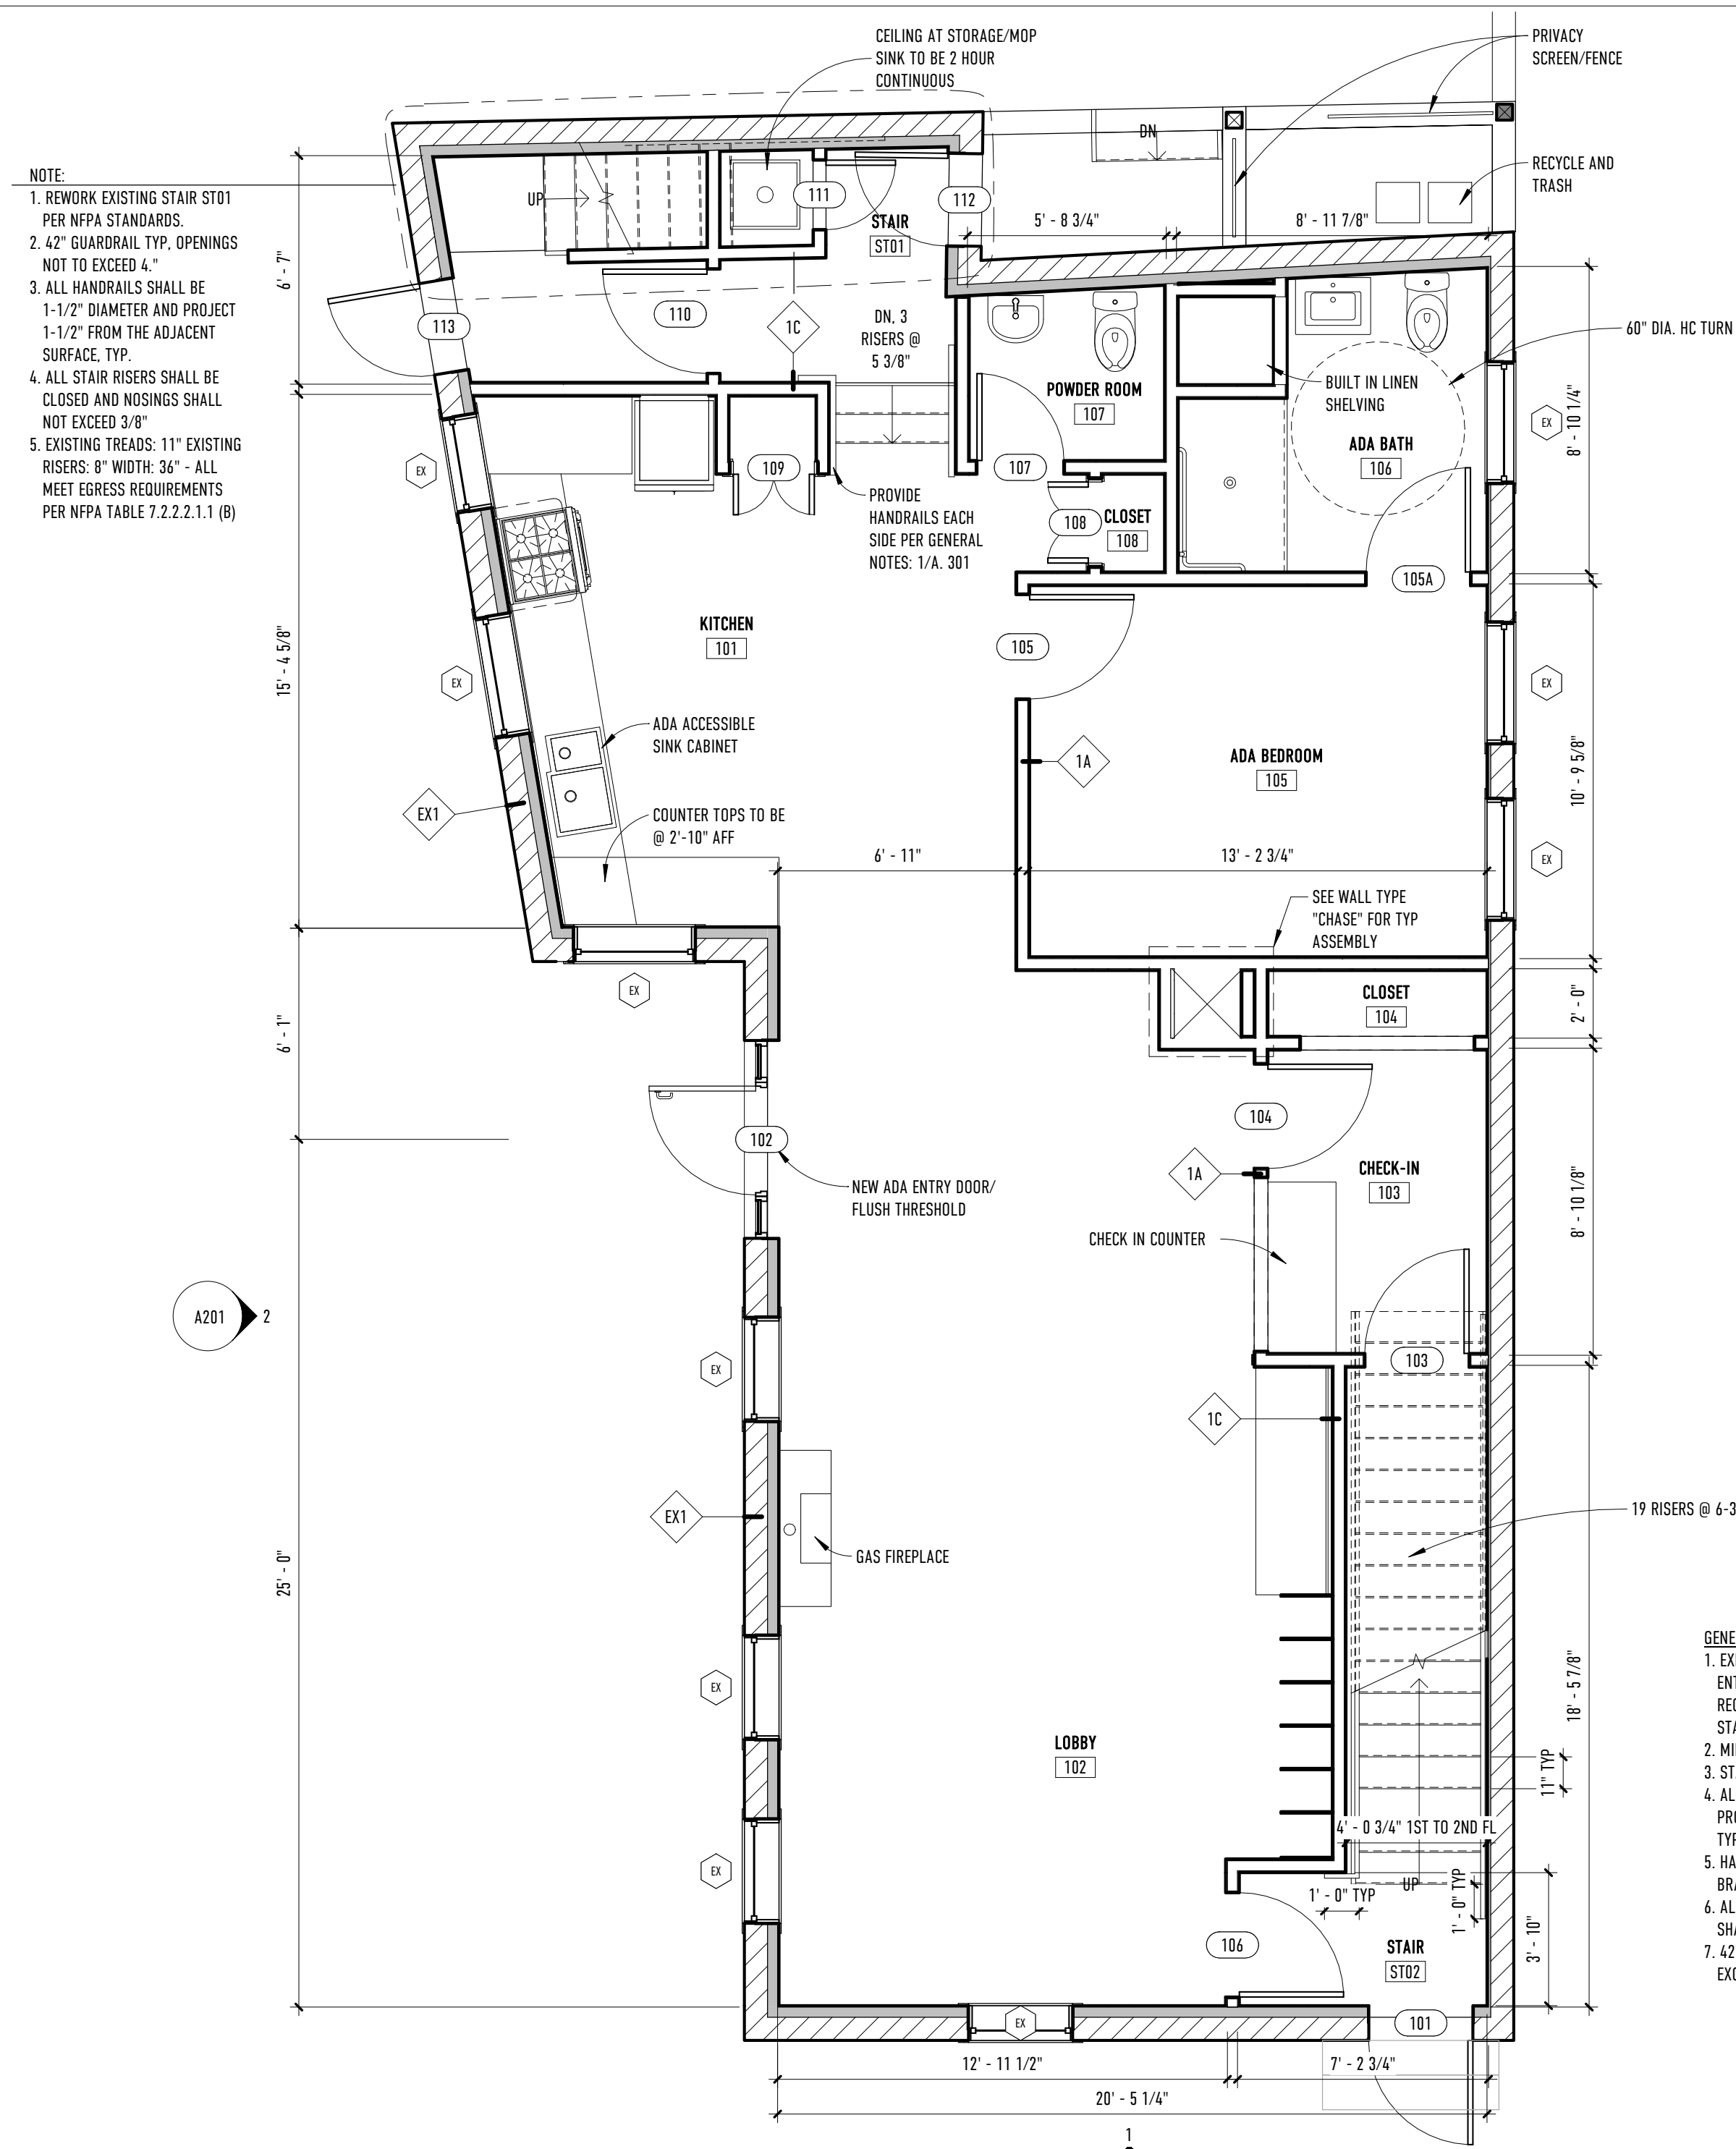

FIRST FLOOR
1/4" = 1'-0"

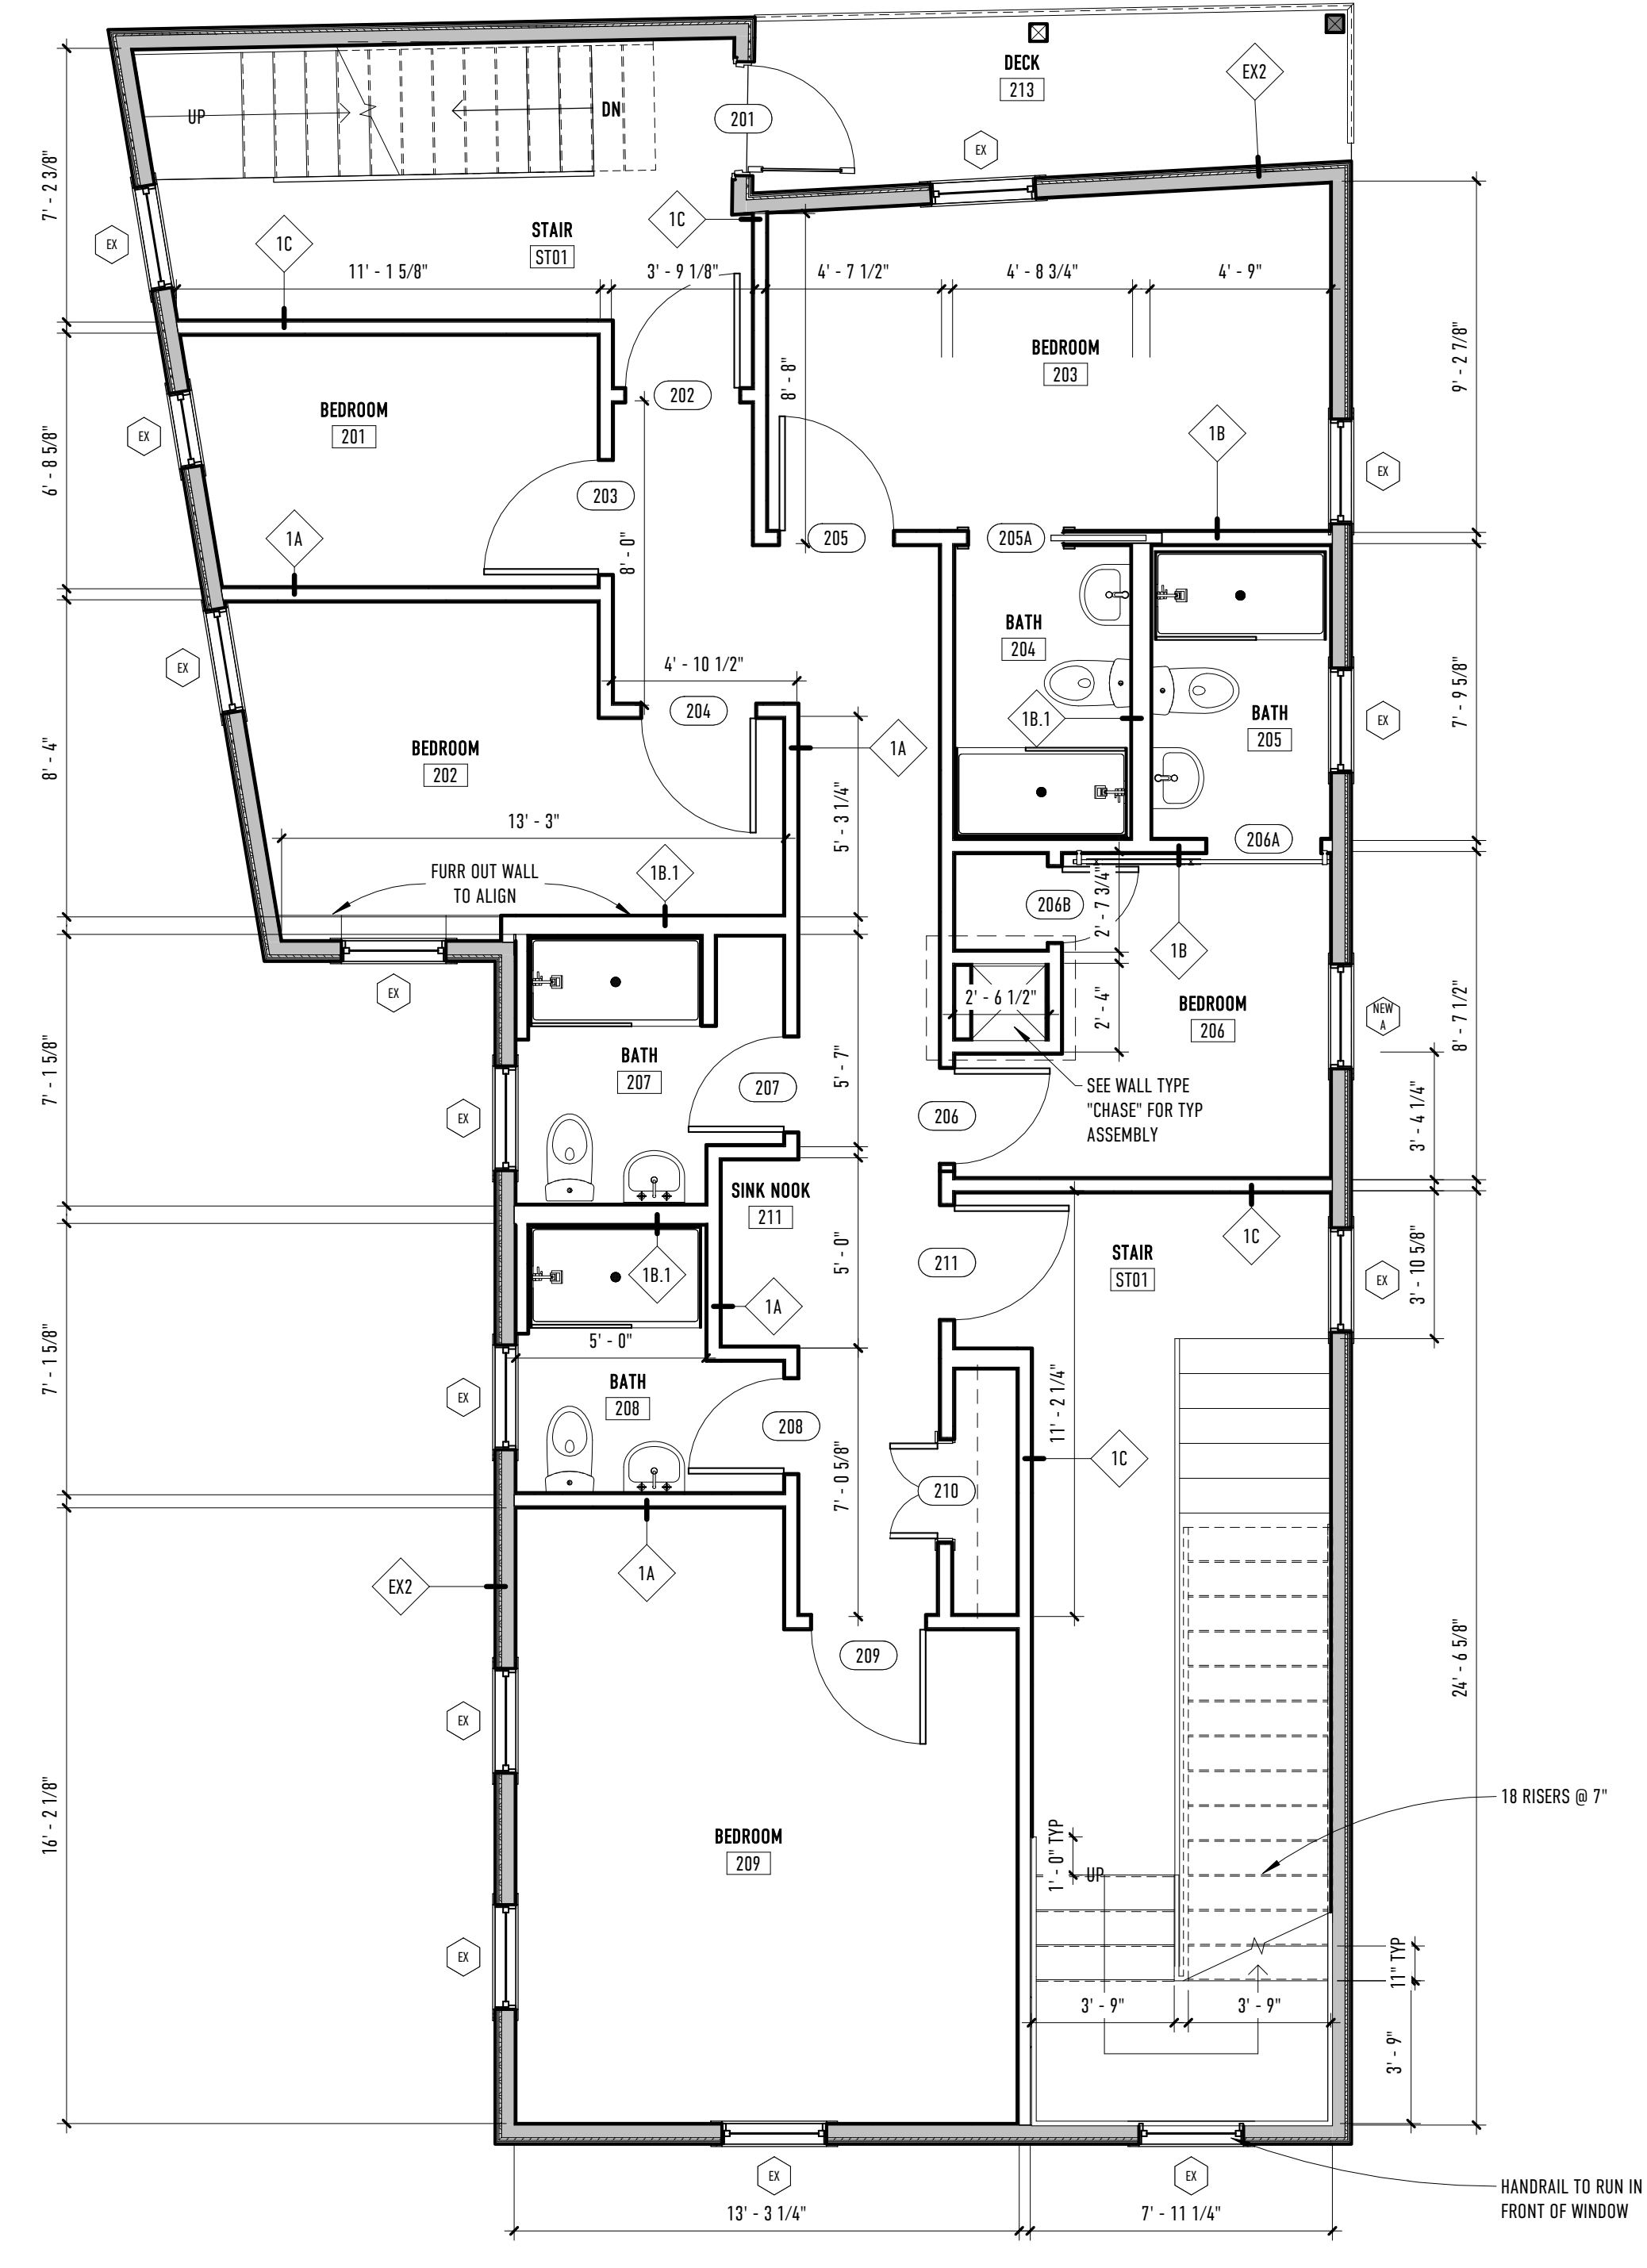

SECOND FLOOR
1/4" = 1'-0"

- GENERAL NOTE:**
- EXISTING STAIR ST02 TO BE DEMOLISHED IN ITS ENTIRETY AND REBUILT TO MEET ALL CODE REQUIREMENTS PER NFPA 7.2.2.1.1 (A) NEW STAIRS.
 - MIN STAIR WIDTH TO BE 44" MINIMUM.
 - STAIR HEAD ROOM CLEARANCE TO BE 6'-8" MIN.
 - ALL HANDRAILS TO BE 1-1/2" DIAMETER AND PROJECT 1-1/2" FROM THE ADJACENT SURFACE.
 - HANDRAIL, PROVIDE BLOCKING AND SUPPORT BRACKETS AS REQ.
 - ALL STAIR RISERS TO BE CLOSED AND NOSING SHALL NOT EXCEED 3/8"
 - 4.2" GUARDRAIL TYP. ALL OPENINGS SHALL NOT EXCEED 4"

REVISIONS:

**33 HAMPSHIRE
FIRST AND SECOND FLOOR PLANS**

A101

33 HAMPSHIRE ST. PORTLAND, MAINE 04101

DATE OF ISSUE: 12/12/2017

ISSUED FOR: PERMIT AMENDMENT

SCALE: As indicated

THIS DRAWING IS THE PROPERTY OF BARRETT MADE AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. BARRETT MADE 48 BROADWAY PORTLAND MAINE 04101 2017.010.0423