


ADA PLUMBING
FIXTURES





BASEMENT

HAS
(1) Smoke
(1) CO
(1) horn/strobe
(1) Pull

▽ Strobe
□ Roll
◻ Horn/strobe
H Horn
○ Smoke
◇ CO

GENERAL NOTES:

- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.
- VERIFY ALL ROOM SCHEDULES FOR ROOM SCHEDULES THAT ARE ASSOCIATED WITH THIS PLAN.

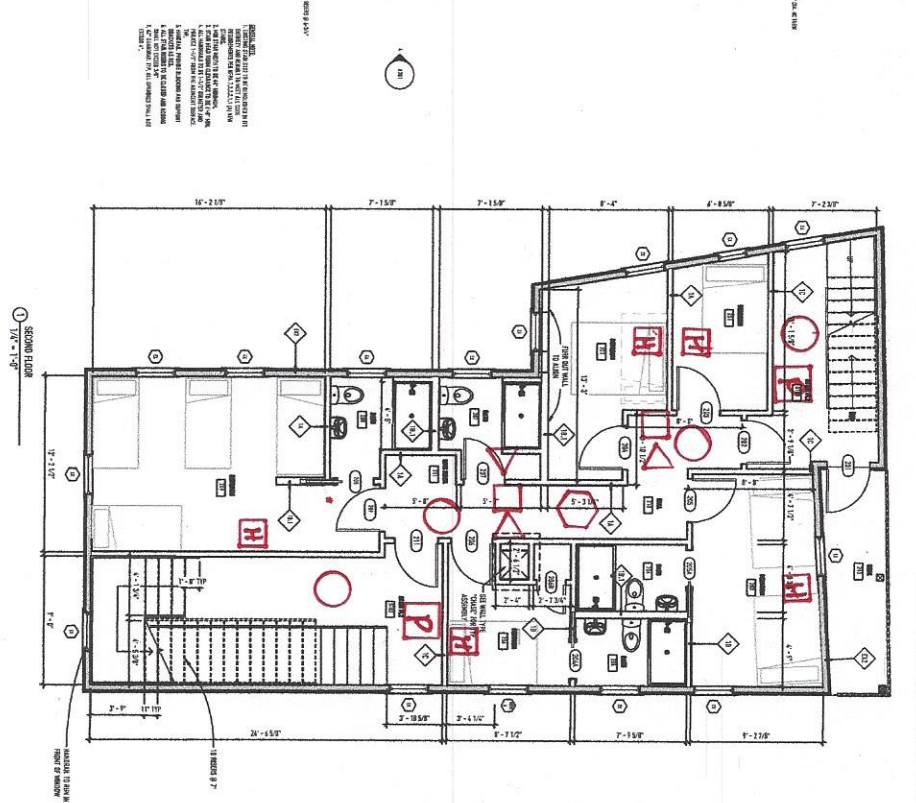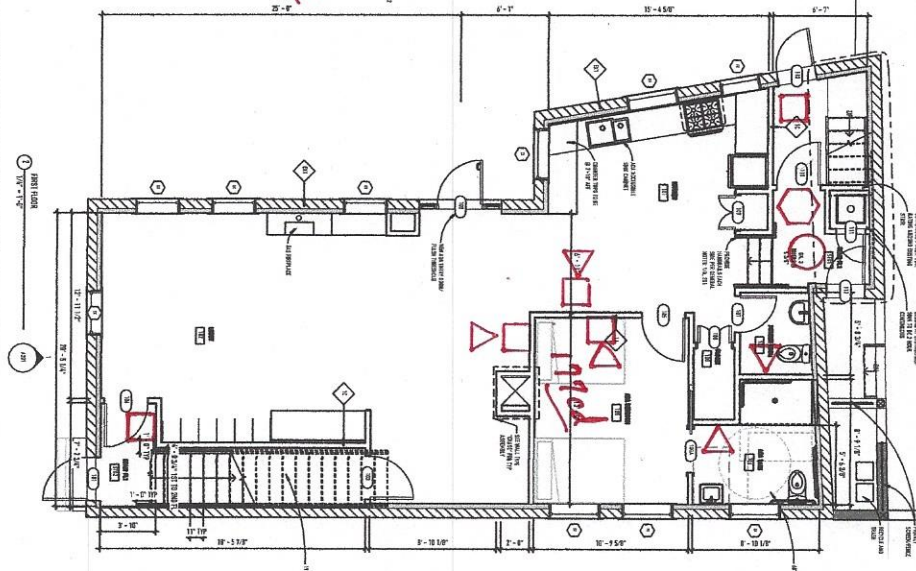

1A	48 IN 1200 MM	<p>CEILING FIRE ALARM DEVICE IN 1A WALL</p>
EX1	48 IN 1200 MM	<p>EXTERIOR FIRE ALARM DEVICE IN 1A WALL</p>
1B	48 IN 1200 MM	<p>CEILING FIRE ALARM DEVICE IN 1B WALL</p>
EX2	48 IN 1200 MM	<p>EXTERIOR FIRE ALARM DEVICE IN 1B WALL</p>
1B.1	48 IN 1200 MM	<p>CEILING FIRE ALARM DEVICE IN 1B.1 WALL</p>
C1	48 IN 1200 MM	<p>CEILING FIRE ALARM DEVICE IN 1B.1 WALL</p>
1C	48 IN 1200 MM	<p>CEILING FIRE ALARM DEVICE IN 1C WALL</p>
CHASE	48 IN 1200 MM	<p>CEILING FIRE ALARM DEVICE IN CHASE</p>