

424 Fore Street  
Portland, ME 04101  
Phone 207.842.2800  
Fax 207.842.2828  
www.cascobayengineering.com

CLIENT:

MARK MUELLER  
ARCHITECTS  
100 COMMERCIAL STREET # 25-  
PORTLAND, ME 04101

75 MARKET STREET  
2ND FLOOR INFILL  
PORTLAND MAINE

REVISIONS

DATE	ISSUE
6-19-05	FOR CONSTRUCTION

SHEET TITLE:

FRAMING PLAN

DESIGNED:	ED
DRAWN:	PM
DATE:	6-16-05
CADD FILE:	5037-S1
PROJECT No:	5037

50

ALL LUMBER SHALL BE VISUALLY GRADED AND STAMPED WITH GRADE DESIGNATION, SPECIES, AND ADDITIONAL INSPECTION INFORMATION, U.N.O.

CARE SHALL BE TAKEN TO PROTECT TIMBER FROM WEATHER AND DAMPNESS. DO NOT STACK IN SUCH A WAY AS TO CAUSE WARPING OR PREVENT ADEQUATE AIR CIRCULATION.

WOOD GRADES AND SPECIES:

SPRUCE-PINE-FIR, No.1/No.2 OR BETTER FOR TYPICAL LUMBER (JOISTS, WALLS, ETC) U.N.O.

USE SOUTHERN YELLOW PINE FOR EXTERIOR EXPOSURE APPLICATIONS AND WHERE SHOWN ON DRAWINGS AS PRESERVATIVE PRESSURE TREATED LUMBER (PT OR PPT).

WHERE NOTED LVL OR PSL ON DRAWINGS, PROVIDE VERSALAM MEMBERS BY BOISE CASCADE, OR EQUIVALENT, WHICH HAVE THE FOLLOWING MINIMUM ALLOWABLE STRESSES:

BEAM PROPERTIES:

Fb = 3080 PSI	Fc = 3000 PSI (PARALLEL TO GRAIN)
Fv = 285 PSI	Fc = 850 PSI (PERPENDICULAR TO GRAIN)
Ft = 2100 PSI	E = 2,000,000 PSI

COLUMN PROPERTIES:

Fb = 2200 PSI	Fc = 3000 PSI (PARALLEL TO GRAIN)
Fv = 285 PSI	Fc = 900 PSI (PERPENDICULAR TO GRAIN)
Ft = 1600 PSI	E = 1,800,000 PSI

STRUCTURAL LUMBER SHALL HAVE A MAXIMUM MOISTURE CONTENT OF 19%

PROVIDE PRESSURE TREATED LUMBER FOR ALL LUMBER IN CONTACT WITH MASONRY OR CONCRETE.

NOMINAL SIZES ARE TYPICALLY REFERENCED ON THE DRAWINGS. PROVIDE ACTUAL SIZES AS SET FORTH IN U.S. DEPARTMENT OF COMMERCE VOLUNTARY PRODUCT STANDARD PS20-99.

ALL PLYWOOD SHALL BE APA RATED CDX SHEATHING:

USE 1/2-INCH PLYWOOD WALL SHEATHING. ATTACH PLYWOOD WITH LONG SIDE PERPENDICULAR TO WALL STUDS. STAGGER PANEL ENDS AND BLOCK ALL PANEL EDGES.

USE 5/8-INCH PLYWOOD ROOF SHEATHING. ATTACH PLYWOOD WITH LONG SIDE PERPENDICULAR TO FRAMING. STAGGER PANEL ENDS. USE SHEATHING CLIPS BETWEEN SHEETS WHERE BLOCKING IS NOT REQUIRED.

USE 3/4-INCH PLYWOOD FLOOR SHEATHING. ATTACH PLYWOOD WITH LONG SIDE PERPENDICULAR TO FRAMING. STAGGER PANEL ENDS.

PROVIDE FULL DEPTH BLOCKING AT ENDS AND INTERIOR SUPPORTS OF ALL JOISTS AND RAFTERS WHERE JOISTS AND RAFTERS FRAME OVER SUPPORTS. PROVIDE 1x3 DIAGONAL BRIDGING OR FULL DEPTH SOLID BLOCKING FOR EACH 8'-0" OF SPAN FOR ALL JOISTS AND RAFTERS.

FASTENERS SHALL COMPLY WITH RECOMMENDED FASTENING SCHEDULE OF REFERENCED BUILDING CODE, U.N.O. ON DRAWINGS, SPIKE TOGETHER ALL FRAMING MEMBERS WHICH ARE BUILT-UP USING A MINIMUM OF 2-ROWS OF 16d NAILS AT 12" O.C. STAGGERED, UNLESS OTHERWISE NOTED IN BOCA OR ON THE DRAWINGS. NAIL MULTIPLE LVLS TOGETHER AS RECOMMENDED BY THE MANUFACTURER USING A MINIMUM OF 2-ROWS OF 16d NAILS AT 12"O.C. STAGGERED. ALL FASTENERS, NUTS, AND WASHERS SHALL BE HOT-DIPPED GALVANIZED.

ALIGN COLUMNS SUCH THAT COLUMNS BEAR CONTINUOUSLY TO FOUNDATION SUPPORT.

PROVIDE HORIZONTAL BLOCKING FOR ALL LOAD BEARING WALLS AT 4'-0" O.C. VERTICAL, MAXIMUM.

SUBMIT SHOP DRAWINGS FOR ALL PREFABRICATED WOOD JOISTS AND WALL PANELS TO ENGINEER FOR REVIEW PRIOR TO CONSTRUCTION.

THE FOLLOWING BUILDING CODES AND STANDARDS SHALL BE REFERENCED DURING CONSTRUCTION:

IBC	2003 EDITION OF THE INTERNATIONAL BUILDING CODE
ASCE 7	AMERICAN SOCIETY OF CIVIL ENGINEERS, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION, MANUAL OF STEEL CONSTRUCTION, NINTH EDITION
ACI 301	AMERICAN CONCRETE INSTITUTE SPECIFICATION FOR STRUCTURAL CONCRETE
ACI 318	AMERICAN CONCRETE INSTITUTE BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE
ASTM	AMERICAN SOCIETY OF TESTING AND MATERIALS
NDS	NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION BY NATIONAL FOREST PRODUCTS ASSOCIATION, 2001.

REFERENCE ARCHITECTURAL PLANS FOR DIMENSIONS NOT SHOWN. REFERENCE MECHANICAL, ELECTRICAL, AND ARCHITECTURAL PLANS FOR SIZES AND LOCATIONS OF WALL AND SLAB OPENINGS, DUCTS, PIPING, CURBS, AND EQUIPMENT PADS. IN THE EVENT OF A CONFLICT BETWEEN THE DRAWINGS, SPECIFICATIONS, OR NOTES ON THE DRAWINGS, THE ENGINEER SHALL BE NOTIFIED PRIOR TO CONSTRUCTION.

EXISTING DIMENSIONS AND CONDITIONS ARE FOR REFERENCE ONLY. CONTRACTOR SHALL VERIFY ALL EXISTING CONSTRUCTION AND DIMENSIONS IN THE FIELD PRIOR TO CONSTRUCTION OR FABRICATION. ALL DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER PRIOR TO COMMENCING WORK.

THE CONTRACTOR SHALL NOTIFY THE ENGINEER IF DEVIATIONS OR CHANGES ARE REQUIRED TO THE CONTRACT DOCUMENTS OR APPROVED SHOP DRAWINGS DUE TO INTERFERENCES, FABRICATION ERRORS, OR OTHER CAUSES.

THE STRUCTURE IS SELF-SUPPORTING AND STABLE AFTER THE ENTIRE BUILDING IS COMPLETELY CONSTRUCTED. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR ERECTION PROCEDURES AND SEQUENCING DURING CONSTRUCTION AND ERECTION TO PROVIDE AND ENSURE LOCAL AND OVERALL STABILITY OF THE BUILDING AND ITS COMPONENTS DURING CONSTRUCTION AND ERECTION. THE CONTRACTOR SHALL RETAIN A LICENSED STRUCTURAL ENGINEER TO DESIGN TEMPORARY BRACING/SHORING AND DETERMINE WHERE THE TEMPORARY BRACING/SHORING IS NEEDED.

LIVE LOAD (INTERIOR RENOVATION ONLY):  
OFFICES ABOVE FIRST FLOOR= 50 PSF LIVE LOAD + 20 PSF PARTITION LOAD.

GENERAL NOTES

SCALE: NTS

WOOD NOTES

SCALE: NTS


REVISIONS

No.	DATE	ISSUE
0	6-19-05	FOR CONSTRUCTION
1	7-8-05	FOR CONSTRUCTION

SHEET TITLE:

FRAMING PLAN

DESIGNED:	ED
DRAWN:	PM
DATE:	6-16-05
CADD FILE:	5037-S1
PROJECT No:	5037

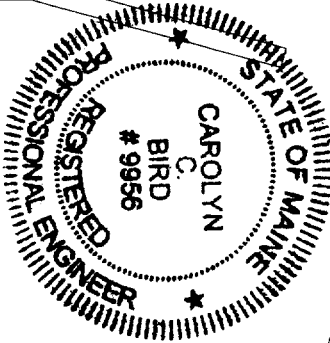

FASTEN 2x12 PT LEDGER TO FACE OF EXIST. BRICK WALL w/(2)-5/8" DIA. HAS-E RODS AND HIT HY 20 (6" EMBED.) @ 16" o.c. AND AT EACH END OF LEDGER

PROVIDE SIMPSON LUS210-2 FACE MOUNTED HANGERS @ DOUBLE 2x10 JOISTS @ 2x12 PT LEDGER

2x12 PT LEDGER

DOUBLE 2x10's @ 16" o.c.

EXIST. DOUBLE 2x10 JOIST  
EXIST. DOUBLE 2x10 JOIST

EXIST. 3x10 JOISTS

EXIST. COLUMN

EXISTING 10x10 TIMBER BEAM (LOW)

EXIST. COLUMN

PROVIDE 1 3/4"x11 7/8" BEAM w/SIMPSON HU11 FACE MOUNTED HANGER AT EACH END, TYP.

- NOTES:
1. TOP OF NEW FLOOR TO MATCH EXISTING FLOOR ELEVATION.
  2. FLOOR TOPPING SHALL BE 3/4" PLYWOOD, U.N.O.

PROVIDE SIMPSON LUS210 FACE MOUNTED HANGERS @ 2x10 JOISTS, TYP.

EXIST. JOISTS NOT SHOWN FOR CLARITY

EXISTING 10x10 TIMBER BEAM (LOW)

EXIST. COLUMN

EXISTING 10x10 TIMBER BEAM (LOW)

EXIST. COLUMN

EXIST. 3x10 JOISTS

EXIST. 3x10 BEAM w/SISTERED 2x10

3 1/2"x11 7/8" LVL

EXIST. 3x10 JOISTS

EXIST. (2)-2x10

EXIST. 6" METAL STUD WALL

1 3/4"x11 7/8" LVL

3 1/2" x11 7/8" LVL

SISTER 3 1/2"x11 7/8" LVL TO SIDE OF EXIST. 2x10

EXIST. BRICK WALL w/SUPPORT SHELF FOR EXIST. FLOOR JOISTS

EXIST. JOISTS NOT SHOWN FOR CLARITY

PROVIDE SIMPSON HUS412 FACE MOUNTED HANGER @ EACH END OF LVL

SECOND FLOOR FRAMING PLAN

SCALE: 1/4"=1'-0"