


Notes

- 1) Supporting steelwork and anchor bolts to be designed and furnished by others.
- 2) All supporting steel must be level at top.
- 3) Beams should be selected in accordance with accepted structural practice, maximum deflection of beam under unit to be 1/360 of span, not to exceed 1/2 inch.
- 4) Supporting steel will be greater than or equal to the length of the basin.
- 5) Alternatively the unit may be supported on columns at the four corners of the unit. Consult your BAC Representative for details.
- 6) If vibration isolation rails are used between unit and supporting steel, be certain to allow for the length of the vibration rails when determining length of supporting steel. Vibration rail length and mounting hole locations may differ from those of the unit. Refer to vibration isolator drawings for this data.
- 7) Each beam should be designed, as a minimum, for 65% of the total unit operating weight applied as a uniformly distributed load.
- 8) Do not use this drawing to size point vibration isolators. See your BAC Representative for details.
- 9) All Dimensions are in feet and inches. All weights are in pounds.
- 10) Weights include all of the options and accessories.

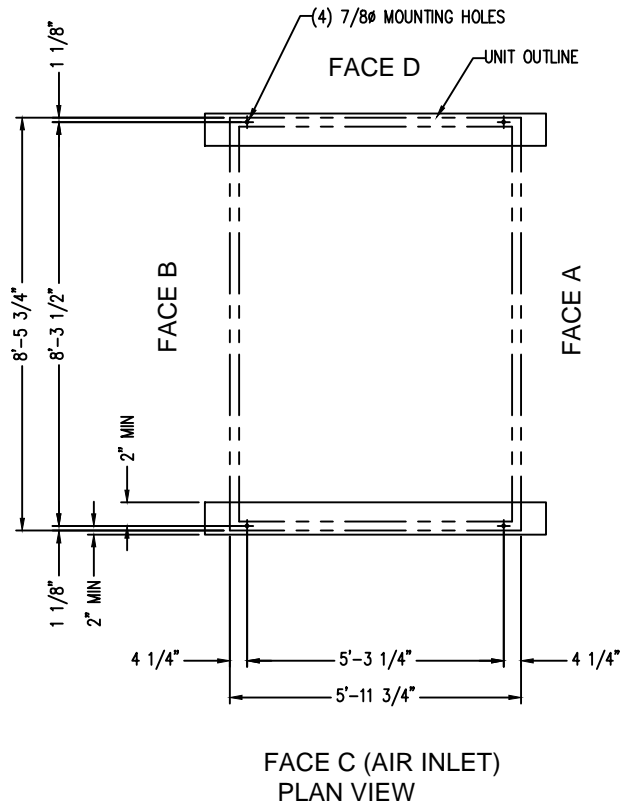

PLAN "A" STEEL

Model Number	Shipping Weight	Operating Weight
FXV-0806B-24D-H	6872	10030

ORDER NO: **U150762301**
DATE: **3/6/2015 1:19:37 PM**



BALTIMORE AIRCOIL COMPANY

Single Cell Unit Support
DRAWING NUMBER:
SS-U150762301