

MARK MUELLER ARCHITECTS
A.I.A.
100 Commercial Street
Suite 205
Portland, Maine 04101
Phone: 207.774.9057
Email: rfm@muellerarchitects.com

© COPYRIGHT 2016
MARK MUELLER ARCHITECTS

62


INDIA

INDIA STREET NEIGHBORHOOD
PORTLAND, MAINE

WALL / FLOOR TYPES

REVISIONS
DATE
JUNE 2016
PROJECT
INDIA STREET
DRAWN BY
MAM

A-4.0

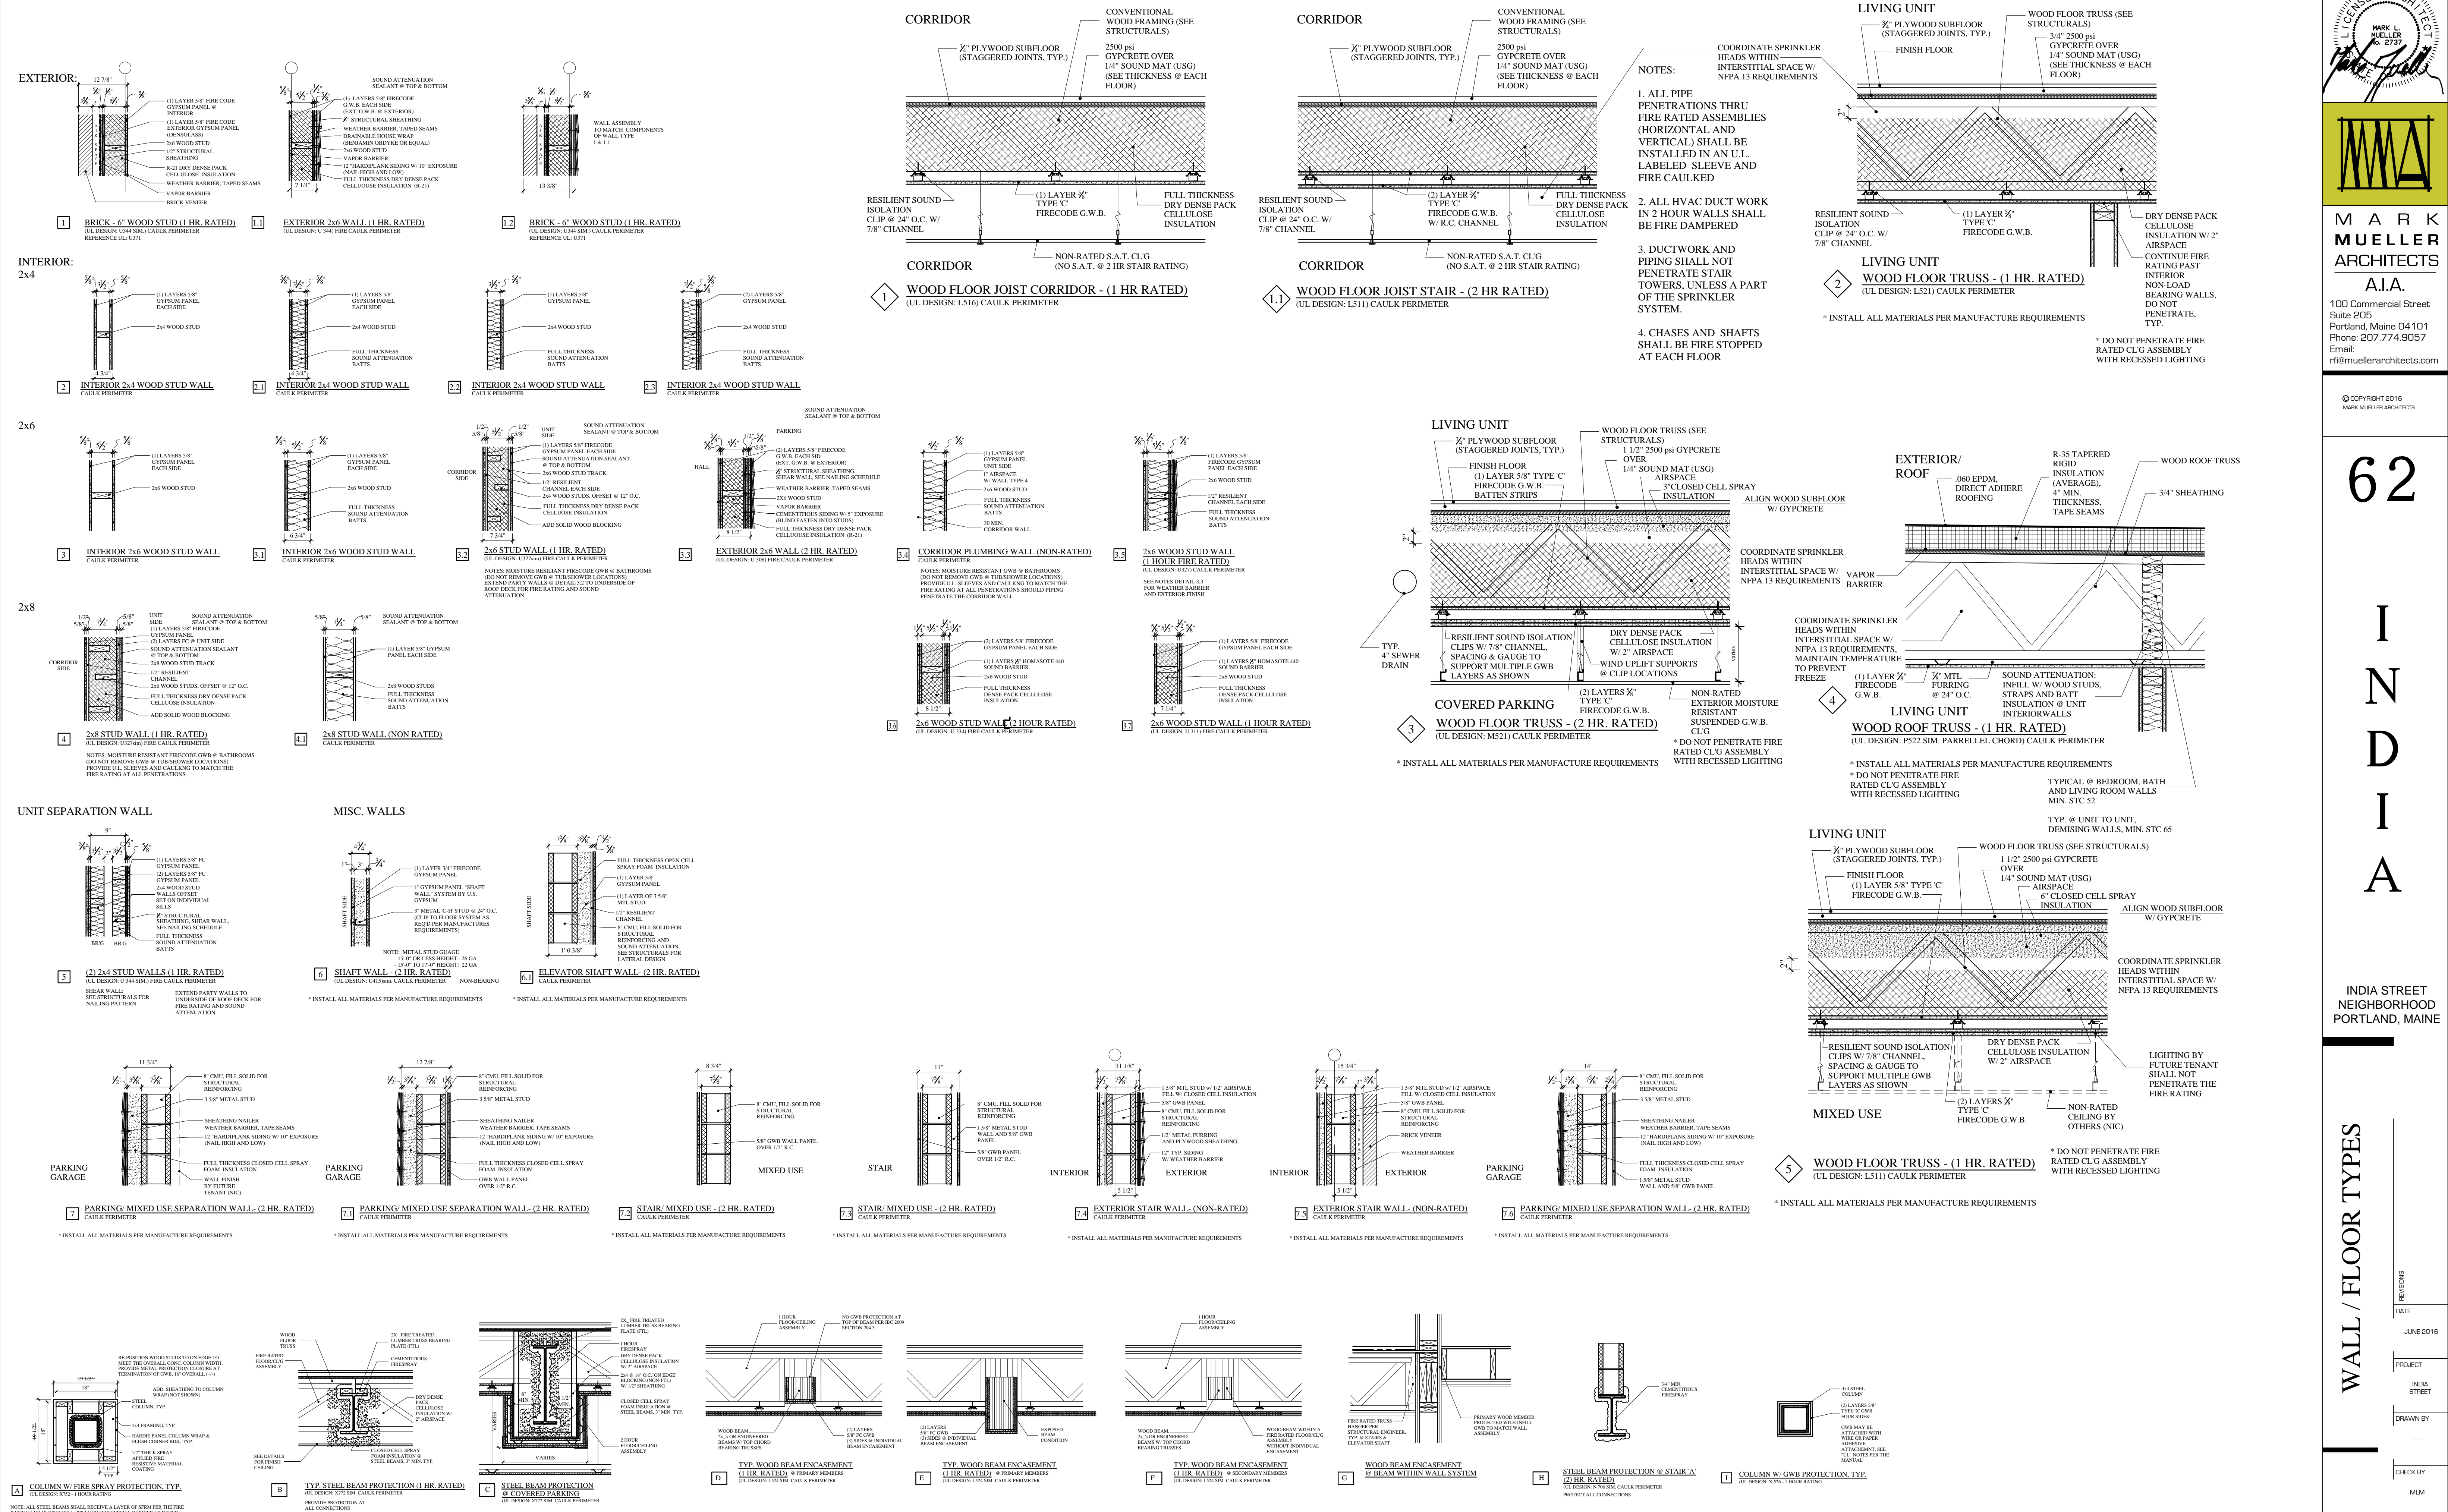

NOTES:

1. ALL PIPE PENETRATIONS THRU FIRE RATED ASSEMBLIES (HORIZONTAL AND VERTICAL) SHALL BE INSTALLED IN AN U.L. LABELED SLEEVE AND FIRE CAULKED
2. ALL HVAC DUCT WORK IN 2 HOUR WALLS SHALL BE FIRE DAMPPED
3. DUCTWORK AND PIPING SHALL NOT PENETRATE STAIR TOWERS, UNLESS A PART OF THE SPRINKLER SYSTEM.
4. CHASES AND SHAFTS SHALL BE FIRE STOPPED AT EACH FLOOR

PROTECTED STRUCTURE:
THE BUILDING IS A 5A PROTECTED STRUCTURE, PRIMARY AND SECONDARY STRUCTURE, INCLUDING WOOD AND STEEL, SHALL BE FIRE SPRAYED AND OR G.W.B ENCASED TO THICKNESS SHOWN IN THE PLANS.

NOTE:
PRIMARY WOOD BEAMS SHALL BE INDIVIDUALLY PROTECTED W/ F.C. G.W.B ENCASEMENT, SECONDARY MEMBERS SHALL BE A PART OF THE HORIZONTAL ASSEMBLY

CONSTRUCTION SET
NOVEMBER 18, 2016