

A	AMPERE	MC	MICROPHONE
AC	ALTERNATING CURRENT	MW	MICROWAVE
AFB	ABOVE FINISHED FLOOR	MLO	MAIN LUG ONLY
AFG	ABOVE FINISHED GRADE	MT	MOUNT
AHU	AIR HANDLING UNIT	MTS	MANUAL TRANSFER SWITCH
AIC	AMPERES INTERRUPTING CAPACITY	MCP	MOTOR CONTROL PANEL
ATS	AUTOMATIC TRANSFER SWITCH	MH	METAL HALIDE
AWG	AMERICAN WIRE GAUGE	MDP	MAIN DISTRIBUTION PANEL
BAS	BUILDING AUTOMATION SYSTEM	MIN	MINIMUM
BKBD	BACKBOARD	N	NEUTRAL
C	CONDUIT	NC	NORMALLY CLOSED
CAT	CATALOG, CATEGORY	NEC	NATIONAL ELECTRICAL CODE
CATV	CABLE TV	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
CB	CIRCUIT BREAKER	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
CCTV	CLOSED CIRCUIT TELEVISION	NIC	NOT IN CONTRACT
CM	CIRCULAR MILS	NF	NON-FUSED
COMM	COMMUNICATIONS	NO	NORMALLY OPEN
CU	MECH CONDENSING UNIT	NO., #	NUMBER
CU	COPPER	NTS	NOT TO SCALE
CUH	CABINET UNIT HEATER	OC	ON CENTER
DC	DIRECT CURRENT	OCC	OCCUPANCY
DDC	DIGITAL DIRECT CONTROL	OH	OVERHEAD
DN	DOWN	P	POLE
DW	DISHWASHER	PA	PUBLIC ADDRESS
DWG	DRAWING	PB	PULLBOX
EF	EXHAUST FAN	PH	PHASE
ELEV	ELEVATOR	PIR	PASSIVE INFRARED
EMT	ELECTRICAL METALLIC TUBING	PNL	PANELBOARD
EP	EXPLOSION PROOF	PIO	PART OF
ERU	ENERGY RECOVERY UNIT	PV	PHOTOVOLTAIC
EWC	ELECTRIC WATER COOLER	PVC	POLY-VINYL CHLORIDE
FACP	FIRE ALARM CONTROL PANEL	REC	RECEPTACLE RECEPT
FB	FLOOR BOX	REF	REFRIGERATOR
FLA	FULL LOAD AMPS	RF	RETURN FAN
FWE	FURNISHED WITH EQUIPMENT	RGS	RIGID GALVANIZED STEEL
G_GND	GROUND	RM	ROOM
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	RMC	RIGID METAL CONDUIT
GFP	GROUND FAULT PROTECTION	RTU	ROOFTOP UNIT
HID	HIGH INTENSITY DISCHARGE	REF	REFRIGERATOR
HOA	HAND-OFF-AUTO SELECTOR SWITCH	SF	SUPPLY FAN
HP	HORSEPOWER	SPDT	SINGLE POLE, DOUBLE THROW
HVAC	HEATING, VENTILATION AND COOLING UNIT	SQ	SQUARE
IDS	INTRUSION DETECTION SYSTEM	TEL	TELEPHONE
IG	ISOLATED GROUND	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
IMC	INTERMEDIATE METAL CONDUIT	TYP	TYPICAL
IR	INFRARED	UF	UNDER FLOOR
K	KILO	UG	UNDERGROUND
KMIL	KILO CIRCULAR MILS	UH	UNIT HEATER
KW	KILOWATT	UL	UNDERWRITER'S LABORATORY
KVA	KILO VOLT-AMPS	UNO	UNLESS NOTED OTHERWISE
LAN	LOCAL AREA NETWORK	UPS	UNINTERRUPTIBLE POWER SUPPLY
LC	LIGHTING CONTACTOR	V	VOLTS
LF	LINEAR FEET	VFD	VARIABLE FREQUENCY DRIVE
LC	LOADCENTER	W	WATT
LCP	LIGHTING CONTROL PANEL	WP	WEATHERPROOF
LED	LIGHT EMITTING DIODE	WG	WIREGUARD
LTG	LIGHTING	XFMR	TRANSFORMER
LTS	LIGHTS		
MAX	MAXIMUM		
MCB	MAIN CIRCUIT BREAKER	(E)	EXISTING ITEM TO REMAIN
MECH	MECHANICAL	(R)	REMOVE ITEM AND DISPOSE OF PROPERLY
MH	MOUNTING HEIGHT	(ER)	RELOCATED ITEM AT NEW LOCATION
		(RL)	REMOVE AND RELOCATE

NOTE

SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET ARE FOR REFERENCE ONLY AND DO NOT NECESSARILY INDICATE THEIR INCORPORATION INTO THE DESIGN

LIGHTING SWITCHES

- \$s LIGHT SWITCH, 20A, 125/277V
- \$3 THREE-WAY LIGHT SWITCH
- \$4 FOUR-WAY LIGHT SWITCH
- \$2 TWO-POLE SWITCH
- \$K KEY OPERATED SWITCH
- \$M MOTOR RATED SWITCH
- \$P SINGLE POLE SWITCH WITH RED PILOT LIGHT - RED LIGHT SHALL GLOW WHEN CIRCUIT IS ENERGIZED
- \$PP MULTI-GANGED SWITCHES, GANG UNDER ONE PLATE, LETTER INDICATES SWITCHING
- \$OS OCCUPANCY SENSOR SWITCH, WALL MOUNTED
- \$OS2 2-BUTTON OCCUPANCY SENSOR SWITCH
- \$OS3 OCCUPANCY SENSOR SWITCH WIRED FOR 3-WAY OPERATION
- \$OSD OCCUPANCY SENSOR SWITCH WITH DIMMING - COORDINATE DIMMING TECHNOLOGY WITH LOAD TO BE DIMMED
- \$OS OCCUPANCY SENSOR SWITCH WITH DIMMING - COORDINATE DIMMING TECHNOLOGY WITH LOAD TO BE DIMMED
- \$O OCCUPANCY SENSOR, CEILING MOUNTED
- \$OB OCCUPANCY SENSOR, WALL MOUNTED
- \$D DIMMER SWITCH - COORDINATE DIMMING TECHNOLOGY WITH LOAD TO BE DIMMED
- \$H HANDICAP SWITCHES FOR HOOD LIGHT AND FAN
- \$T TIMER SWITCH
- \$LV LOW VOLTAGE LIGHT SWITCH, MOMENTARY CONTACT
- LTC LIGHTING TIME CLOCK
- LC LIGHTING CONTACTOR
- LCP LIGHTING CONTROL PANEL
- PC OUTDOOR PHOTOELECTRIC SWITCH
- DS DAYLIGHT HARVESTING SENSOR


- NOTES:**
- MOUNT LIGHT SWITCHES WITH CENTERLINE 48" AFF, UNO
 - LOWER CASE LETTER AT SWITCH INDICATES SWITCHING

EMERGENCY LIGHTING

- WHERE NOTED ON PLANS FIXTURE EQUIPPED WITH EMERGENCY BATTERY DRIVER. CONNECT TO BOTH SWITCHED AND UNSWITCHED PORTION OF LIGHTING CIRCUIT IN ACCORDANCE WITH EMERGENCY BATTERY DRIVER MANUFACTURER'S INSTRUCTIONS.
- EM "EM" INDICATES EMERGENCY WHERE SYMBOL HATCHING IS UNCLEAR
- EMER BATTERY UNIT WITH NO HEADS, MT 7'-6" AFF BP# INDICATES BATTERY UNIT DESIGNATION, CONNECT TO UNSWITCHED PORTION OF AREA LIGHTING BRANCH CIRCUIT, U.N.O.
- EMER BATTERY UNIT WITH INTEGRAL HEADS, MT 7'-6" AFF BP# INDICATES BATTERY UNIT DESIGNATION, CONNECT TO UNSWITCHED PORTION OF AREA LIGHTING BRANCH CIRCUIT, U.N.O.
- SINGLE REMOTE EMERGENCY LIGHT HEAD, MOUNT 7'-6" AFF BP# INDICATES BATTERY UNIT CONNECTED TO
- DOUBLE REMOTE EMERGENCY LIGHT HEAD, MOUNT 7'-6" AFF BP# INDICATES BATTERY UNIT CONNECTED TO
- DOUBLE REMOTE EMERGENCY LIGHT HEAD, CEILING MOUNTED BP# INDICATES BATTERY UNIT CONNECTED TO
- EXIT SIGN, CEILING MOUNTED, SHADING INDICATES FACE(S) ARROWHEAD INDICATES CHEVRON(S) REQUIRED, CONNECT TO UNSWITCHED PORTION OF AREA LIGHTING BRANCH CIRCUIT, U.N.O.
- EXIT SIGN, WALL MOUNTED, SHADING INDICATES FACE(S) MOUNT AT 7'-6" AFF OR OVER DOOR, CONNECT TO UNSWITCHED PORTION OF AREA LIGHTING BRANCH CIRCUIT, U.N.O.
- CENTRAL LIGHTING INVERTER

REFER TO LUMINAIRE SCHEDULE FOR FIXTURE LEGEND

TYPICAL FOR ALL FIXTURE TYPES :

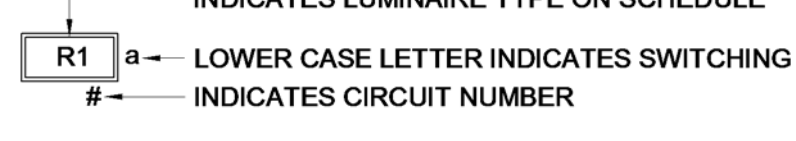

- BRANCH CIRCUIT WIRING NOT SHOWN. CIRCUITING SHALL IN ACCORDANCE WITH APPLICABLE CODES AND STANDARD PRACTICE. PROVIDE A 20A, 1P CIRCUIT BREAKER FOR EACH LIGHTING AND RECEPTACLE CIRCUIT UNLESS OTHERWISE INDICATED OR NOTED. CONNECT NO MORE THAN SIX DUPLEX CONVENIENCE RECEPTACLES PER BRANCH CIRCUIT. CONNECTED LOAD ON LIGHTING CIRCUITS SHALL NOT EXCEED 12 AMPS. DO NOT SCALE THE DRAWINGS. REFER TO ARCHITECTURAL DRAWINGS AND EXISTING CONDITIONS FOR EXACT DIMENSIONS.
- THE LOCATION OF EQUIPMENT, OUTLETS, ETC. AS GIVEN ON THE DRAWINGS IS APPROXIMATE. IT SHALL BE UNDERSTOOD THAT THESE LOCATIONS ARE SUBJECT TO MODIFICATION AS MAY BE FOUND NECESSARY OR DESIRABLE AT THE TIME OF INSTALLATION IN ORDER TO MEET PROJECT REQUIREMENTS. SUCH CHANGES SHALL BE MADE WITHOUT EXTRA CHARGE.
- ALL ELECTRICAL DEVICES, WHEN INSTALLED, SHALL BE PROTECTED FROM DAMAGE DURING CONSTRUCTION. COVER PLATES SHALL BE INSTALLED AFTER FINISH MATERIALS HAVE BEEN APPLIED.
- COORDINATE ALL WORK WITH OTHER DIVISIONS AND THE OWNER.
- VERIFY EXACT POWER REQUIREMENTS OF EQUIPMENT PRIOR TO ROUGH IN.
- COORDINATE LOCATIONS OF WALL MOUNTED LIGHT FIXTURES AND OTHER ELECTRICAL ITEMS WITH ARCHITECTURAL INTERIOR ELEVATIONS.

GENERAL NOTES

- SINGLE RECEPTACLES**
- 20A, 125V, 2P, 3W, NEMA 5-20R
 - 20A, 125V, 2P, 3W, NEMA L5-20R (TWISTLOCK)
 - 30A DRYER RECEPTACLE - 125/250V, 3P, 4W, GROUNDING, NEMA 14-30R, (3)#10+(1)#10G TO 30A, 2P CIRCUIT BREAKER
 - 30A, 250V, 2P, 3W, NEMA 6-30R
 - 50A RANGE RECEPTACLE - 125/250V, 3P, 4W, GROUNDING, NEMA 14-50R, (3)#6+(1)#10 TO 50A, 2P CIRCUIT BREAKER
 - 20A, 250V, 2P, 3W, NEMA 6-20R

NOTE:

PROVIDE MATCHING CORD AND PLUG FOR SINGLE RECEPTACLES

FLOOR AND CEILING DEVICES

- F 20A, 125V, 2P, 3W, NEMA 5-20R, MOUNT IN FLUSH FLOOR BOX
- F 30A DRYER RECEPTACLE, 20A, 125V, 2P, 3W, NEMA 5-20R, MOUNT IN FLUSH FLOOR BOX
- P 20A, 125V, 2P, 3W, NEMA 5-20R, PEDESTAL MOUNTED
- P 20A, 125V, 2P, 3W, NEMA 5-20R, SINGLE RECEPTACLE, PEDESTAL MOUNTED
- C 20A, 125V, 2P, 3W, NEMA 5-20R, DUPLEX RECEPTACLE, FLUSH MOUNTED IN CEILING
- C 20A, 125V, 2P, 3W, NEMA 5-20R, DOUBLE DUPLEX RECEPTACLE, FLUSH MOUNTED IN CEILING
- C 20A, 125V, 2P, 3W, NEMA 5-20R, GFCI RECEPTACLE, FLUSH MOUNTED IN CEILING
- C 20A, 125V, 2P, 3W, NEMA 5-20R, DOUBLE GFCI RECEPTACLE, FLUSH MOUNTED IN CEILING
- O OVERHEAD RECEPTACLE DROP, DUPLEX
- O OVERHEAD RECEPTACLE DROP, DOUBLE DUPLEX
- O OVERHEAD RECEPTACLE DROP, GFCI
- PT-1 4" POKE-THRU DEVICE, DUAL SERVICE FURNITURE FEED. BASIS OF DESIGN: WIREMOLD AFFATC
- PT-2 6" POKE-THRU DEVICE, WITH (2) DUPLEX RECEPTACLES AND TELDATA AS INDICATED ON PLANS. BASIS OF DESIGN: LEGRAND 6AT SERIES.
- 20A, 125V, 2P, 3W, NEMA 5-20R MULTI-SERVICE FLUSH FLOOR BOX - WIREMOLD EFB45 SERIES OR APPROVED EQUAL. COVER SHALL BE FLUSH STYLE WITH FLOOR INSERT. COVER FINISH COLOR SHALL BE SELECTED BY ARCHITECT FROM MANUFACTURER'S STANDARD FINISHES.

RECEPTACLES

- 20A, 125V, 2P, 3W, NEMA 5-20R DUPLEX RECEPTACLE
- DOUBLE DUPLEX RECEPTACLE
- DUPLEX RECEPTACLE, HATCH INDICATES AFCI PROTECTION AND TAMPERPROOF
- TAMPERPROOF DUPLEX RECEPTACLE
- GFCI DUPLEX RECEPTACLE, MOUNT 44" AFF UNO
- GFCI DOUBLE DUPLEX RECEPTACLE, MOUNT 44" AFF UNO
- GFCI RECEPTACLE FOR ELECTRIC WATER COOLER - COORDINATE LOCATION WITH DIVISION 22.
- GFCI RECEPTACLE WITH WEATHERPROOF COVER
- GFCI RECEPTACLE IN WP ENCLOSURE ON ROOF
- MULTI-OUTLET STRIP, PROVIDE OUTLETS 24" OC UNO, MOUNT 48" AFF UNO
- SURFACE RACEWAY WITH DIVIDER, MOUNT 44" AFF UNO. PROVIDE NEMA 5-20 RECEPTACLES AND TECHNOLOGY OUTLETS AS SHOWN ON PLAN

- NOTES:**
- MOUNT RECEPTACLES WITH CENTERLINE 18" AFF UNO
 - MOUNT EXTERIOR RECEPTACLES WITH CENTERLINE 24" AFF UNO

RECEPTACLES

- CAMERA - PROVIDE SINGLE GANG BOX WITH 1/2" CONDUIT AND (1) CATEGORY 6 OUTLET AND CABLING. MOUNTING HEIGHT AND LOCATION SHALL BE CONFIRMED WITH OWNER PRIOR TO ROUGH IN. CONFIRM LOCATION AND HEIGHT WITH OWNER PRIOR TO ROUGH IN. PROVIDE 20' OF SLACK CABLING AT EACH OUTLET. ALL CABLING SHALL BE RUN TO THE TEL/DATA RACK.
- SECURITY PANEL, MOUNT WITH TOP OF PANEL NOT MORE THAN 72" AFF
- ANNUNCIATOR, MOUNT WITH TOP OF PANEL NOT MORE THAN 72" AFF
- ACCESS CONTROL KEYPAD - PROVIDE RECESSED WALL MOUNTED SINGLE GANG BOX 44" AFF WITH 1/2" CONDUIT WITH PULL STRING. EXTERIOR BOXES SHALL BE WATERPROOF.
- ACCESS CONTROL KEYPAD/CARD READER - PROVIDE RECESSED WALL MOUNTED SINGLE GANG BOX 44" AFF WITH 1/2" CONDUIT WITH PULL STRING. EXTERIOR BOXES SHALL BE WATERPROOF.
- SECURITY SYSTEM INTERFACE KEYPAD - PROVIDE RECESSED WALL MOUNTED SINGLE GANG BOX 44" AFF WITH 3/4" CONDUIT WITH PULL STRING
- MOTION SENSOR, DUAL TECHNOLOGY, PIR/MICROWAVE, CEILING MOUNTED - PROVIDE RECESSED SINGLE GANG BOX IN CEILING WITH 1/2" CONDUIT
- REQUEST TO EXIT - PROVIDE RECESSED WALL MOUNTED SINGLE GANG BOX 44" AFF WITH 1/2" CONDUIT WITH PULL STRING
- HIGH TEMPERATURE SENSOR - PROVIDE RECESSED SINGLE GANG BOX IN CEILING WITH 1/2" CONDUIT
- LOW TEMPERATURE SENSOR - PROVIDE RECESSED SINGLE GANG BOX IN CEILING WITH 1/2" CONDUIT
- DOOR POSITION SWITCH - PROVIDE RECESSED 3/4" CONDUIT IN DOOR FRAME

SECURITY

- PANELBOARD - SURFACE MOUNTED
- PANELBOARD - FLUSH MOUNTED
- FUSED DISCONNECT SWITCH
- NON-FUSED DISCONNECT SWITCH
- MOTOR STARTER - NUMBER INDICATES NEMA SIZE
- COMBINATION MOTOR STARTER/FUSED DISCONNECT
- MOTOR OR FAN
- METER AND CABINET
- JUNCTION BOX - CEILING MOUNTED
- JUNCTION BOX - WALL MOUNTED
- JUNCTION BOX - FLUSH FLOOR MOUNTED
- JUNCTION BOX - PEDESTAL MOUNTED
- TRANSFORMER - NUMBER INDICATES DESIGNATION SEE TRANSFORMER SCHEDULE
- VARIABLE FREQUENCY DRIVE
- TRANSIENT VOLTAGE SURGE SUPPRESSOR
- EMERGENCY SHUTOFF SWITCH - WALL MOUNTED 48" TO CENTERLINE - PROVIDE TAMPER-PROOF COVER
- SHUT-OFF SWITCH
- CONDUIT TURNING UP
- CONDUIT TURNING DOWN
- WIRING UNDERGROUND OR UNDERSLAB
- HOMERUN - (2)#12+(1)#12G UNO - INDICATES OUTLET ON INDIVIDUAL BRANCH CIRCUIT
- SINGLE-PHASE HOMERUN OR MULTIPLE HOMERUN UTILIZING THE SAME CONDUIT
- 3-PHASE HOMERUN OR MULTIPLE HOMERUN UTILIZING THE SAME CONDUIT
- FLEXIBLE CONNECTION
- GROUNDING SYSTEM
- POWER POLE
- PUSHBUTTON
- DOORBELL CHIME
- SYSTEMS FURNITURE WHIP, DUAL SERVICE, WALL MOUNTED
- MOTORIZED DOOR OPERATOR AND PUSH PADDLE - FURNISHED BY DIV 08, WIRED BY DIV 26
- ENCLOSED CIRCUIT BREAKER
- AUTOMATIC TRANSFER SWITCH
- HAND DRYER, COORDINATE HEIGHT WITH ARCHITECTURAL PLANS
- SYSTEMS FURNITURE FEED

POWER DISTRIBUTION


- MOTORIZED SHADE FURNISHED BY DIVISION 12, WIRED BY DIVISION 26
- SHADE CONTROLLER FURNISHED BY DIVISION 12, WIRED BY DIVISION 26, COORDINATE LOCATION WITH ARCHITECT, COORDINATE WIRING REQUIREMENTS WITH DIVISION 12
- MOTORIZED SHADE CONTROL SWITCH FURNISHED BY DIVISION 12, WIRED BY DIVISION 26, COORDINATE LOCATION WITH ARCHITECT, COORDINATE WIRING REQUIREMENTS WITH DIVISION 12

MISCELLANEOUS

- FIRE ALARM CONTROL PANEL, MOUNT WITH TOP OF PANEL NOT MORE THAN 72" AFF
- FIRE ALARM ANNUNCIATOR, MOUNT WITH TOP OF PANEL NOT MORE THAN 72" AFF, WIRED TO FACP
- SMOKE DETECTOR, WIRED TO FACP
- SMOKE DETECTOR, "E" INDICATES CONNECTION FOR ELEVATOR RECALL, WIRED TO FACP
- SINGLE STATION SMOKE DETECTOR WITH AUDIBLE INDICATING APPLIANCE, WALL MOUNTED
- SINGLE STATION SMOKE DETECTOR WITH AUDIBLE/VISUAL INDICATING APPLIANCE, CEILING MOUNTED
- SINGLE/MULTI-STATION SMOKE/CARBON MONOXIDE DETECTOR WITH AUDIBLE/VISUAL INDICATING APPLIANCE, CEILING MOUNTED
- SINGLE/MULTI-STATION SMOKE/CARBON MONOXIDE DETECTOR WITH AUDIBLE INDICATING APPLIANCE, WALL MOUNTED
- HEAT DETECTOR, WIRED TO FACP
- HEAT DETECTOR, "E" INDICATES CONNECTION FOR ELEVATOR RECALL, WIRED TO FACP
- DUCT SMOKE DETECTOR, WIRED TO FACP
- GAS DETECTOR, WIRED TO FACP
- GAS VALVE, WIRED TO FACP
- FLAME DETECTOR, WIRED TO FACP
- REMOTE TEST/INDICATOR FOR DUCT SMOKES, MOUNT ON CEILING BENEATH UNIT, OR WALL MOUNT WHERE INDICATED ON PLANS
- MANUAL PULL STATION, MOUNT 48" AFF
- HORN/STROBE, WALL MOUNTED CANDELA AS NOTED ON PLANS, WIRED TO FACP
- HORN/STROBE, CEILING MOUNTED, CANDELA AS NOTED ON PLANS, WIRED TO FACP
- STROBE ONLY INDICATING APPLIANCE, WALL MOUNTED, CANDELA AS NOTED ON PLANS, WIRED TO FACP
- STROBE ONLY INDICATING APPLIANCE, CEILING MOUNTED, CANDELA AS NOTED ON PLANS, WIRED TO FACP
- STROBE ONLY INDICATING APPLIANCE, WALL MOUNTED, CANDELA AS NOTED ON PLANS, 120V, CONNECT TO OPERATE UPON ACTIVATION OF ROOM SMOKE DETECTOR
- STROBE ONLY INDICATING APPLIANCE, WALL MOUNTED, CANDELA AS NOTED ON PLANS, 120V, CONNECT TO OPERATE UPON ACTIVATION OF ROOM SMOKE DETECTOR
- MINI HORN, WALL MOUNTED, WIRED TO FACP
- MINI HORN, CEILING MOUNTED, WIRED TO FACP
- HORN/STROBE WITH PULL STATION DIRECTLY BELOW
- MAGNETIC DOOR HOLD OPEN DEVICE, WIRED TO FACP
- TRANSFORMER
- SPRINKLER SYSTEM WATER FLOW SWITCH, PROVIDED UNDER DIVISION 23, WIRED TO FACP UNDER DIVISION 26
- SPRINKLER SYSTEM TAMPER SWITCH, PROVIDED UNDER DIVISION 23, WIRED TO FACP UNDER DIVISION 26
- SPRINKLER SYSTEM CHECK VALVE PRESSURE SWITCH, FURNISHED AND INSTALLED UNDER DIVISION 23, WIRED TO FACP UNDER DIVISION 26
- SPRINKLER SYSTEM PRE-ACTION VALVE, FURNISHED AND INSTALLED UNDER DIVISION 21, WIRED TO FACP UNDER DIVISION 26
- KNOX BOX, MOUNT 60" AFF
- SMOKE DAMPER, WIRED TO FACP
- FIRE AND SMOKE DAMPER, WIRED TO FACP
- HORN/STROBE, CANDELA AS NOTED ON PLANS, WIRED TO FACP
- SPEAKER/STROBE, WALL MOUNTED, CANDELA AS NOTED ON PLANS, WIRED TO FACP
- SPEAKER/STROBE, CEILING MOUNTED, CANDELA AS NOTED ON PLANS, WIRED TO FACP
- MASTER BOX

FIRE ALARM

160 Veranda Street
Portland, Maine 04103
Tel: 207-221-2266
Fax: 207-221-2266
Web: www.allied-eng.com

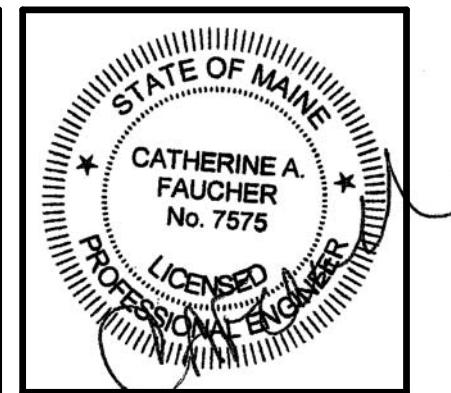

29 BLACK POINT ROAD
SCARBOROUGH, MAINE 04074
207-883-4307
WWW.GAWRONTURGEON.COM

GAWRON
TURGEON
ARCHITECTS, P.C.

cPort Credit Union

50 India Street
Portland, Maine

REVISIONS		
#	DATE	DESCRIPTION
1	09.19.17	PROGRESS NOT FOR CONSTRUCTION
2	09.29.17	ISSUED FOR CONSTRUCTION

DATE:	09.29.17
PROJECT #	010416
DRAWN BY:	GMC
CHECKED BY:	SRM
DRAWING SCALE	AS NOTED

SHEET TITLE

ELECTRICAL
LEGENDS,
ABBREVIATIONS
AND GENERAL
NOTES

E000

© COPYRIGHT 1985-2017
REPRODUCTION OR RELEASE OF
THIS DOCUMENT WITHOUT
THE WRITTEN PERMISSION OF
GAWRON ARCHITECTS IS PROHIBITED