















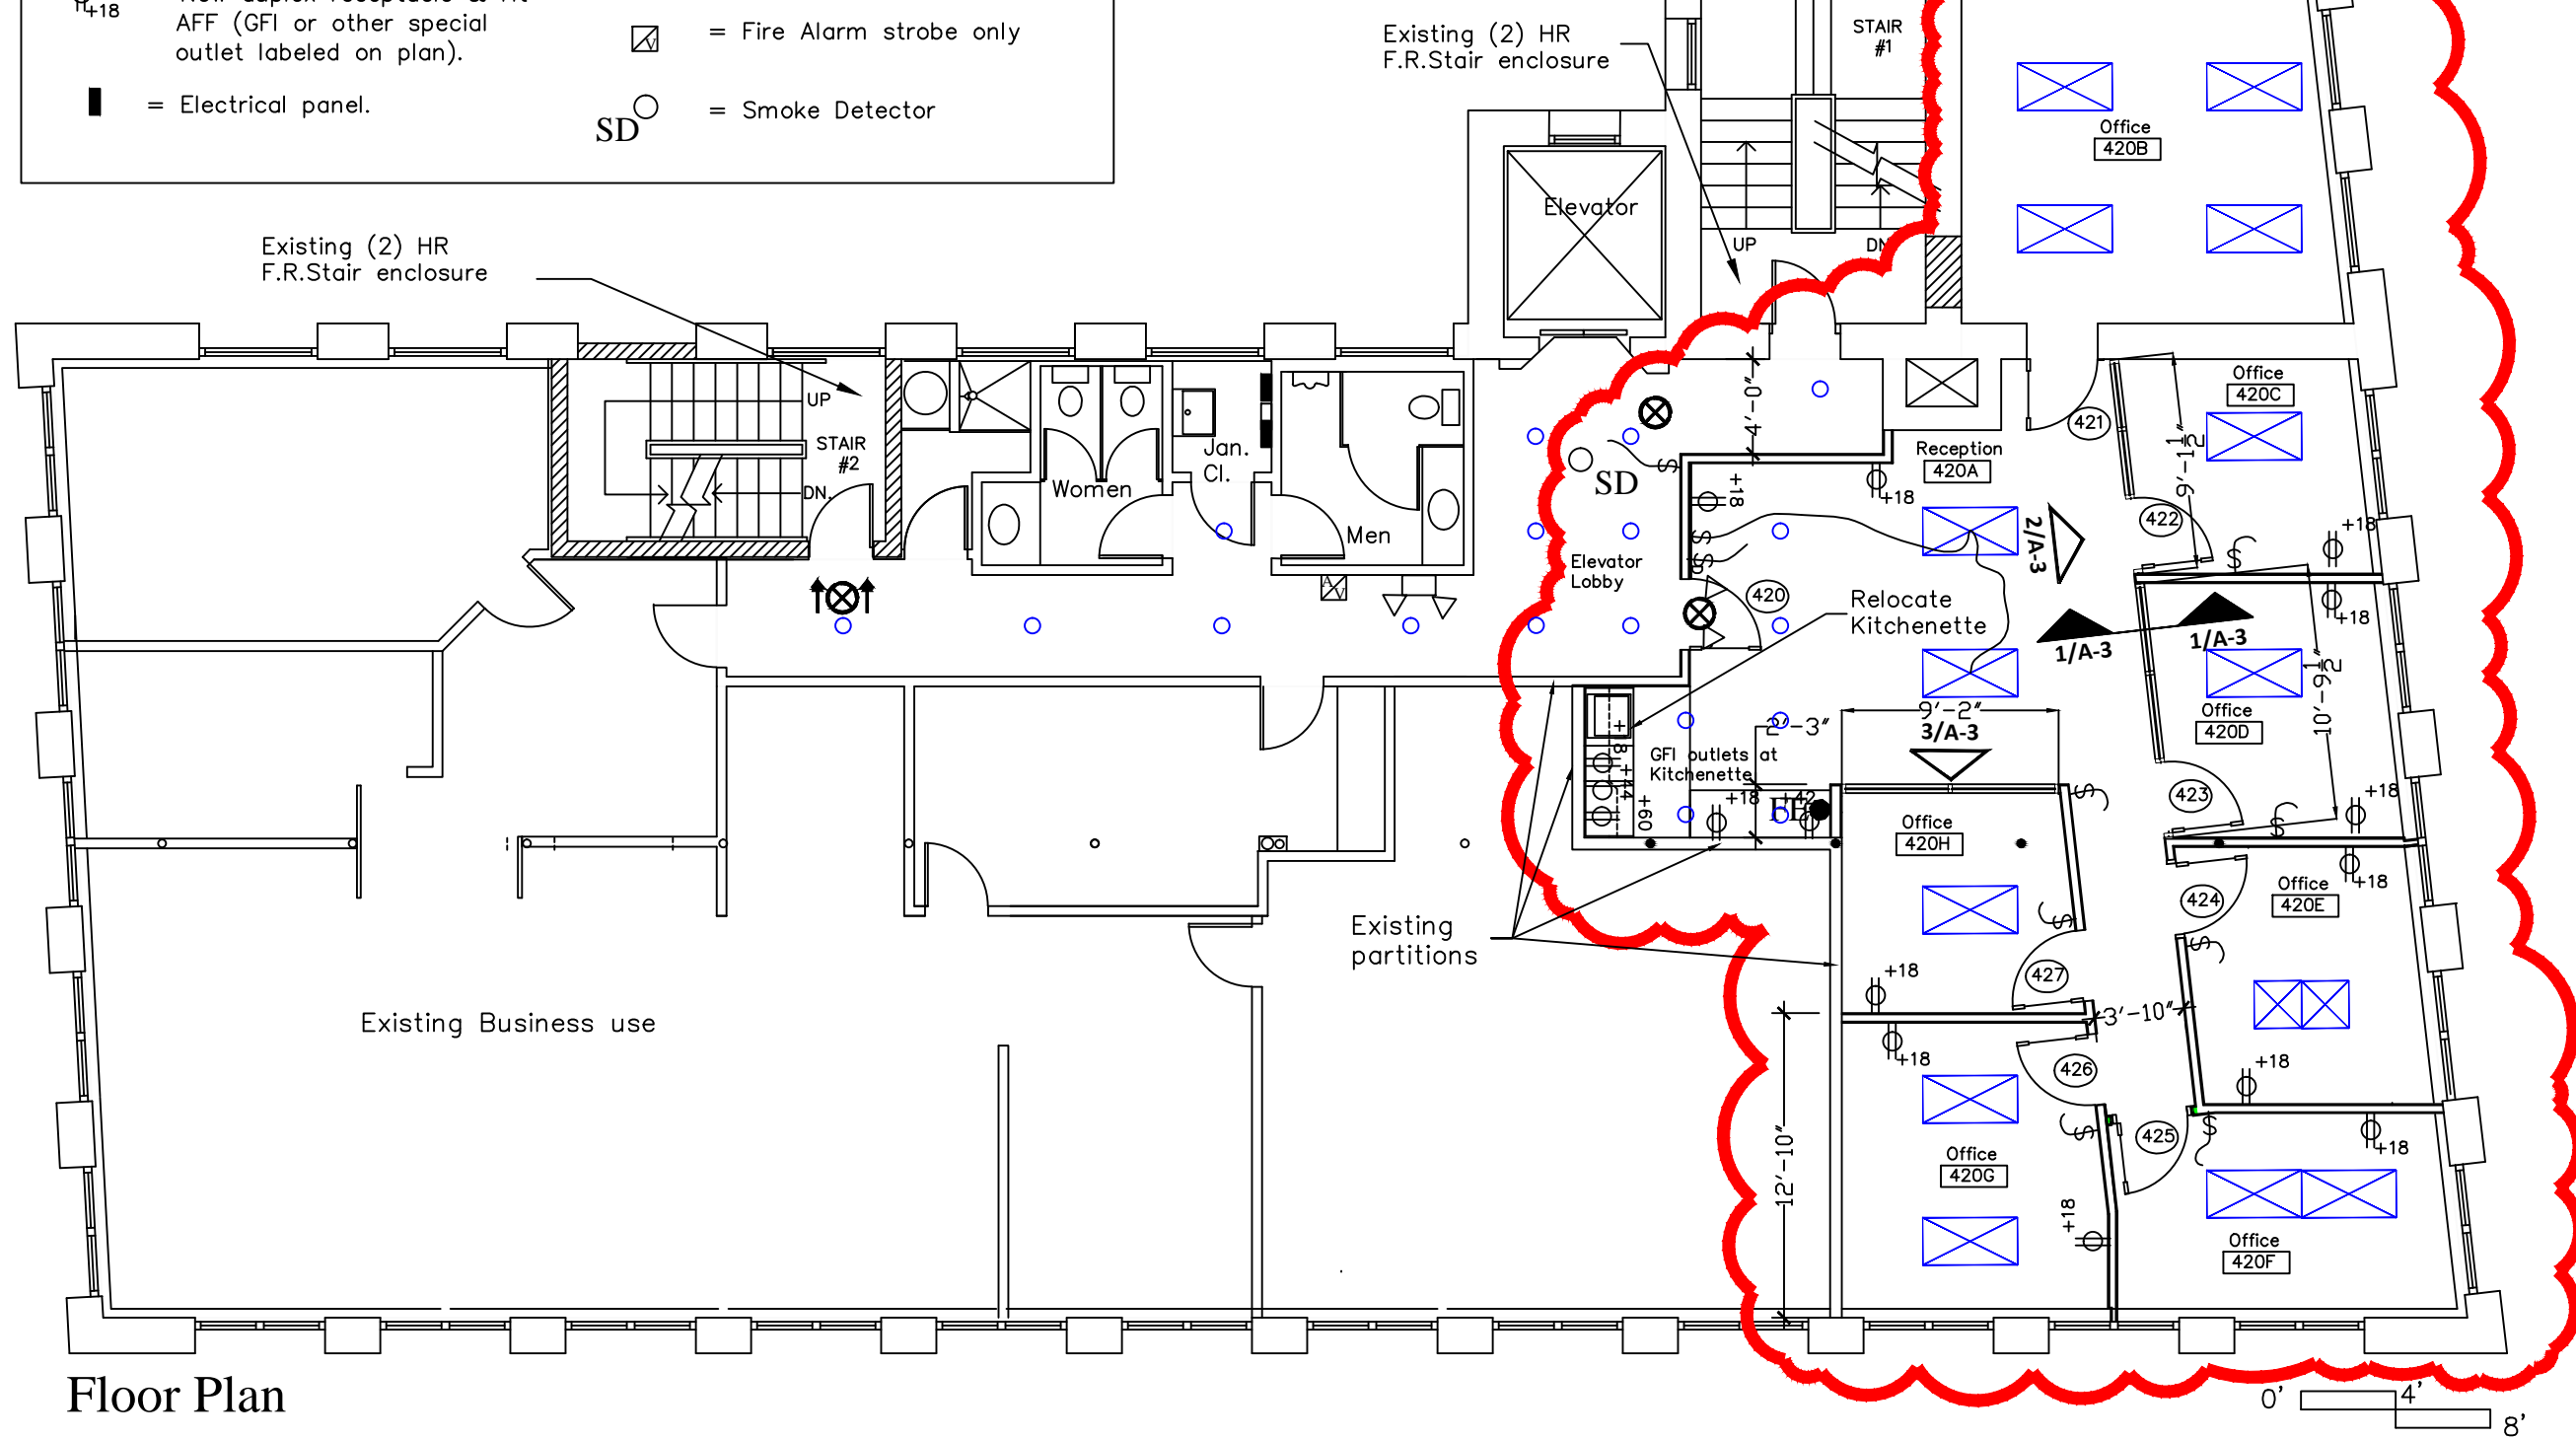

**Legend:**

-  = 2x4 Recessed LED Troffer
-  = 2x2 Recessed LED Troffer
-  = Recess LED can Light
-  = Switch
-  = Dimmer switch
-  = New duplex receptacle & Ht AFF (GFI or other special outlet labeled on plan).
-  = Electrical panel.
-  = Fire Extinguisher – min. required capacity = 2A. Min. Provided capacity = 2A
-  = LED Exit light.
-  = Combination Exit and emergency light.
-  = Emergency Light
-  = Fire Alarm Horn Strobe
-  = Fire Alarm strobe only
-  = Smoke Detector

**General Notes:**

This permit is for Suite 420 and a portion of the elevator lobby (inside the clouded area). Areas outside the clouded area have been previously permitted.  
 Building is fully sprinklered and monitored to NFPA.  
 All work to be in compliance with Maine Uniform Building Code, and City of Portland City Code Chapter 10 – Fire Prevention and Protection which includes NFPA 1 & NFPA101..  
 Finish Schedule to follow.  
 All Dimensions to face of finish.  
 Existing electrical outlets and switches in existing walls to remain to remain and are not shown for clarity.  
 Renovation for existing tenant – no change of use.  
 Entire 4th floor is a Business use.

**Area to be renovated under this permit application**



**Floor Plan - 4th Floor  
5 Milk Street - Portland, ME**

Revisions:

**A-1**

Sept. 15, 2017

Floor Plan

