
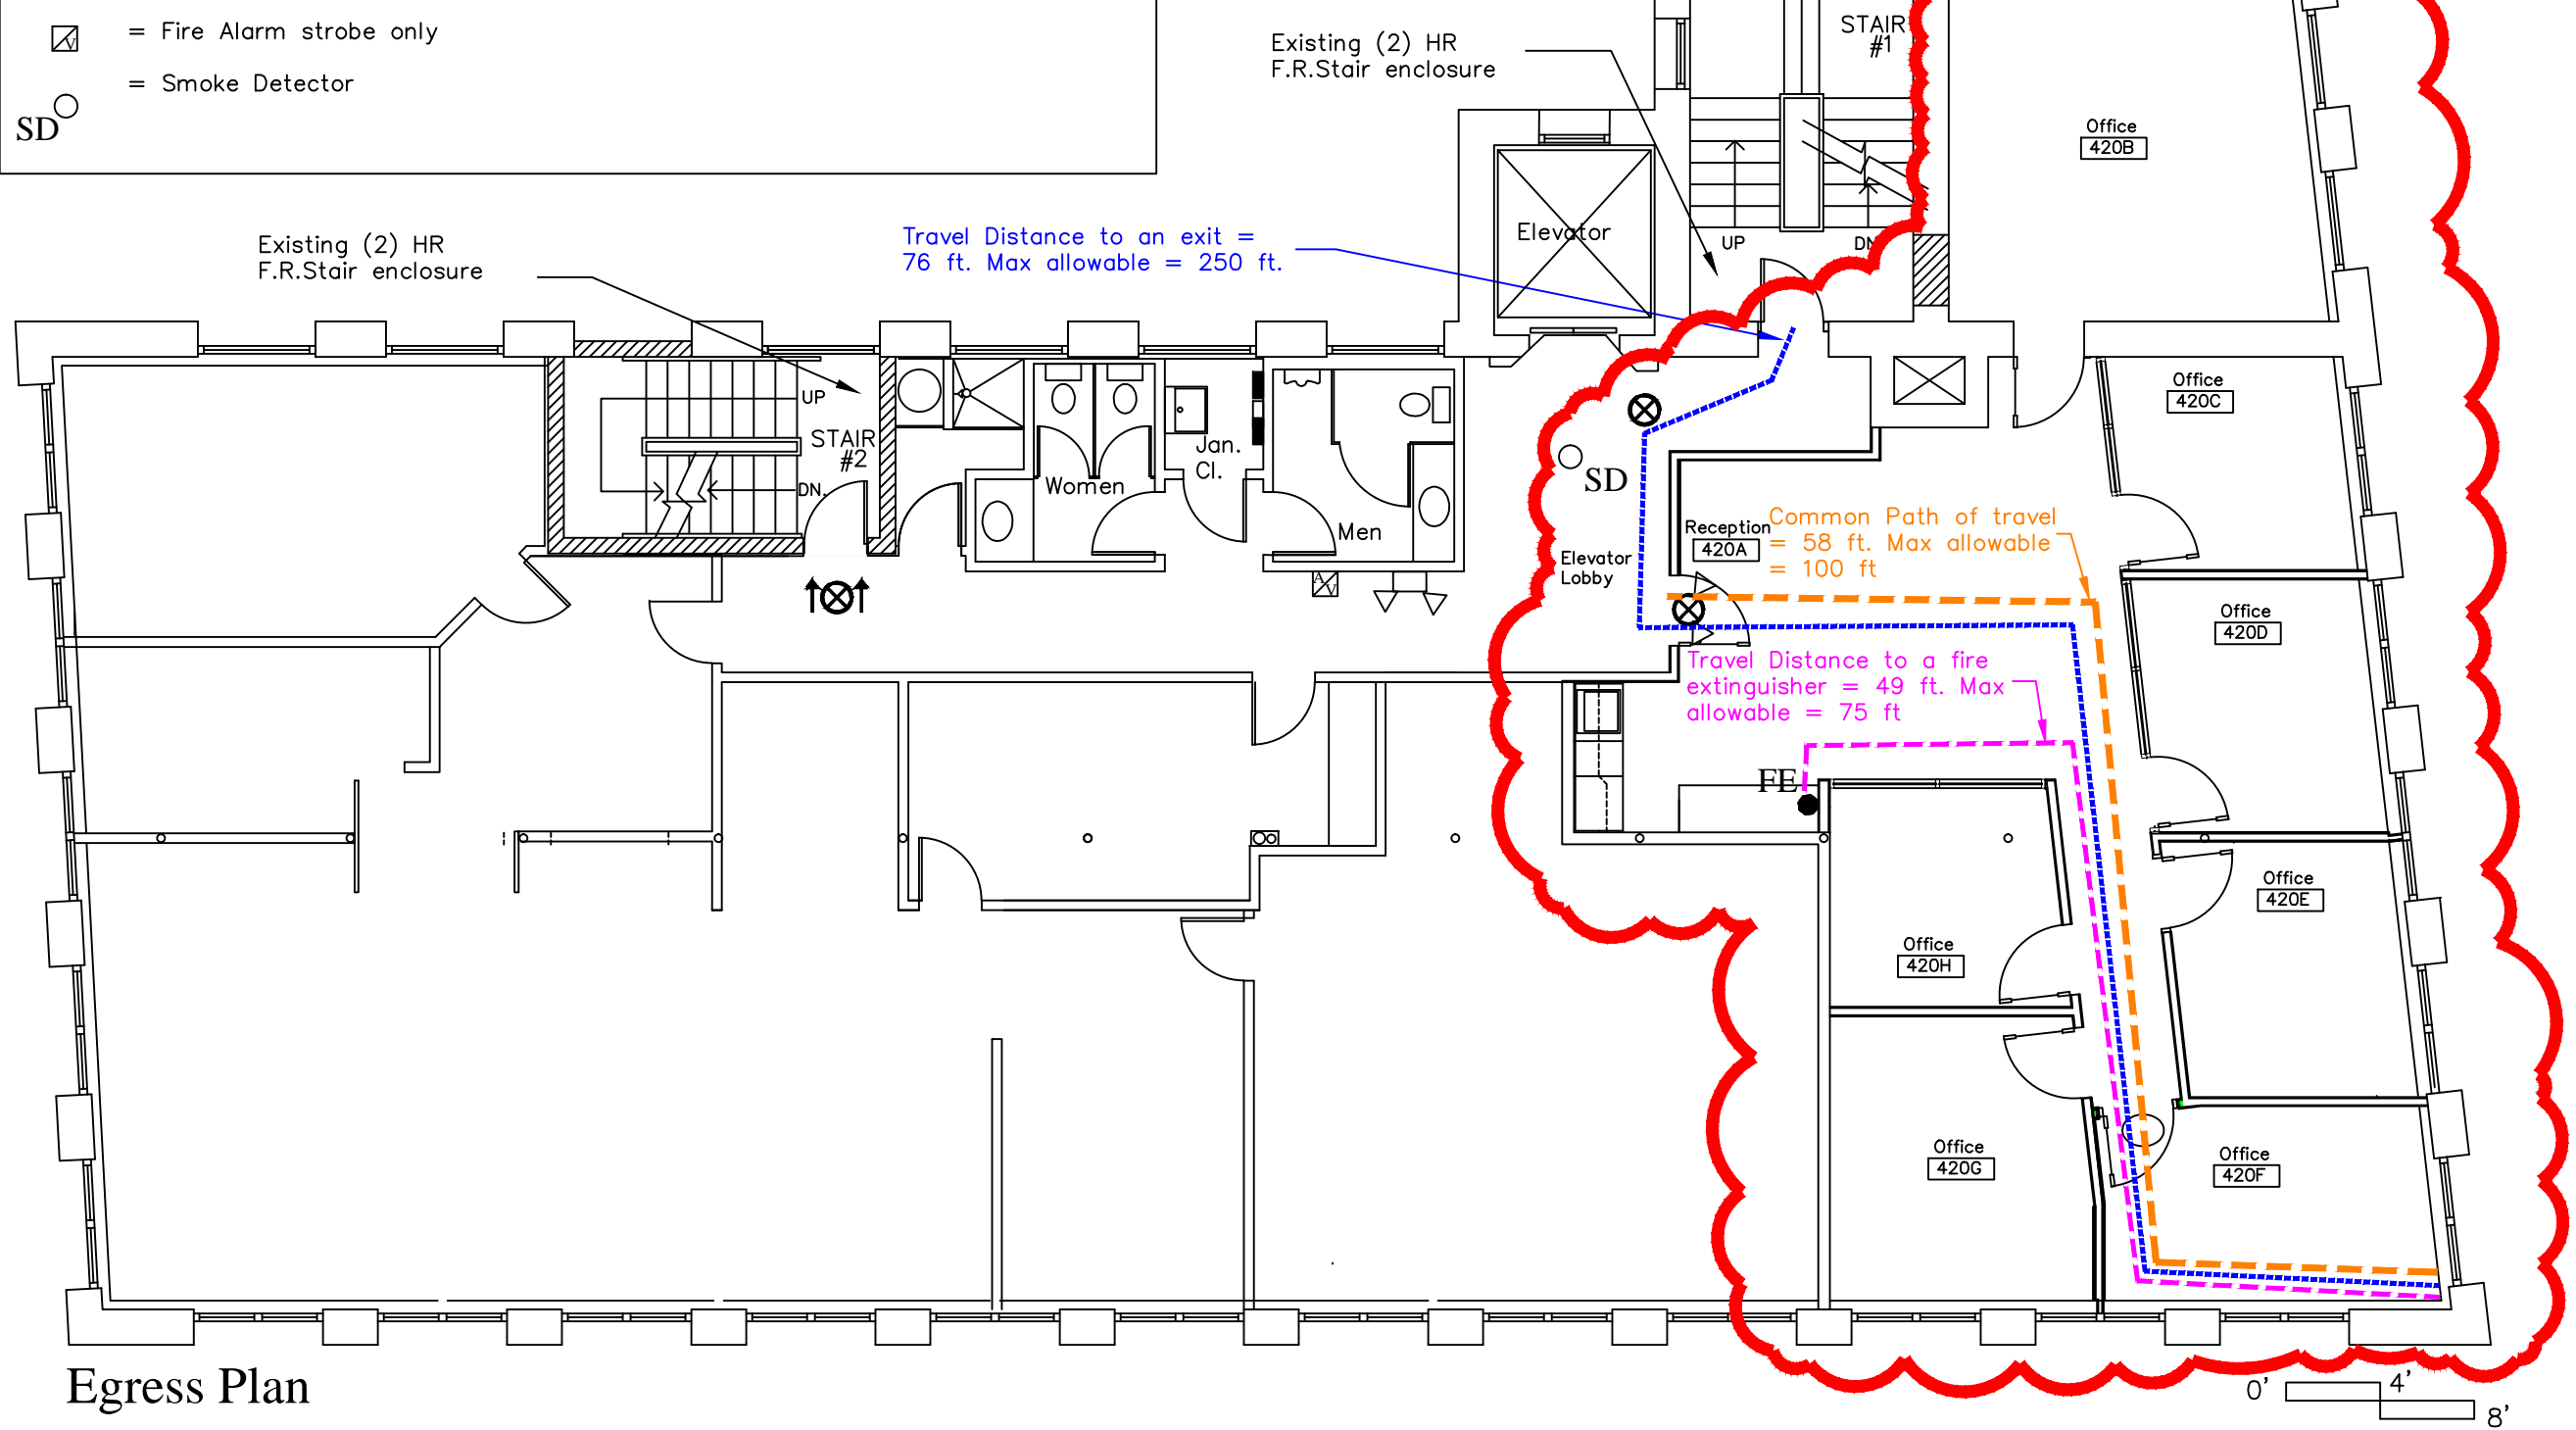


Legend:

- FE = Fire Extinguisher – min. required capacity = 2A –Min. Provided capacity = 2A
- ⊕ = LED Exit light.
- ⊗ = Combination Exit and emergency light.
- ⏏ = Emergency Light
- ⊠ = Fire Alarm Horn Strobe
- ⊞ = Fire Alarm strobe only
- SD = Smoke Detector
- ⋯ = Travel distance to an exit (300 ft max. allowable)..
- ⋯ = Common path of Travel (100 ft max. allowable).
- ⋯ = Travel Distance to a Fire Extinguisher (75 Ft Max. allowable).

- Fire and egress data: (Existing Building):**
- Applicant: Milk Street Associates, LLC.
PO Box 7525
Portland, Maine 04112
(207) 772-6404
 - Occupancy: Existing Business.
 - Area/Use/Occupancy ratio:
 - Suite 420 = 1649 sf : Business: "B" (1 occ/100 sf)=17 Occupants
 - Core and Shell permit previously issued.
 - Sprinklers: Existing bldg has full coverage, wet sprinkler monitored system to NFPA.
 - Refer to floor plan for additional information.

Area to be renovated under this permit application



**Egress Plan - 4th Floor
5 Milk Street - Portland, ME**

Revisions:

EG-1

Sept. 15, 2017

