

DESIGNED BY:
 LARRY WICHROSKI, P.E.
 DRAWN BY:
 LAW
 JOB NO.:
 04913
 DATE:
 12-20-2013

REVISED:
 02-28-2014
 SHEET:
 S1


STRUCTURAL NOTES:

CODE: Comply with the 2009 International Building Code (IBC).
DESIGN LOADS:
 Dead Loads: Roof = 20.0 psf, Floors = 16.0 psf.
 Live Loads: Roof = 45.0 psf (Plus Drift), Office Space = 50.0 psf, Common Areas = 100.0 psf.
Wind:
 Wind Speed = 100 mph, Exposure "C", $I_w = 1.0$
 Uplift Loads: Roof framing is subject to an uplift load.
Overall Roof: 18 PSF
12" Strip Around Perimeter: 22 PSF
12" Squares At Building Corners: 24 PSF


STEEL:
 1. Rolled sections and plates: ASTM A-36, $F_y = 36$ ksi.
 2. Wide Flange Shapes - ASTM A572, $F_y = 50$ ksi.
 3. Steel Lally Columns: ASTM A513, $F_y = 32$ ksi. 16 gage steel filled w/ 3,000 psi concrete.
 4. Bolt and plate anchors: ASTM A307.
 5. Submit shop drawings. Fabricate after Engineers review.

WOOD:
 1. General:
 a. Each piece of lumber shall be "S-DRY" and bear the grade stamp of a grading rules agency approved by the American Lumber Standards Committee.
 b. Nail up studs, joists and under beams.
 c. Do not notch or drill joists, beams or floor bearing studs without approval.
 2. Connections:
 a. Nail roof plywood with 8d common at 6" o.c. at all edges and boundary members and 10" o.c. at intermediate supports.
 b. Glue floor plywood to all framing members and nail with 8d common at 6" o.c. at all plywood edges and boundary members and 10" o.c. at intermediate supports.
 c. Common nails at 6" o.c. at all edges and boundary members and 12" o.c. at intermediate supports.
 3. Structural Sawn Lumber:
 a. 2 x 6 thru 2 x 14 joists: Spruce Pine Fir No. 2 with Fb (repetitive) = 1200 p.s.i.
 b. Studs: Spruce Pine Fir No. 2 with Fb (repetitive) = 1200 p.s.i.
 c. Micro-Lam Beams (LVL): Fb = 5680 psi, Fv = 285 psi, E = 2,000 ksi
 4. Roof Sheathing: C-D INT-APA (PSI-04) with exterior glue, 5/8" with Identification Index be continuous over a minimum of two spans with a minimum width of 1'-0" unless blocking is provided at all joints.
 5. Sub-flooring: C-D INT-APA (PSI-04) with exterior glue, 3/4" with Identification Index, 48/24, lay up with face grain perpendicular to supports. Stagger joints. Each plywood piece to be laid up with face grain perpendicular to supports. Stagger joints. Each plywood piece to be provided at all joints.
 6. Wall Sheathing: C-D INT-APA (PSI-74) with exterior glue, 1/2" with Identification Index 24/0. All panel edges backed with 2" nominal or wider framing.


SUPPLEMENTARY NOTES:
 1. Verify all conditions with architectural drawings prior to starting work. Notify the Engineer of any discrepancies or inconsistencies.
 2. Provide all necessary temporary bracing, shoring, guying or other means to avoid excessive stresses and to hold structural elements in place during construction.

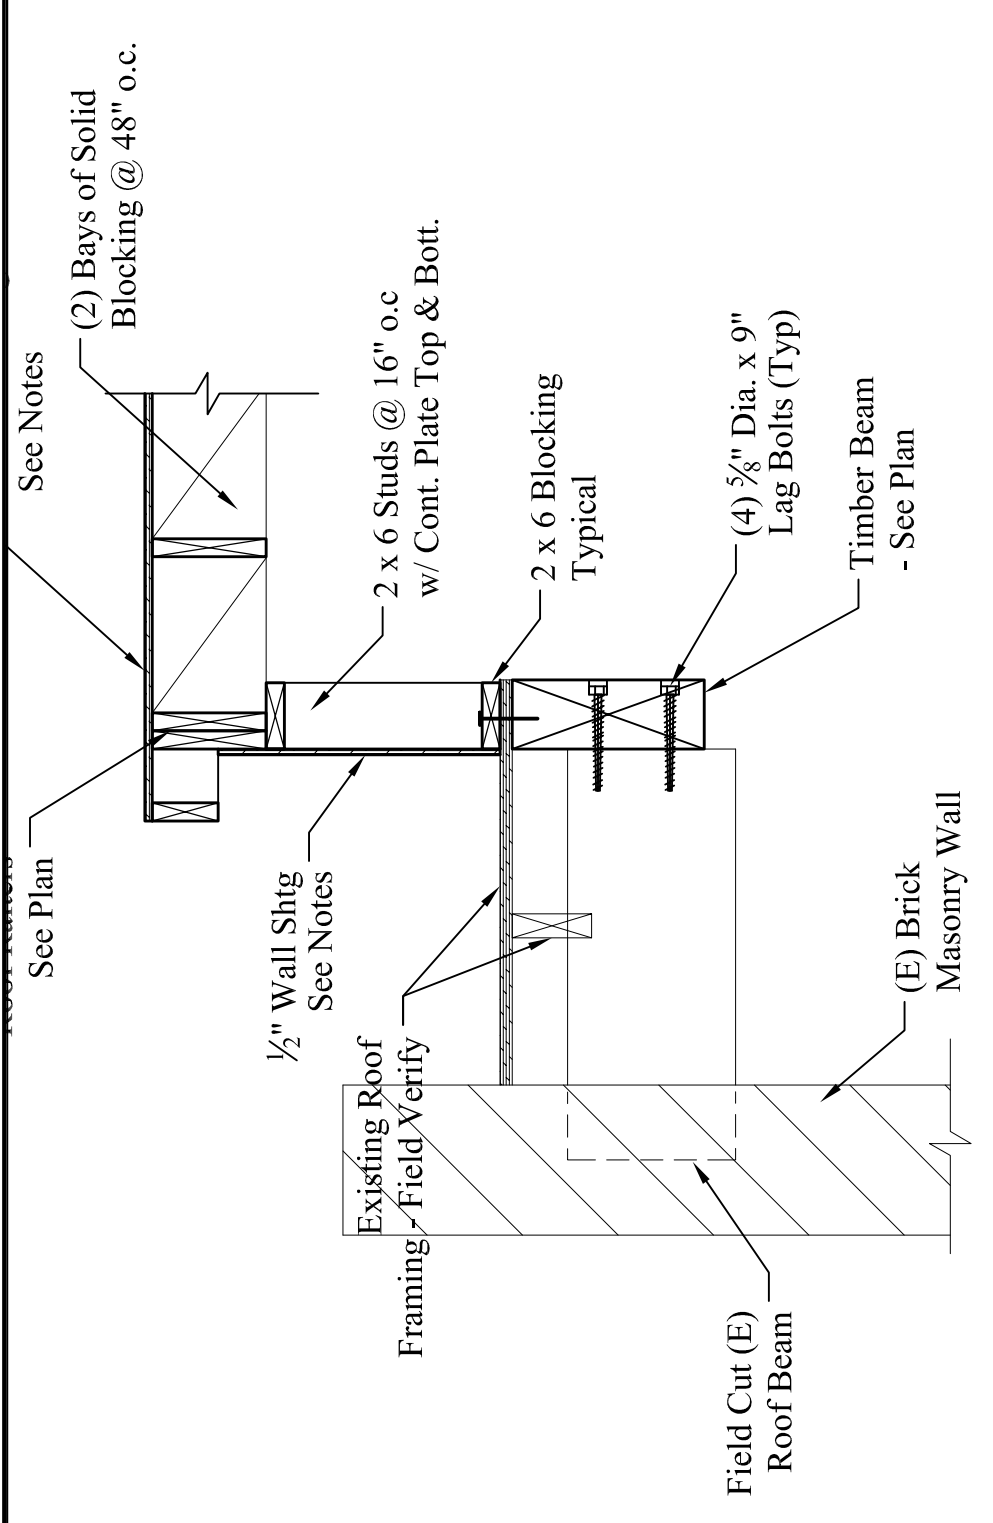


1 WINDOW HDR @ EXTERIOR WALL
 Scale: 3/4" = 1'-0"

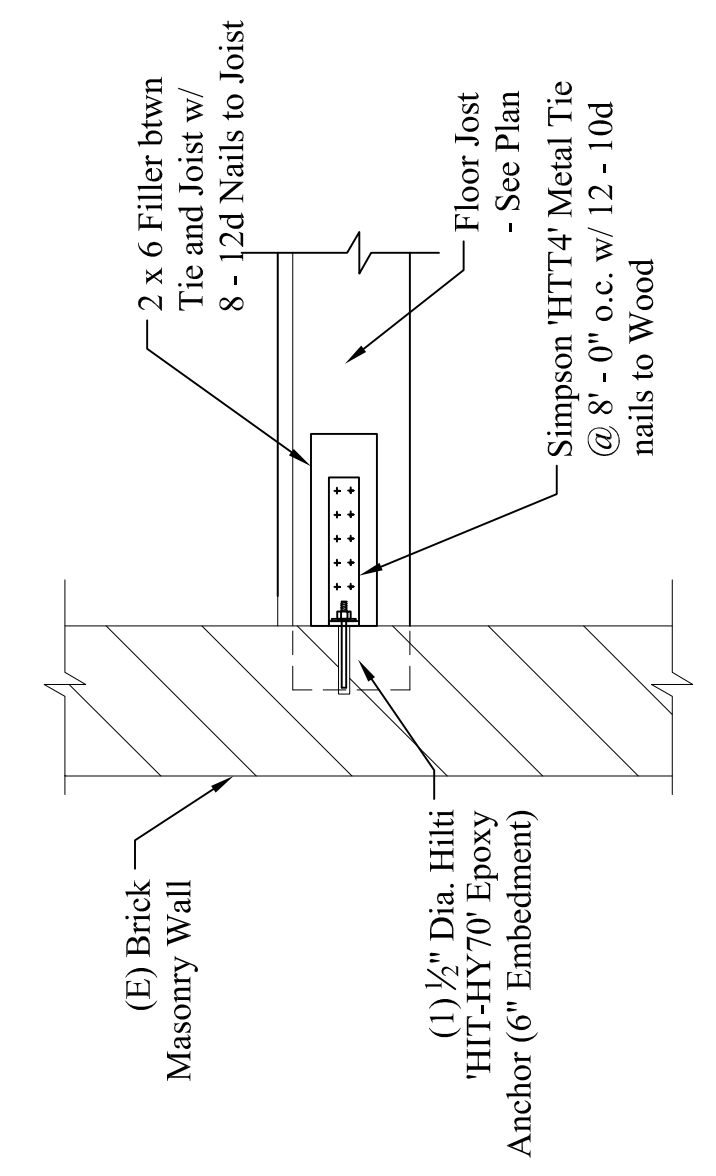


2 DORMER SIDE WALL DETAIL
 Scale: 3/4" = 1'-0"

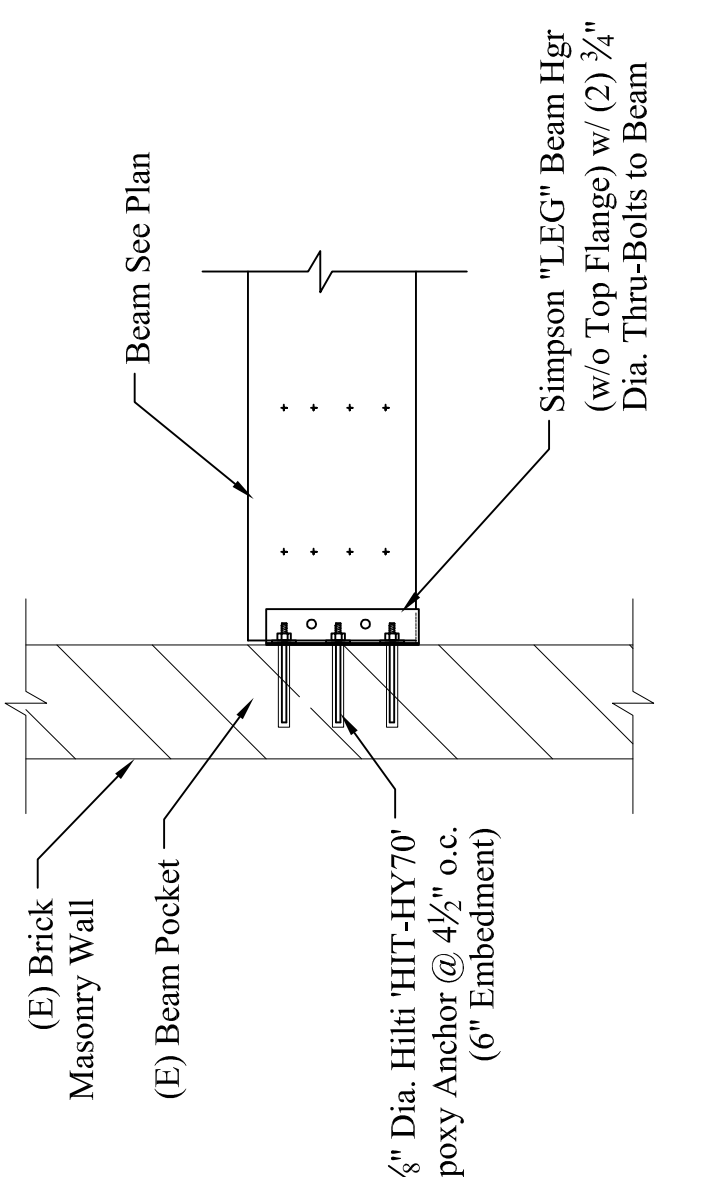


3 SISTERED BEAM SUPPORT @ (E) MAS. WALL
 Scale: 3/4" = 1'-0"

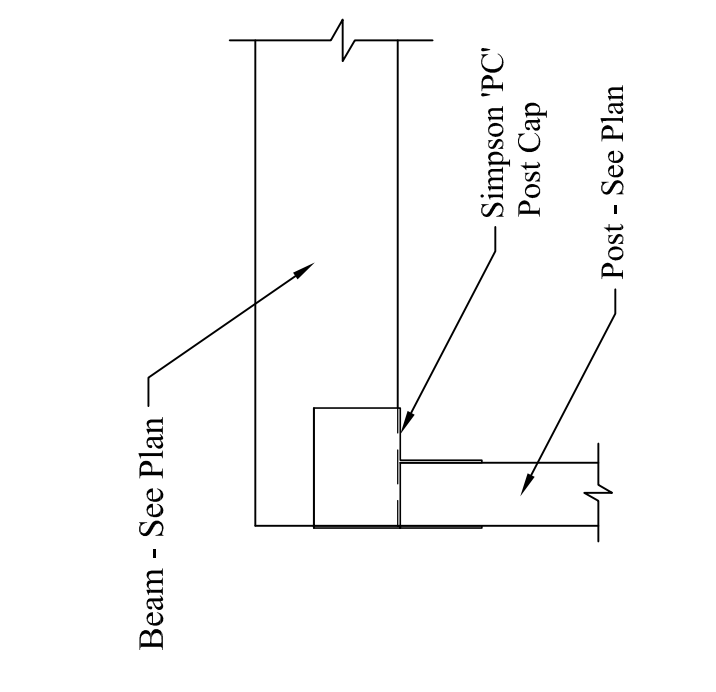


4 BEAM TIES @ EXIST. BRICK WALL
 Scale: 3/4" = 1'-0"

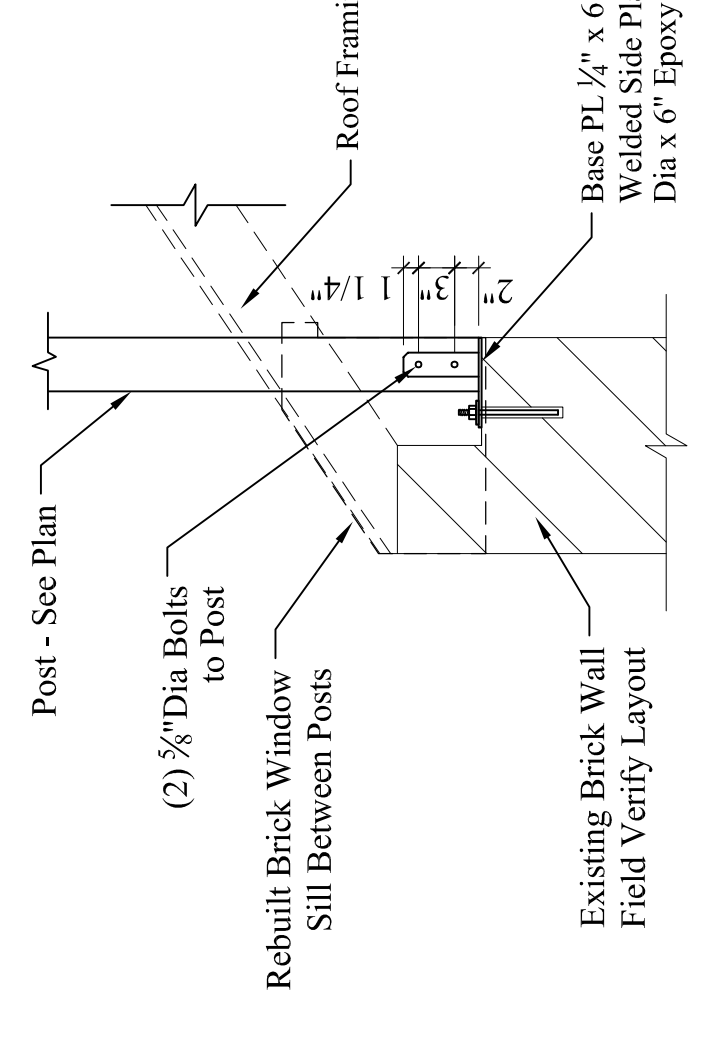


5 BEAM SUPPORT @ (E) MAS. WALL
 Scale: 3/4" = 1'-0"

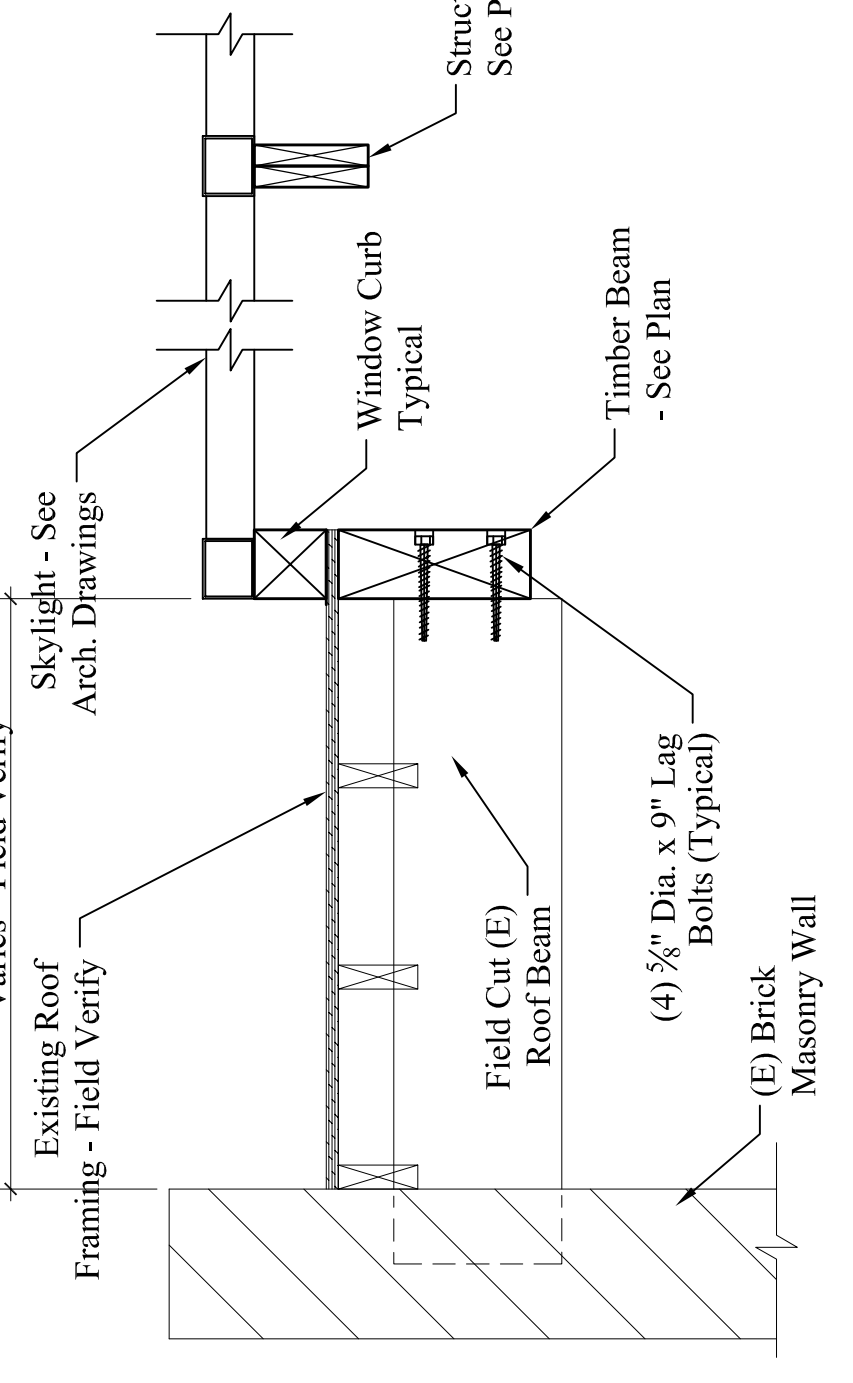


6 BEAM TO POST CONN.
 Scale: 3/4" = 1'-0"

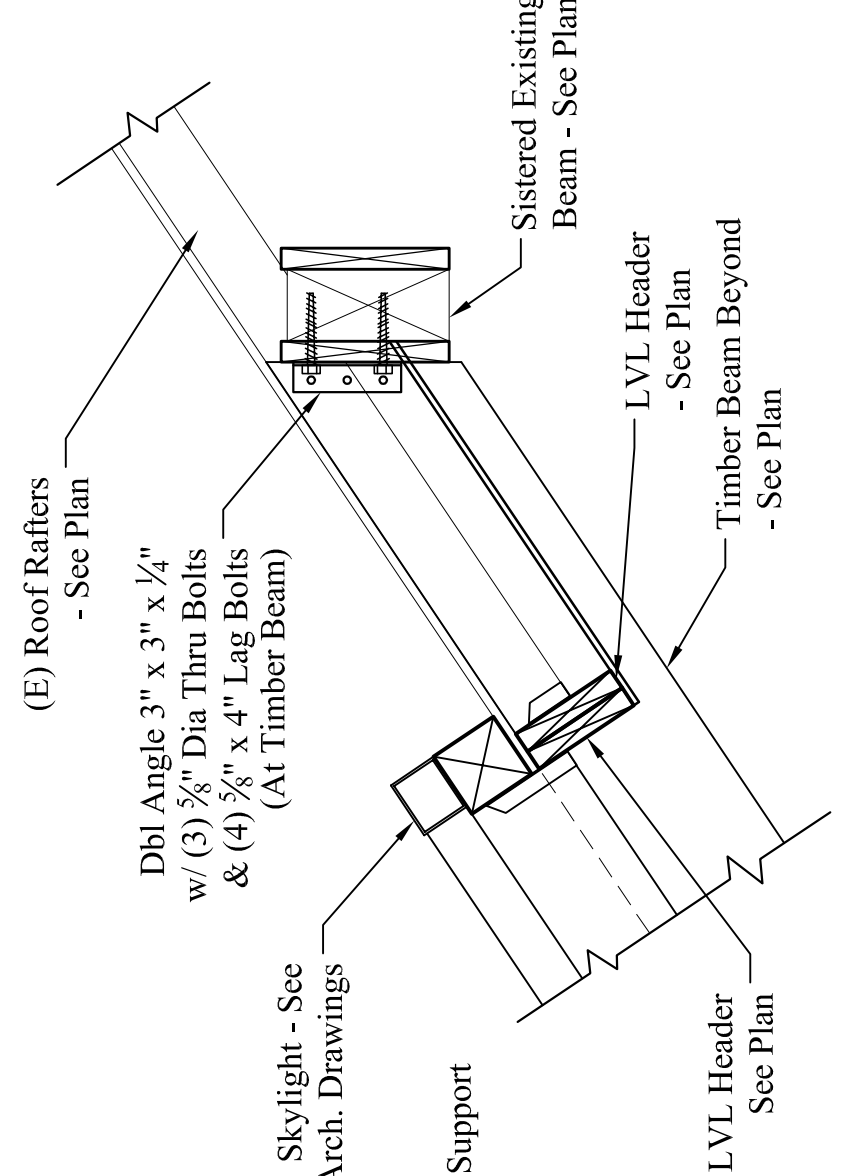


7 POST @ (E) MAS. WALL
 Scale: 3/4" = 1'-0"

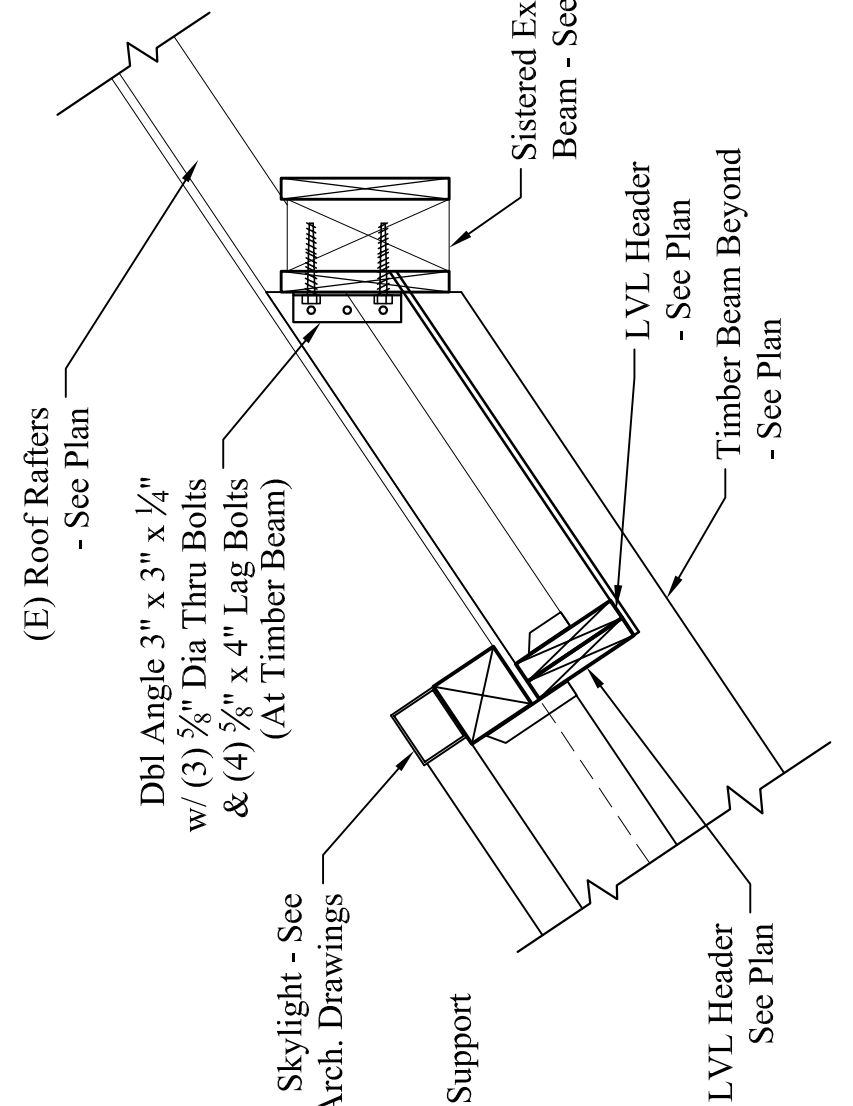


8 SKYLIGHT JAMB
 Scale: 3/4" = 1'-0"

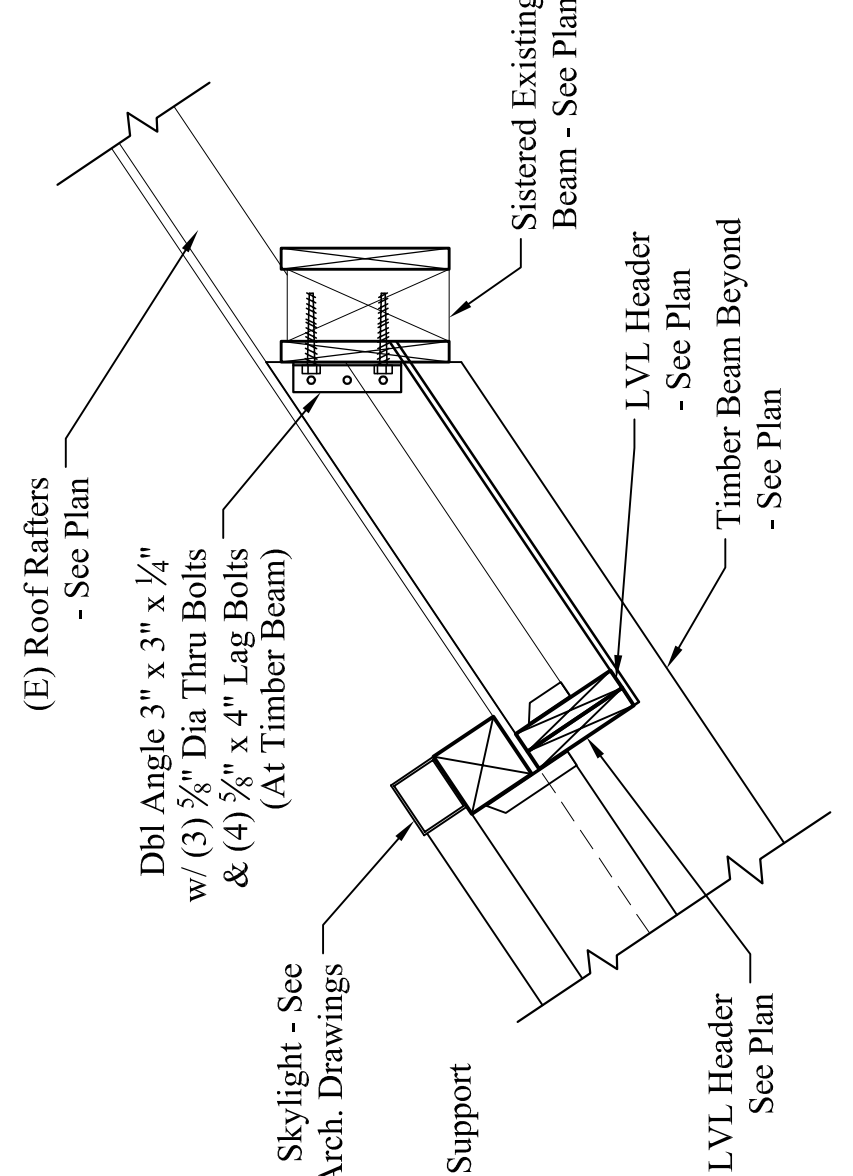


9 SKYLIGHT HEADER
 Scale: 3/4" = 1'-0"

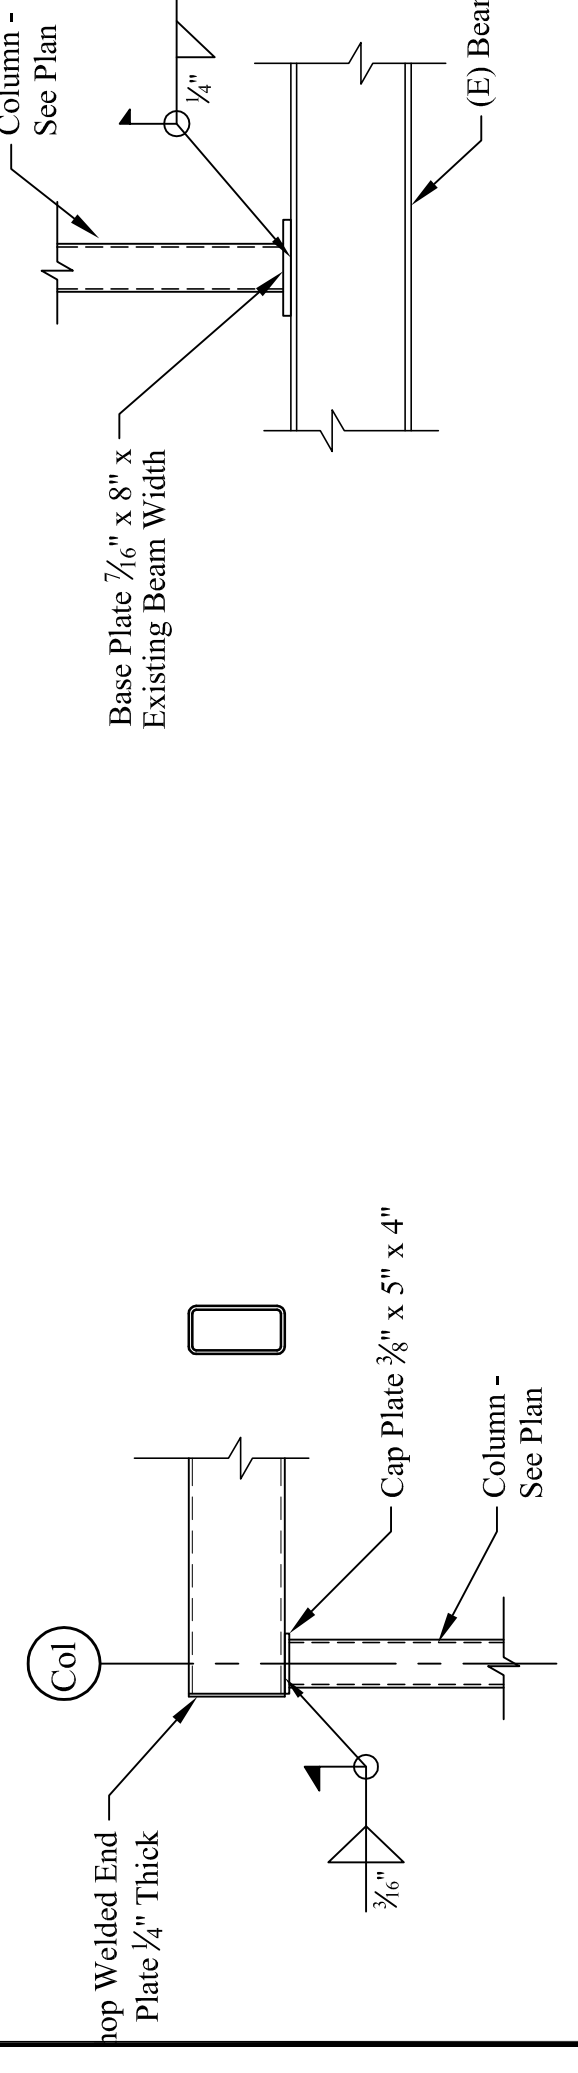

10 COLUMN TO COLUMN CONN.
 Scale: 3/4" = 1'-0"

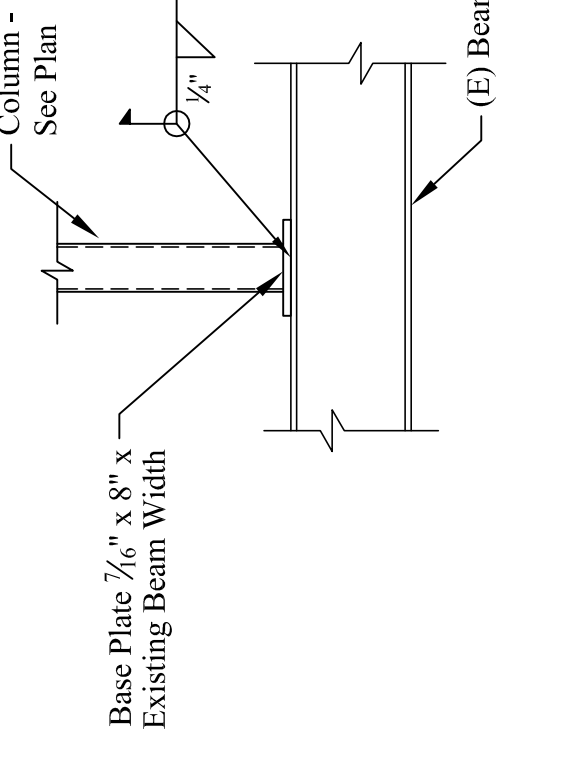

11 COLUMN TO EXIST. BEAM CONN.
 Scale: 3/4" = 1'-0"

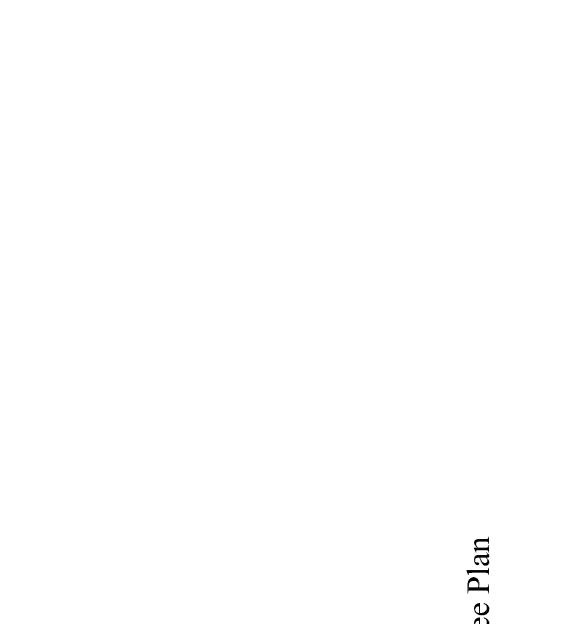

12 BEAM TO COLUMN CONN.
 Scale: 3/4" = 1'-0"