

City of Portland, Maine – Building or Use Permit Application 389 Congress Street, 04101, Tel: (207) 874-8703, FAX: 874-8716

| | | | | | | | |
|--|--|---|--|---------------------------------|--|---|--|
| Location of Construction: 37 Pearl St | | Owner: Schuller International, Inc. | | Phone: | | Permit No: 980077 | |
| Owner Address: | | Lessee/Buyer's Name: Renover Insurance | | Phone: | | Business Name: | |
| Contractor Name: Alliance Construction | | Address: 160 Pleasant Hill Rd Scarborough, ME 04074 855-0855 | | Phone: | | PERMIT ISSUED Permit Issued: FEB - 5 1998 CITY OF PORTLAND | |
| Past Use: Office | | Proposed Use: Same | | COST OF WORK: \$ 175,000.00 | | PERMIT FEE: \$ 896.00 | |
| Proposed Project Description: Make Interior Renovations 2nd & 3rd floors | | FIRE DEPT. <input type="checkbox"/> Approved <input type="checkbox"/> Denied | | INSPECTION: Use Group: Type: | | Zoning: CBL: 02B-E-016 | |
| | | Signature: [Signature] | | Signature: [Signature] | | Zoning Approval: Special Zone or Reviews: <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan maj <input type="checkbox"/> minor <input type="checkbox"/> mm <input type="checkbox"/> | |
| PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.) | | Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied | | Signature: [Signature] | | Date: [Date] | |
| Permit Taken By: Mary Grezik | | Date Applied For: 30 January 1998 | | | | | |

1. This permit application does not preclude the Applicant(s) from meeting applicable State and Federal rules.
2. Building permits do not include plumbing, septic or electrical work.
3. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work..

PERMIT ISSUED WITH REQUIREMENTS

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit

SIGNATURE OF APPLICANT: [Signature] ADDRESS: DATE: 30 January 1998 PHONE:

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE PHONE:

White-Permit Desk Green-Assessor's Canary-D.P.W. Pink-Public File Ivory Card-Inspector

CEO DISTRICT

2

BUILDING PERMIT REPORT


DATE: 2/2/98 ADDRESS: 27 Pec. 1 St
REASON FOR PERMIT: renovation
BUILDING OWNER: Schulte
CONTRACTOR: Allan Construction
PERMIT APPLICANT: Jim Mullin APPROVAL: X/1*8*10*17*18*19*20*26*29 DENIED
USE GROUP B BOCA 1996 CONSTRUCTION TYPE 1B

CONDITION(S) OF APPROVAL

- X 1. This permit does not excuse the applicant from meeting applicable State and Federal rules and laws.
2. Before concrete for foundation is placed, approvals from the Development Review Coordinator and Inspection Services must be obtained. (A 24 hour notice is required prior to inspection)
3. Precaution must be taken to protect concrete from freezing.
4. It is strongly recommended that a registered land surveyor check all foundation forms before concrete is placed. This is done to verify that the proper setbacks are maintained.
5. Private garages located beneath habitable rooms in occupancies in Use Group R-1, R-2, R-3 or I-1 shall be separated from adjacent interior spaces by fire partitions and floor/ceiling assembly which are constructed with not less than 1-hour fire resisting rating. Private garages attached side-by-side to rooms in the above occupancies shall be completely separated from the interior spaces and the attic area by means of ½ inch gypsum board or the equivalent applied to the garage means of ½ inch gypsum board or the equivalent applied to the garage side. (Chapter 4 Section 407.0 of the BOCA/1996)
6. All chimneys and vents shall be installed and maintained as per Chapter 12 of the City's Mechanical Code. (The BOCA National Mechanical Code/1993).
7. Sound transmission control in residential building shall be done in accordance with Chapter 12 section 1214.0 of the city's building code.
- X 8. Guardrails & Handrails: A guardrail system is a system of building components located near the open sides of elevated walking surfaces for the purpose of minimizing the possibility of an accidental fall from the walking surface to the lower level. Minimum height all Use Groups 42", except Use Group R which is 36". In occupancies in Use Group A, B, H-4, I-1, I-2 M and R and public garages and open parking structures, open guards shall have balusters or be of solid material such that a sphere with a diameter of 4" cannot pass through any opening. Guards shall not have an ornamental pattern that would provide a ladder effect. (Handrails shall be a minimum of 34" but not more than 38". Use Group R-3 shall not be less than 30", but not more than 38".)
9. Headroom in habitable space is a minimum of 7'6".
- X 10. Stair construction in Use Group R-3 & R-4 is a minimum of 10" tread and 7 3/4" maximum rise. All other Use group minimum 11" tread, 7" maximum rise.
11. The minimum headroom in all parts of a stairway shall not be less than 80 inches. (6' 8")
12. Every sleeping room below the fourth story in buildings of use Groups R and I-1 shall have at least one operable window or exterior door approved for emergency egress or rescue. The units must be operable from the inside without the use of special knowledge or separate tools. Where windows are provided as means of egress or rescue they shall have a sill height not more than 44 inches (1118mm) above the floor. All egress or rescue windows from sleeping rooms shall have a minimum net clear opening height dimension of 24 inches (610mm). The minimum net clear opening width dimension shall be 20 inches (508mm), and a minimum net clear opening of 5.7 sq. ft.
13. Each apartment shall have access to two (2) separate, remote and approved means of egress. A single exit is acceptable when it exits directly from the apartment to the building exterior with no communications to other apartment units.
14. All vertical openings shall be enclosed with construction having a fire rating of at least one (1) hour, including fire doors with self closer's.
15. The boiler shall be protected by enclosing with (1) hour fire-rated construction including fire doors and ceiling, or by providing automatic extinguishment.
16. All single and multiple station smoke detectors shall be of an approved type and shall be installed in accordance with the provisions of the City's Building Code Chapter 9, Section 19, 920.3.2 (BOCA National Building Code/1996), and NFPA 101 Chapter 18 & 19. (Smoke detectors shall be installed and maintained at the following locations):
 - In the immediate vicinity of bedrooms
 - In all bedrooms

In each story within a dwelling unit, including basements
In addition to the required AC primary power source, required smoke detectors in occupancies in Use Groups R-2, R-3 and I-1 shall receive power from a battery when the AC primary power source is interrupted. (Interconnection is required)

- 17. A portable fire extinguisher shall be located as per NFPA #10. They shall bear the label of an approved agency and be of an approved type.
- 18. The Fire Alarm System shall be maintained to NFPA #72 Standard.
- 19. The Sprinkler System shall maintained to NFPA #13 Standard.
- 20. All exit signs, lights, and means of egress lighting shall be done in accordance with Chapter 10 Section & Subsections 1023. & 1024. Of the City's building code. (The BOCA National Building Code/1996)
- 21. **No construction or demolition work shall begin until you have obtained permits for dumpsters or containers. A work Stop Order shall be issued if this requirement is not met.**
- 22. Section 25-135 of the Municipal Code for the City of Portland states, "No person or utility shall be granted a permit to excavate or open any street or sidewalk from the time of November 15 of each year to April 15 of the following year".
- 23. The builder of a facility to which Section 4594-C of the Maine State Human Rights Act Title 5 MRSA refers, shall obtain a certification from a design professional that the plans commencing construction of the facility, the builder shall submit the certification to the Division of Inspection Services.
- 24. This permit does not excuse the applicant from obtaining any license which may be needed from the City Clerk's office.
- 25. Ventilation shall meet the requirements of Chapter 12 Sections 1210. of the City's Building Code.
- X 26. All electrical, plumbing and HVAC permits must be obtained by a Master Licensed holders of their trade.
- 27. All requirements must be met before a final Certificate of Occupancy is issued.
- 28. All building elements shall meet the fastening schedule as per Table 2305.2 of the City's Building Code. (The BOCA National Building Code/1996).
- X 29. Ventilation of spaces within a building shall be done in accordance with the City's Mechanical Code (The BOCA National Mechanical Code/1993).
- 30. _____
- 31. _____
- 32. _____
- 33. _____
- 34. _____


P. Samuel Hoffes, Code Enforcement
cc: Lt. McDougall, PFD
Marge Schumckal

PORTLAND FIRE DEPARTMENT

Review Date: _____ Contractor: _____


Address: _____ CBL: _____

Please note marked Conditions of Approval

- * The boiler or furnace shall be protected by enclosing with one hour fire rated construction including fire doors and ceiling or by providing automatic extinguishment and smoke protected enclosure. Sprinkler piping serving not more than six sprinklers may be connected to a domestic water supply system having a capacity sufficient to provide a 0.15 gpm per sq ft of floor throughout the entire area. An indicating shut-off valve shall be installed in an accessible location between the sprinkler and the connection to the domestic water supply. Minimum pipe size shall be 3/4" copper or 1" steel. Maximum coverage area of a residential sprinkler in 144 sq ft per sprinkler.
- * All required fire alarm systems shall have the capacity of zone disconnect via switches or key pad program provided the method is approved by the Fire Prevention Bureau.
- * All remote annunciators shall have a visible trouble indicator along with the fire alarm zone indicators.
- * Any master box connected to the municipal fire alarm system shall have a supervised municipal disconnect switch.
- * All master box locations shall be approved by the Fire Dept. Director of Communications.
- * A master box shall be located so that the center of the box is five feet above finished floor.
- * All master box locations are required to have a Knox box.
- * A fire alarm acceptance report shall be submitted to the Portland Fire Department.
- * All underground tank removal(s) and/or installation(s) shall be done in accordance with the Department of Environmental Protection and Regulation (Chapter 691).
- * No cutting of tanks on site. Cutting of tanks to be done at an approved disposal site.
- * The fire dispatcher must be notified at least 48 hrs in advance of removal or transportation of tanks.
- * All above ground L/P tanks shall be located in accordance with NFPA 58 standards.
- * Any tank located near the path of vehicle movement shall be protected.
- * All piping shall be protected from possible mechanical damage and vandalism.
- * A 4" storz fire department connection is required.
- * Any renovation of sprinkler system over 20 heads must have State Fire Marshall approval.
- * A sprinkler performance test shall be submitted to the P.F.D. after completion of work.
- * State Fire Marshall approval is required for this project.

Lt. Gaylen Mc Dougall
Portland Fire Prevention Bureau

980135

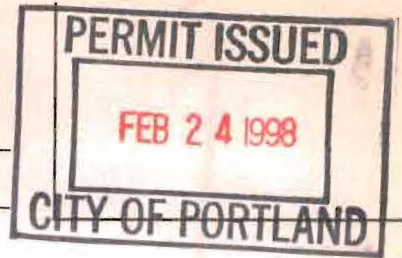

APPLICATION FOR AMENDMENT TO PERMIT

Amendment No. Portland, Maine, 2/11/98



029-E-016

To the INSPECTOR OF BUILDINGS, PORTLAND, MAINE

The undersigned hereby applies for amendment to Permit No. 980077 pertaining to the building or structure comprised in the original application in accordance with the Laws of the State of Maine, the Building Code and Zoning Ordinance of the City of Portland, plans and specifications, if any, submitted herewith, and the following specifications:

Location 27 Pearl Street Within Fire Limits? Dist. No. Owner's name and address Schuller International, Inc. Telephone Lessee's name and address Hanover Insurance Telephone Contractor's name and address Alliance Construction Telephone 885-0855 Architect Plans filed No. of sheets Proposed use of building No. families Last use No. families Increased cost of work \$13,000.00 Additional fee \$85.00

Description of Proposed Work

Addition of int partitions

Handwritten initials

Details of New Work

Is any plumbing involved in this work? Is any electrical work involved in this work? Height average grade to top of plate Height average grade to highest point of roof Size, front depth No. stories solid or filled land? earth or rock? Material of foundation Thickness, top bottom cellar Material of underpinning Height Thickness Kind of roof Rise per foot Roof covering No. of chimneys Material of chimneys of lining Framing lumber - Kind Dressed or full size? Corner posts Sills Girt or ledger board? Size Girders Size Columns under girders Size Max. on centers Studs (outside walls and carrying partitions) 2x4-16" O.C. Bridging in every floor and flat roof span over 8 feet. Joints and rafters: 1st floor, 2nd, 3rd, roof On centers: 1st floor, 2nd, 3rd, roof Maximum span: 1st floor, 2nd, 3rd, roof

Approved: [Handwritten signature]

Signature of Owner [Handwritten signature]

[Handwritten signature]

Approved: [Handwritten signature] Inspector of Buildings

INSPECTION COPY - WHITE APPLICANT'S COPY - YELLOW

FILE COPY - PINK ASSESSOR'S COPY - GOLDEN



CITY OF PORTLAND, MAINE
Department of Building Inspection

Certificate of Occupancy

LOCATION 27 Pearl St. (029-8016)

Date of Issue 9/30/98

Issued to Schuller Int.

This is to certify that the building, premises, or part thereof, at the above location, built — altered — changed as to use under Building Permit No. 980077, has had final inspection, has been found to conform substantially to requirements of Zoning Ordinance and Building Code of the City, and is hereby approved for occupancy or use, limited or otherwise, as indicated below.

PORTION OF BUILDING OR PREMISES

APPROVED OCCUPANCY

2nd & 3rd Floors

Office

Limiting Conditions:

Per Sam Hoffses

This certificate supersedes
certificate issued

Approved:

(Date)

Inspector

Inspector of Buildings

Notice: This certificate identifies lawful use of building or premises, and ought to be transferred from owner to owner when property changes hands. Copy will be furnished to owner or lessee for one dollar.