


scorrell - Fri, 14 Jul 2006 - 1:30pm

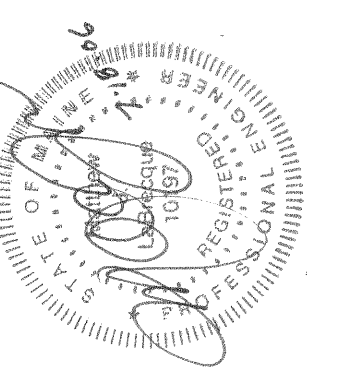


ISSUE:  
05/26/2006 ISSUED FOR PRICING  
07/11/2006 ISSUED FOR PERMIT

**CUSTOM HOUSE SQUARE**  
300 FORE STREET  
PORTLAND, MAINE  
FOURTH FLOOR FRAMING

PROJECT ARCHITECT:  
MW  
DRAWN BY:  
BR, AC, SO  
PROJECT #:  
300506

**S2.4**

05062.4.dwg

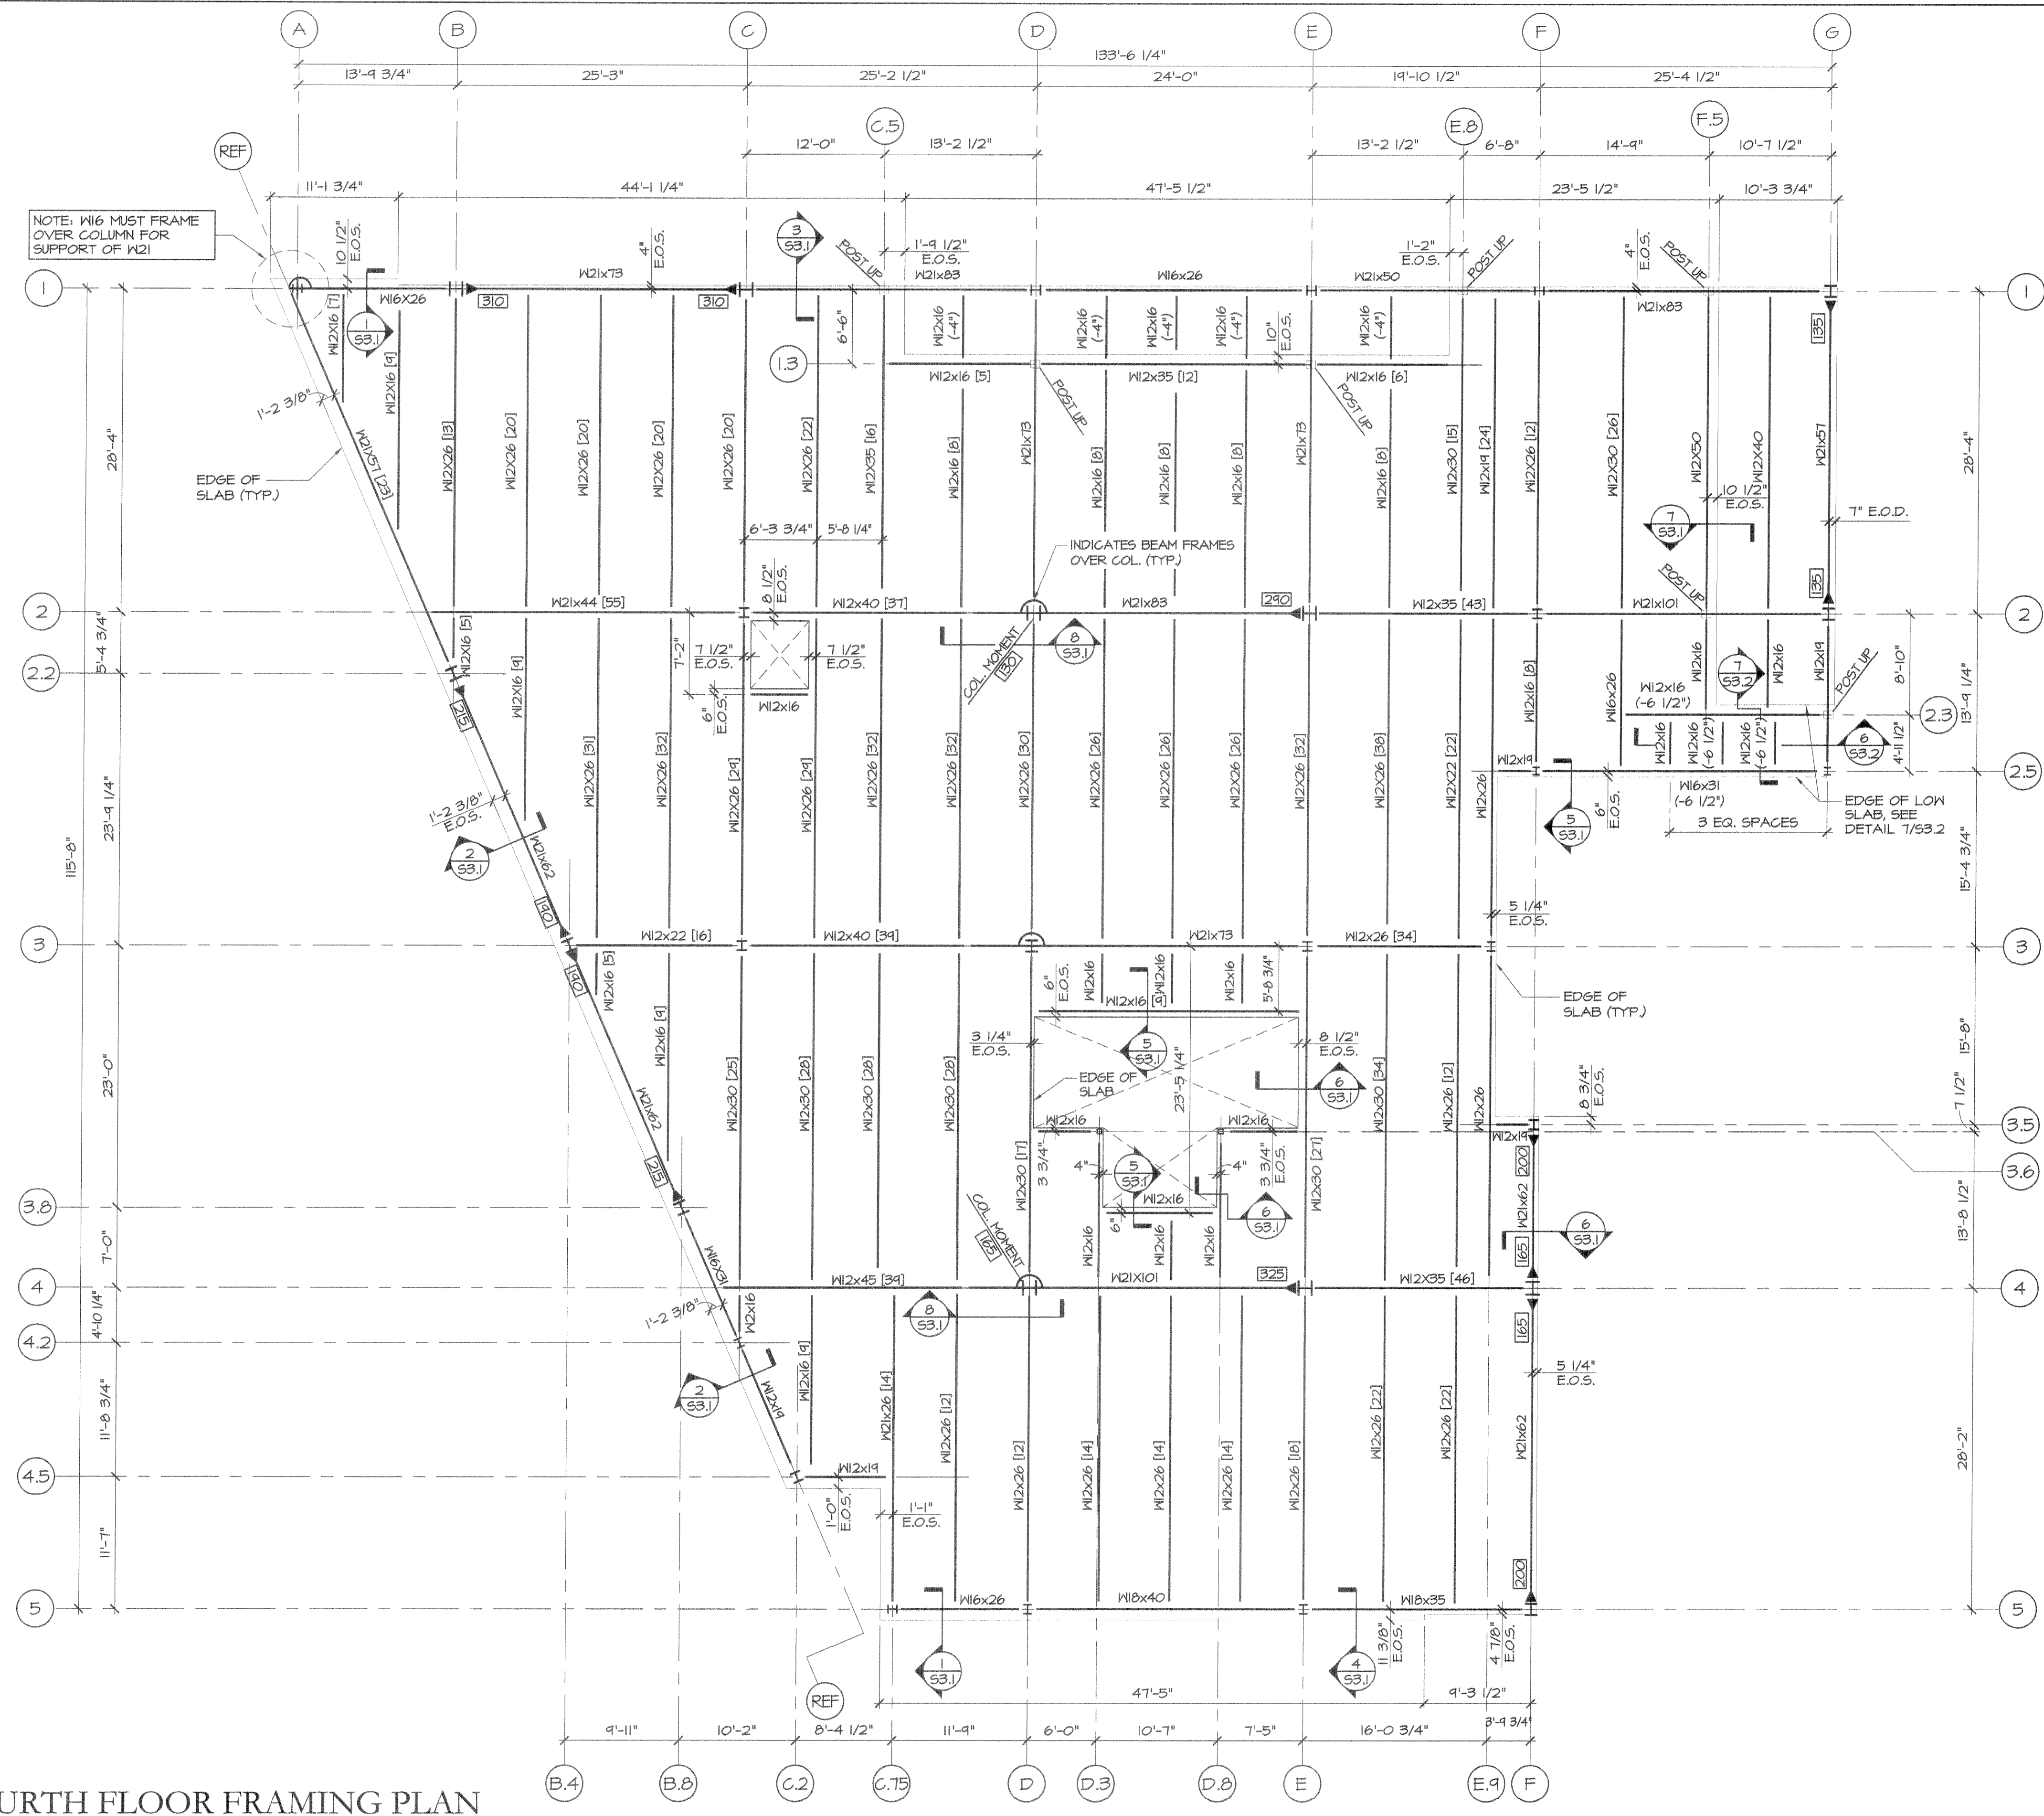


**FOURTH FLOOR FRAMING PLAN**

SCALE: 1/8" = 1'-0"

**NOTES:**

- FLOOR IS 4" (3000 PSF) NORMAL WEIGHT CONCRETE SLAB W/6x6 W1.4xW1.4 WNR ON 1 1/2" LOK-FLOOR 20 GAUGE GALVANIZED COMPOSITE STEEL DECK. DECK MUST EXTEND OVER A MINIMUM OF (3) SPANS (TYP).
- TOP OF SLAB = 56'-10 1/2"
- TOP OF STEEL = 56'-6 1/2" (UNLESS NOTED AS +/- FROM THIS ELEVATION ON PLAN)
- [X] INDICATES NUMBER OF 3/4" x 3" SHEAR STUDS (Fu = 60KSI) WELDED TO BEAM THROUGH COMPOSITE DECK
- DESIGN REACTIONS FOR COMPOSITE BEAMS HAVE BEEN INDICATED AT VARIOUS LOCATIONS ON PLAN. THE STRUCTURAL STEEL FABRICATOR MUST DESIGN THE BEAM FOR THE GREATER OF THE FOLLOWING:
  - REACTION INDICATED ON PLAN
  - MAXIMUM REACTION BASED ON UNIFORM LOAD CAPACITY OF BEAM AT GIVEN SPAN PER AISC ASD 4TH EDITION

- SEE COLUMN SCHEDULE ON SHEET S4.1 FOR STRUCTURAL STEEL COLUMN DETAILING.
- \* \* \* DESIGNATES MOMENT CONNECTION. STRUCTURAL STEEL FABRICATOR MUST PROVIDE A CERTIFIED CONNECTION DESIGN BY AN ENGINEER LICENSED IN THE STATE OF MAINE TO MEET THE DESIGN MOMENT CONNECTION VALUES NOTED AS [XXX] FT-KIPS ON PLAN. SAID MOMENT CONNECTION DESIGN MUST NOT EXCEED 110% OF THE REQUIRED DESIGN VALUE.
- SEE SHEET S0.1 FOR STRUCTURAL GENERAL NOTES.

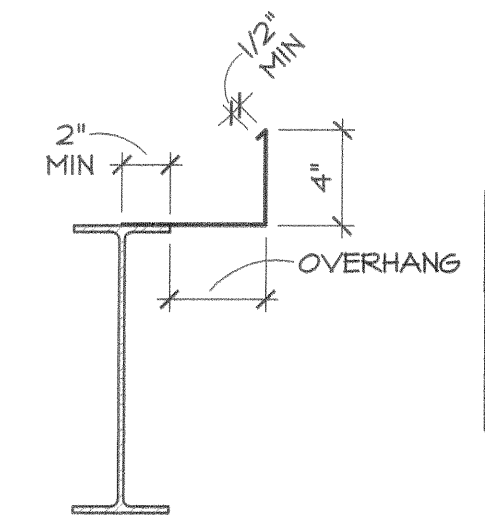

OVERHANG	FOUR STOP GAUGE
UP TO 5"	18
5" TO 6"	16
6" TO 7"	14
OVER 7"	STRUC. STEEL