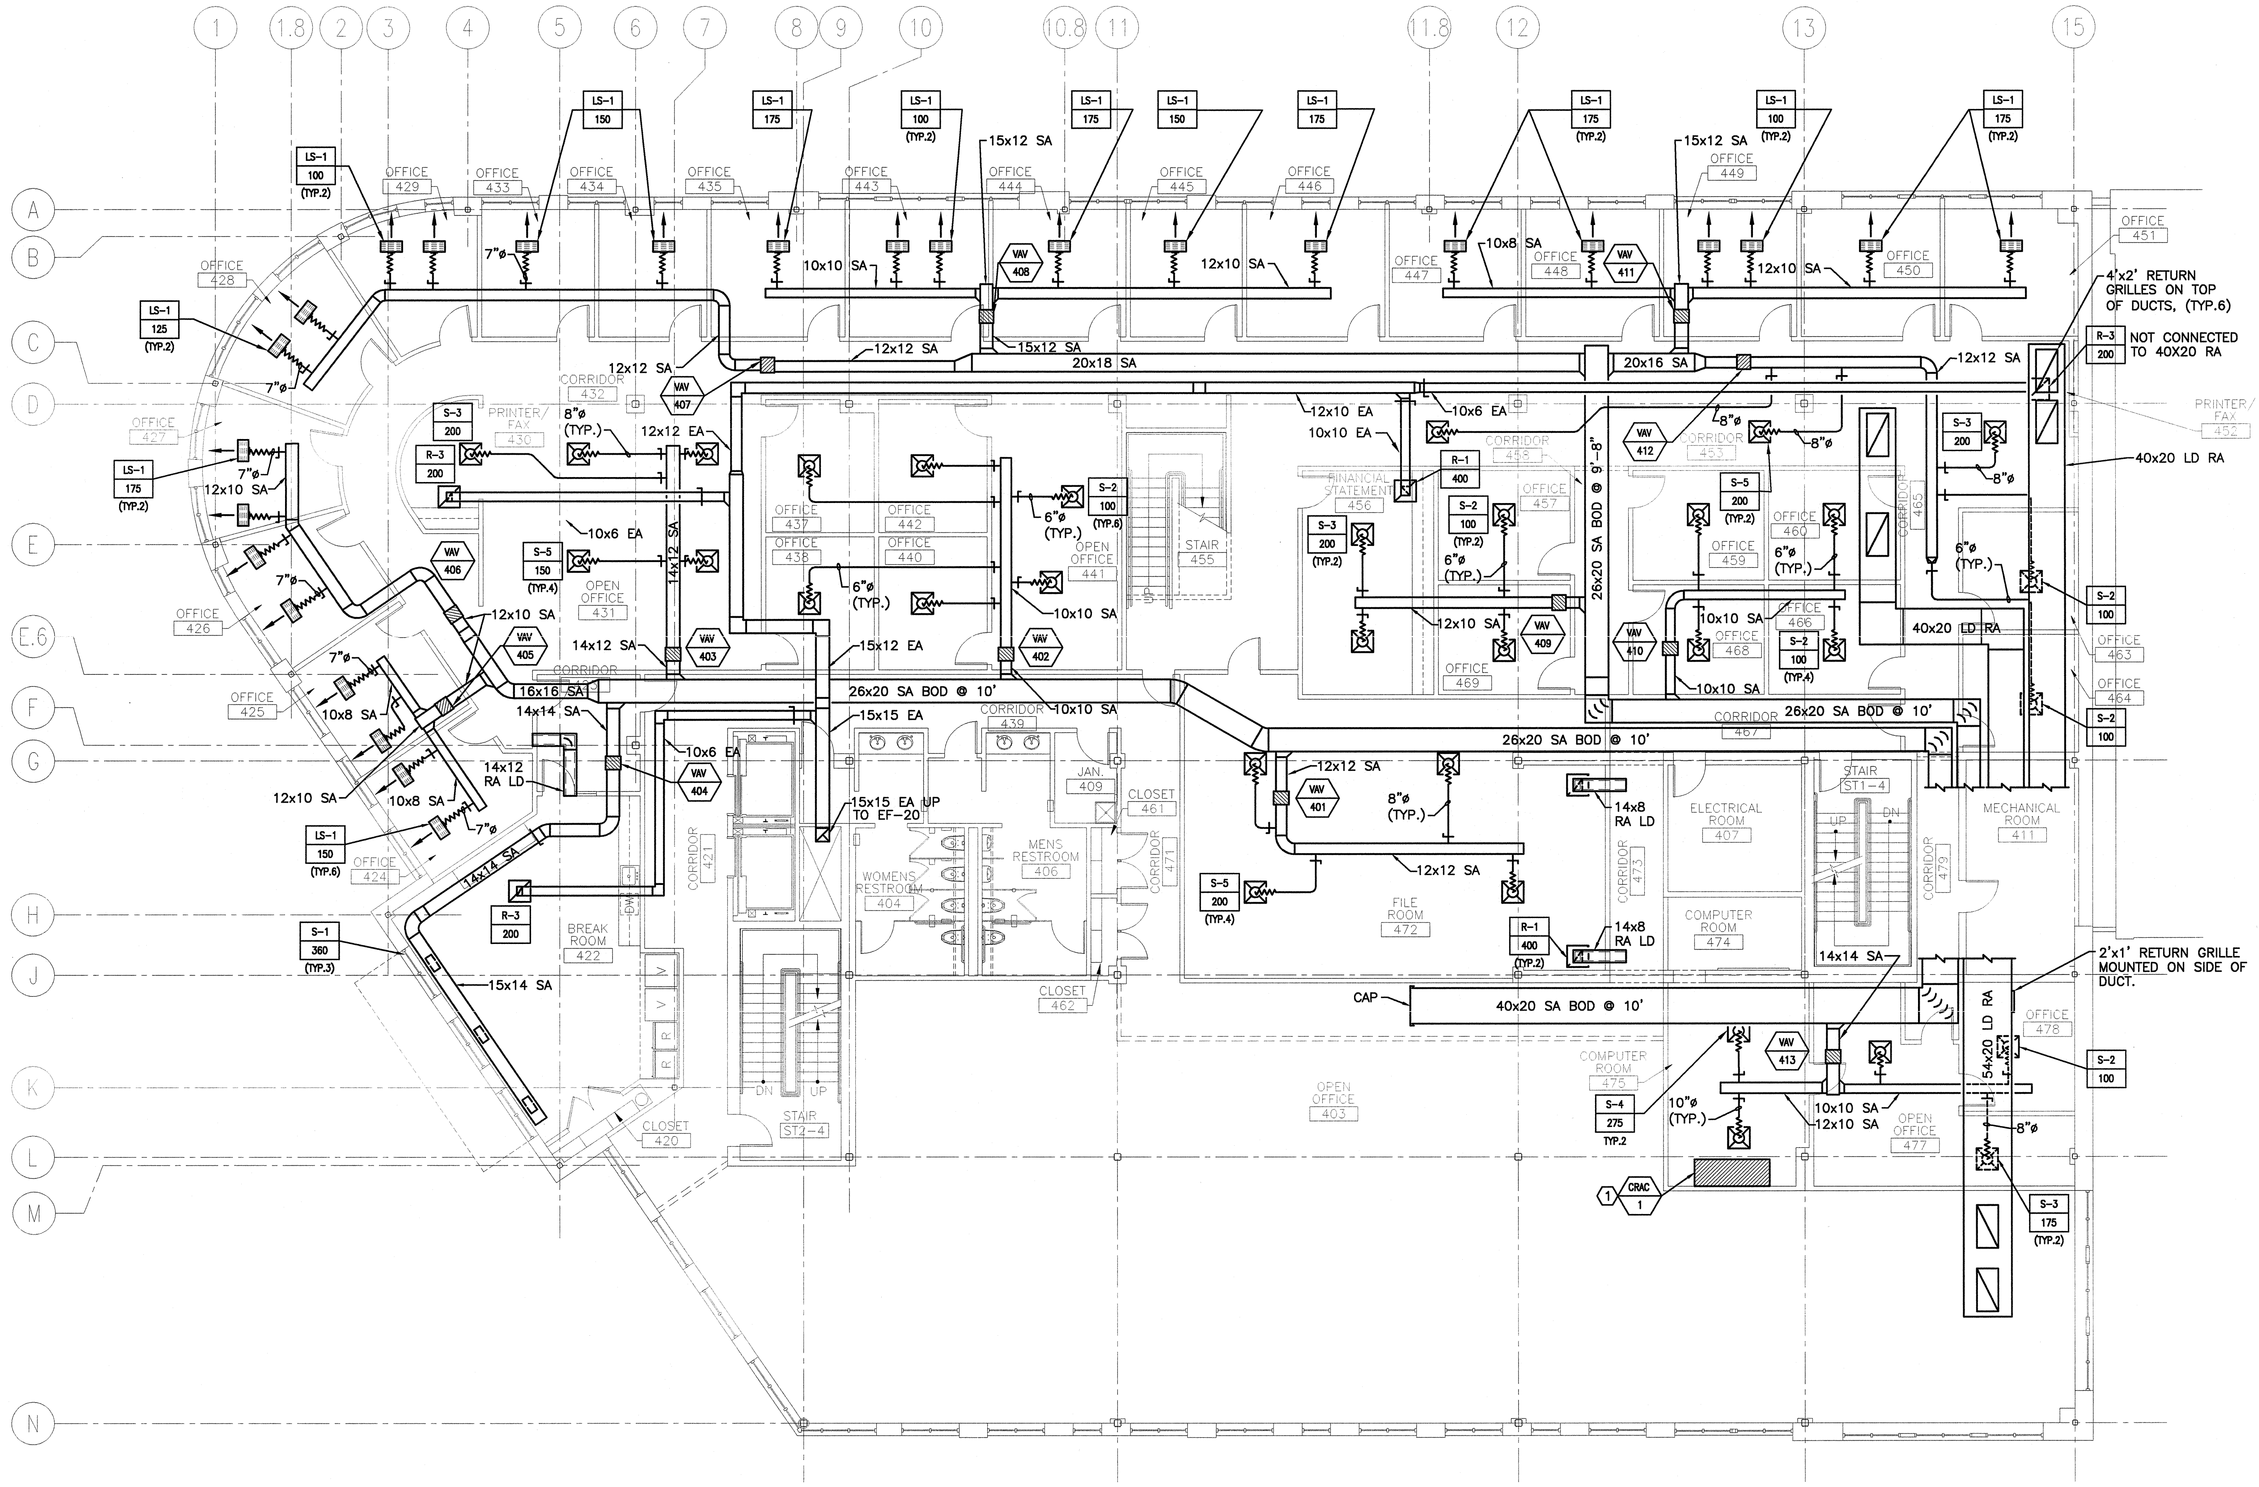

NOTES:

1. SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.
2. PIPE HWS & HWR TO VAV BOXES IN ACCORDANCE WITH DETAIL A11/M-501 & VAV BOX SCHEDULES.

KEYED NOTE:

(1) MOUNT CRAC-1 AT THE CEILING. MOUNT CONDENSING UNIT ON ROOF DIRECTLY ABOVE FIFTH FLOOR COMPUTER ROOM 474. SEE MH102 FOR LOCATION. SEE PL101 FOR CONDENSATE DRAINS.

REV.	DESCRIPTION	DATE
0	ISSUED FOR PERMIT/CONTRACT	6-11-04

ISSUED FOR PERMIT/CONTRACT 6-11-04

CURRENT ISSUE STATUS:

PROJECT NORTH

STATE OF MAINE — DAVID B. REINHEIMER #6251 — REGISTERED PROFESSIONAL ENGINEER

SMRT

ARCHITECTURE ENGINEERING PLANNING

SMRT
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070

BAKER NEWMAN NOYES
FIT-UP
PORTLAND, MAINE

PROJECT:

FOURTH FLOOR
HVAC DUCTWORK PLAN

SHEET TITLE:

SCALE:	1/8" = 1'-0"	DATE:	6-11-04
PROJECT MANAGER:	JLH	GRAPHIC SCALE:	0" 1"
JOB CAP/DRAWN:	DJM/BGG		
A/E OF RECORD:	DBR	SHEET No.	MH101
SMRT CAD FILE:	MH101-03137		
PROJECT No.	03137		

© COPYRIGHT 2004 SMRT INC.

A1 FOURTH FLOOR PLAN

1/8" = 1'-0"