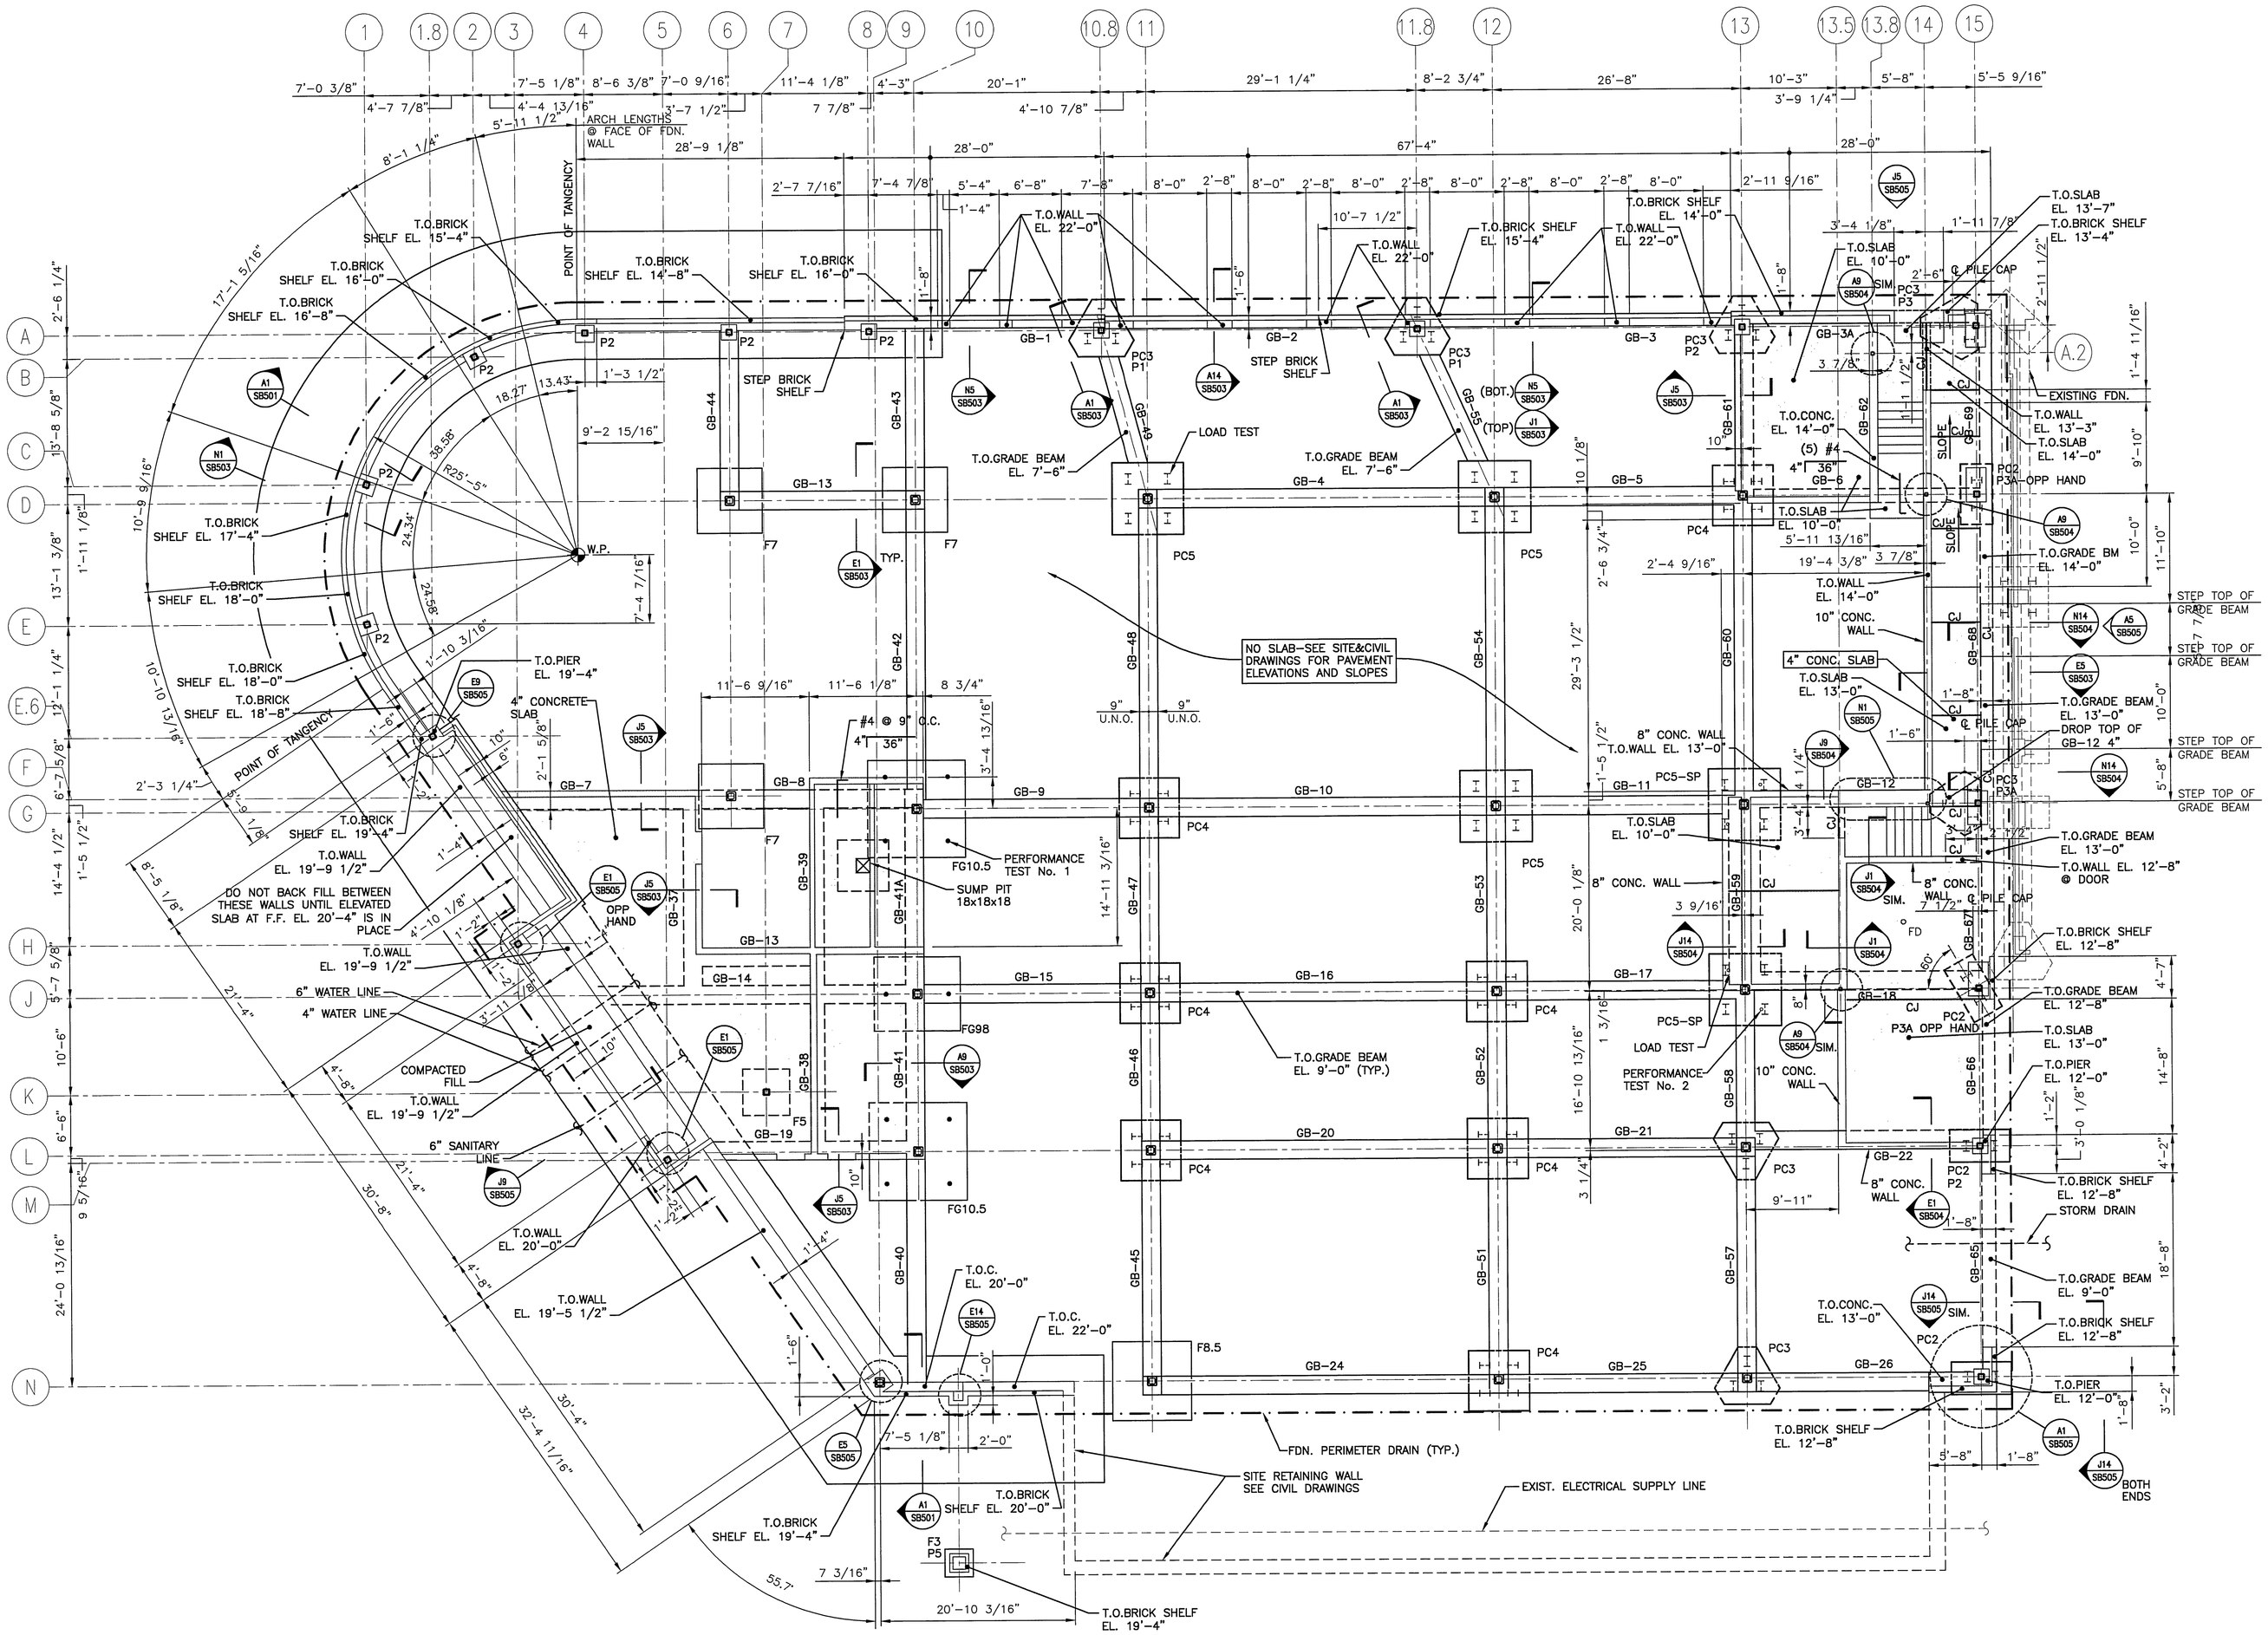

NOTE:

1. SEE S0001 FOR STRUCTURAL GENERAL NOTES.
2. PILES ARE HP12x53 WITH AN ALLOWABLE LOAD OF 180k (90T). PILES ARE BEARING TYPE AND ARE TO BE DRIVEN TO REFUSAL. SEE SPECIFICATION SECTION 02458 FOR DRIVING AND TESTING REQUIREMENTS.
3. TOP OF PILECAPS ARE 7'-6" UNLESS OTHERWISE NOTED (-X'-X") FROM ELEVATION 10'-0".
4. TOP OF SPREAD FOOTINGS ARE 7'-6" UNLESS OTHERWISE NOTED (-X'-X") FROM ELEVATION 10'-0"
5. SEE SB503 FOR GRADE BEAM SCHEDULE.
6. HATCHED ▭ AREAS DENOTES CONCRETE SLAB. 4" TYPICAL DEPTH WITH W2.9xW2.9 4x4 W.W.F. AT MID-DEPTH.
7. SEE SF601 FOR ANCHOR BOLT SIZES AND LOCATIONS.
8. GC TO COORDINATE ALL UTILITY PENETRATIONS THROUGH FOUNDATION WALL PRIOR TO WALL CONSTRUCTION.

REV.	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	12-15-03

ISSUED FOR CONSTRUCTION 12-15-03

CURRENT ISSUE STATUS:

PROJECT NORTH

STATE OF MAINE — SCOTT A. ASH — REGISTERED PROFESSIONAL ENGINEER — NO. 9705 — 12/15/03

SMRT

ARCHITECTURE ENGINEERING PLANNING

SMRT
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070

PROJECT: FORE STREET OFFICE BUILDING
PORTLAND, MAINE

SHEET TITLE: FOUNDATION AND SLAB PLAN

SCALE:	1/8"=1'-0"	DATE:	12-15-03
PROJECT MANAGER:	JLJ	GRAPHIC SCALE:	0" 1"
JOB CAP/DRAWN:	RJL/JSG		
A/E OF RECORD:	JLJ	SHEET No.	SB101
SMRT CAD FILE:	SB101-03087		
PROJECT No.	03087		

© COPYRIGHT 2003 SMRT INC.

A1	FOUNDATION AND SLAB PLAN
1/8"=1'-0"	*