



DRAWTHRU
 A = 1/2 B
 B = GREATER OF 2" OR 1" PLUS
 AHU TOTAL PRESSURE IN
 INCHES-WC

- NOTES:**
1. 1" MIN. PIPE SIZE OR SIZE PER DRAIN TAP IN AHU INSULATE FOR CONDENSATE CONTROL AS REQUIRED.
 2. P-TRAP WITH AIR GAP REQUIRED IN CONDENSATE LINE DRAINING TO SEWER VENTS OR ACID WASTE PUMP STATION.

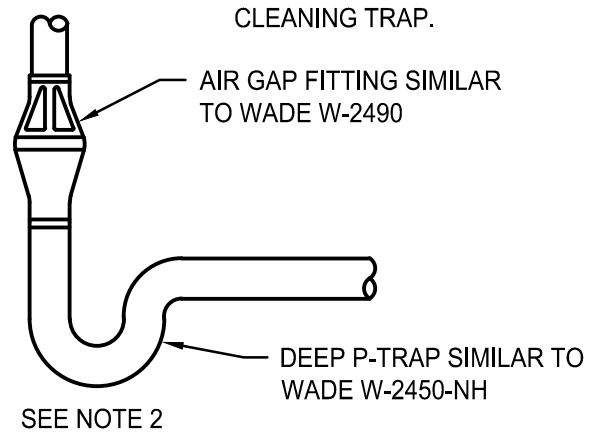

J5 FUNNEL DRAIN DETAIL
 NOT TO SCALE

PLUMBING SPECIALTIES SCHEDULE				
TAG	APPLICATION	TYPICAL UNIT MFG & MODEL NO.	DESCRIPTION	NOTES
WH-A	FREEZE RESISTANT WALL HYDRANT	ZURN #Z-1300-CL-WC-PB	INTEGRAL VACUUM BREAKER, LOOSE KEY, POLISHED BRONZE FACE 3/4" CONNECTION	
NOTES:				

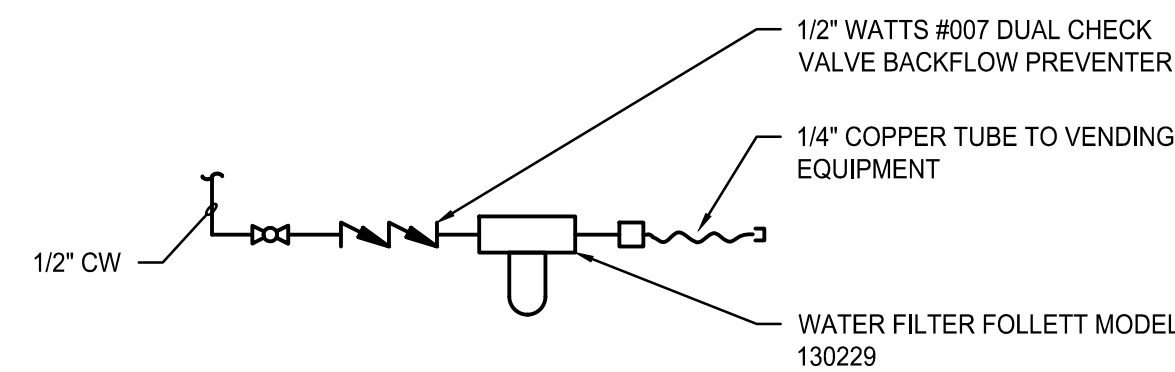

J8 COFFEE MAKER CONNECTION DETAIL
 NOT TO SCALE

NOTE:
 1. SEE SHEET PL001 FOR THE LEGEND AND ABBREVIATIONS

KEYNOTES	
KEYNOTE NUMBER	KEYNOTE DESCRIPTION
1	ADJUST EXISTING CW AND VENT PIPING AS NECESSARY TO CONCEAL PIPES.
2	PROVIDE RAYCHEM 5XL-1 HEAT TRACE ON ALL NEW AND EXISTING COLD WATER PIPING IN AND ABOVE VESTIBULE WALL.
3	3/4" CD-DROP. SPILL VIA AIR GAP INTO FUNNEL DRAIN BEHIND WALL. SEE DETAIL J5/PL101.
4	3/4" CD-DROP. SPILL CD TO FUNNEL DRAIN VIA AIR GAP IN CEILING ABOVE. ROUTE INDIRECT WASTE FROM FUNNEL DRAIN IN WALL TO EXISTING SINK, ABOVE EXISTING P-TRAP.

NO.	DATE	DESCRIPTION
0	02.13.18	ISSUED FOR CONSTRUCTION

ISSUED FOR CONSTRUCTION
 02.13.18

SMRT Architects and Engineers
 144 Fore Street
 Portland, Maine 04104
 1.877.700.7678
 www.smrtinc.com
 ARCHITECTURE | ENGINEERING | PLANNING | INTERIORS | ENERGY **SMRT**

TAC Architectural Group Inc.
 40 Summer St., Suite 4 Bangor, ME 04401


PROJECT NORTH:

BANGOR SAVINGS BANK - RENOVATIONS TO 280 FORE STREET PORTLAND, MAINE


PROJECT NO: 17231
 CAD DWG FILE: PL101-17231
 DRAWN BY: ASM
 CHK'D BY: MJC
 COPYRIGHT: 2018

PLUMBING NEW WORK PLAN - PHASE 1

PL101

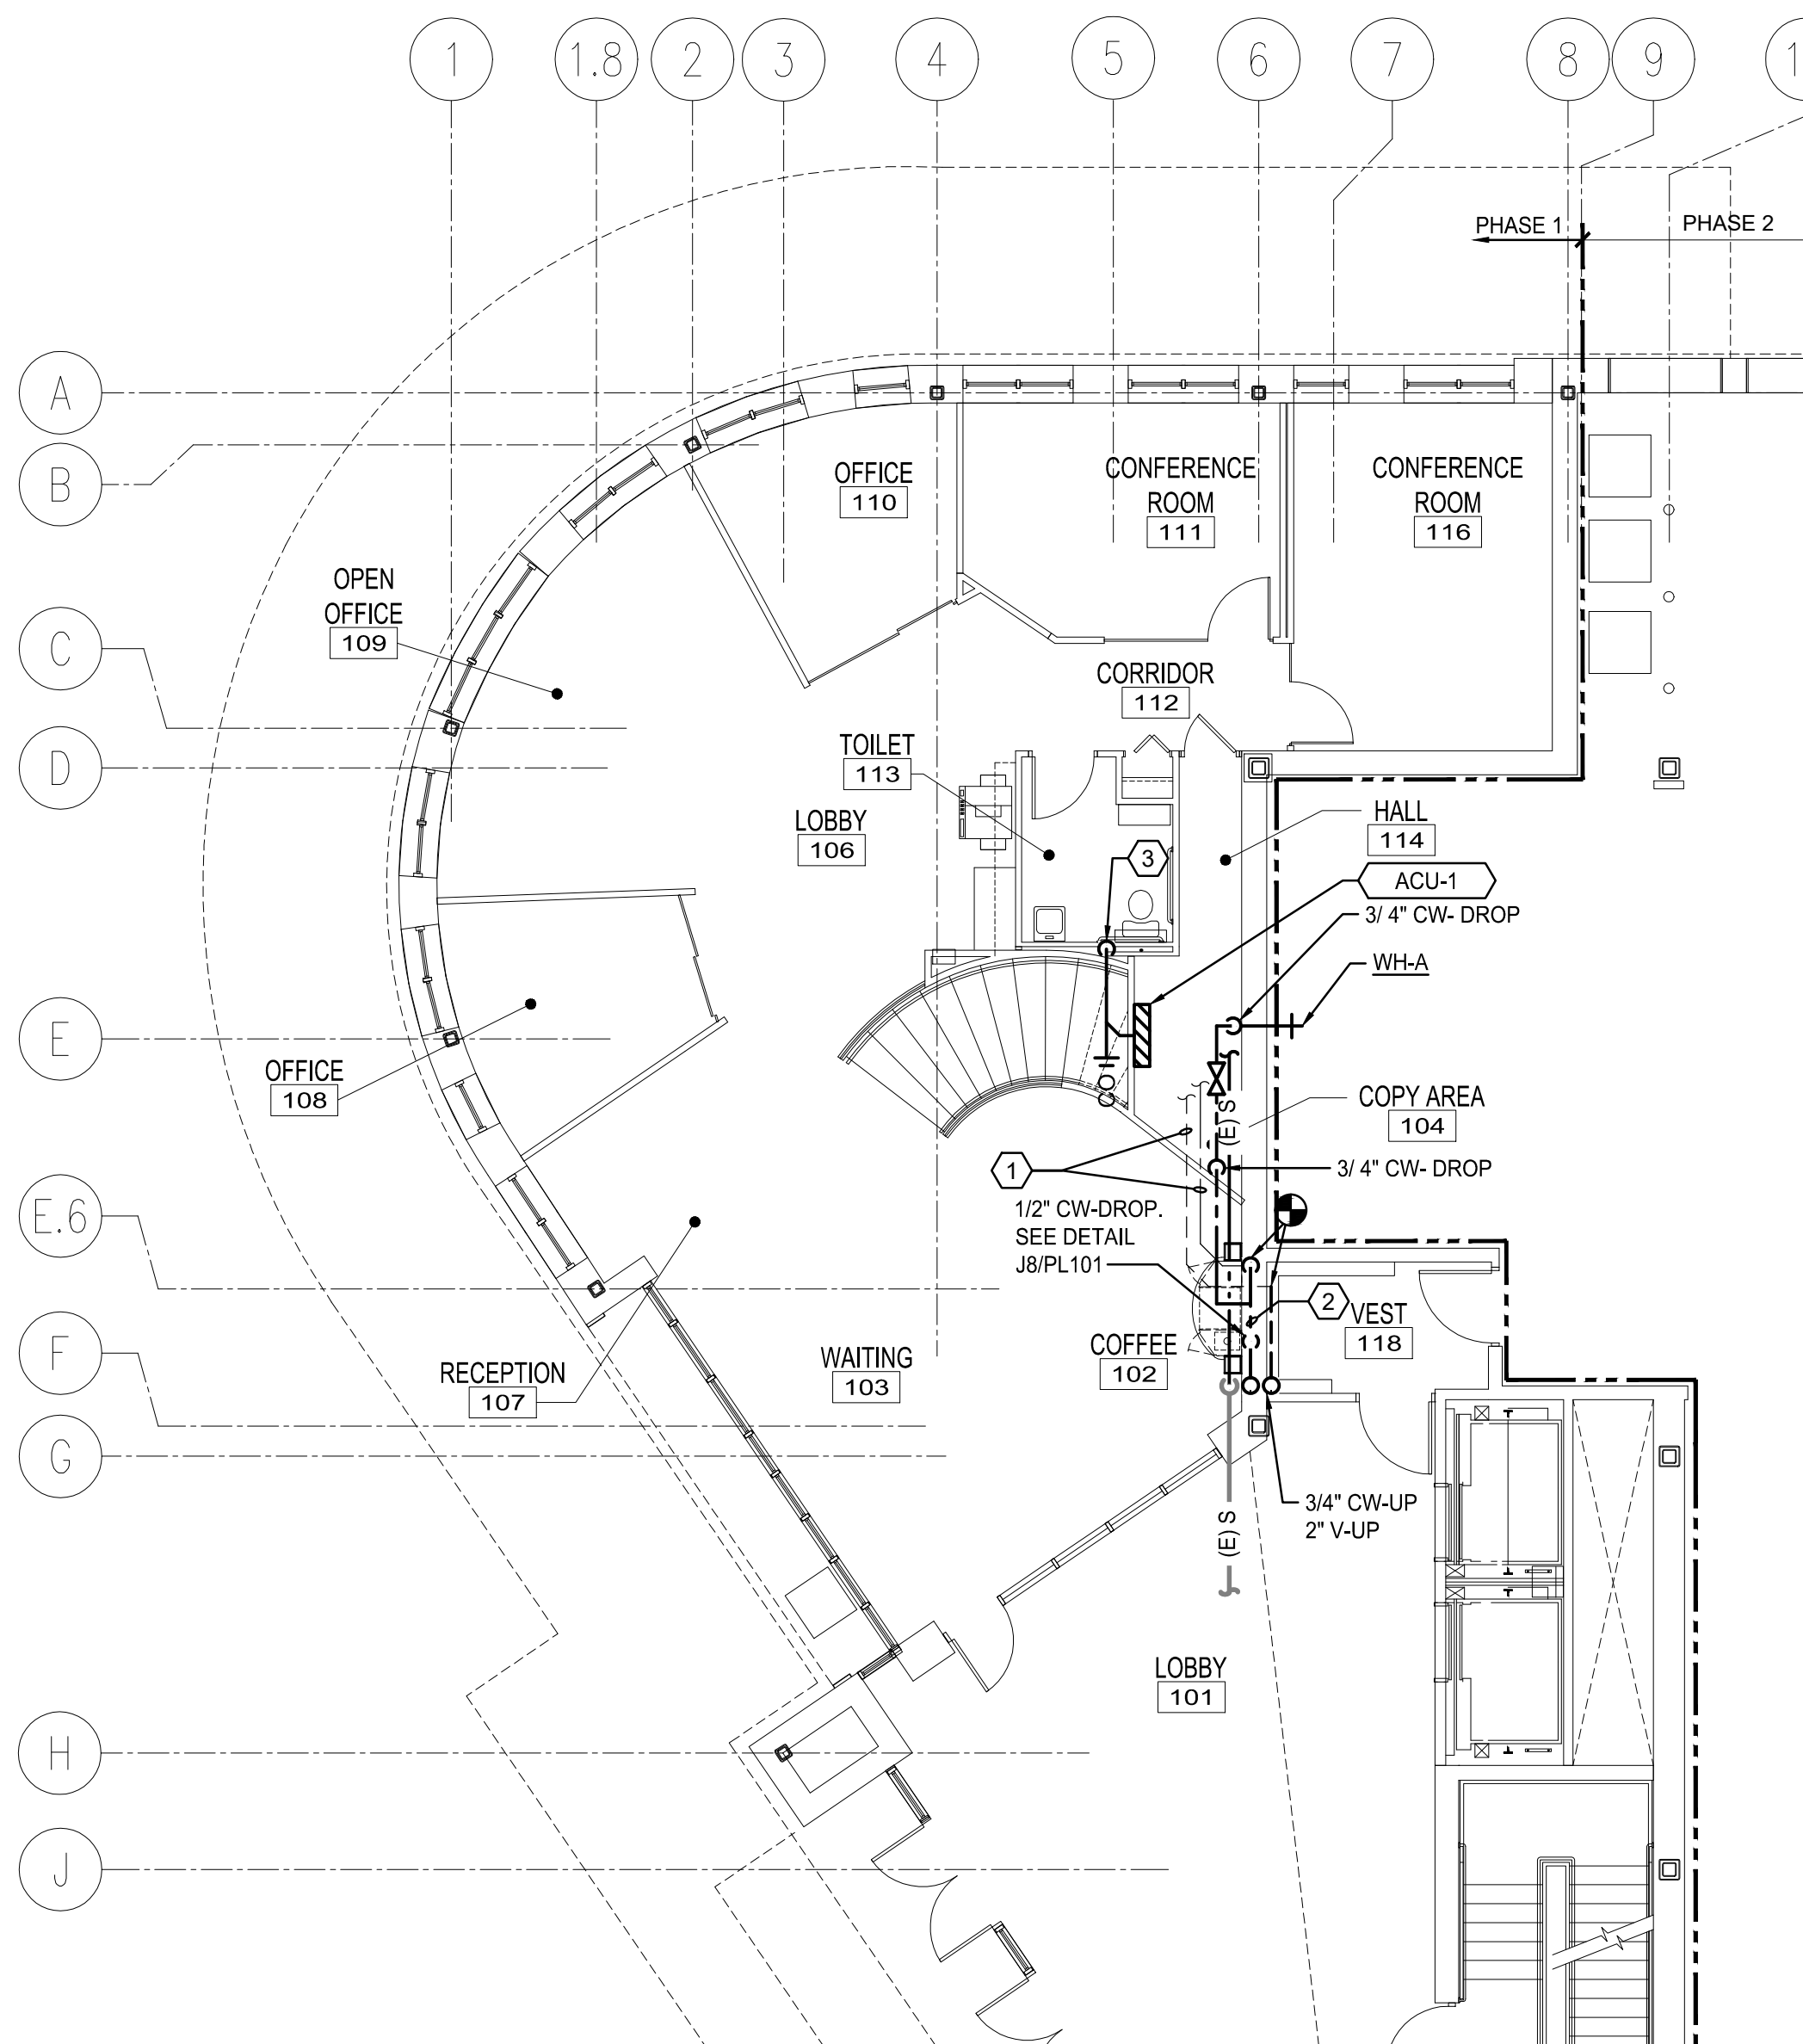

A1 FIRST FLOOR PLUMBING NEW WORK PLAN
 1/8" = 1'-0"

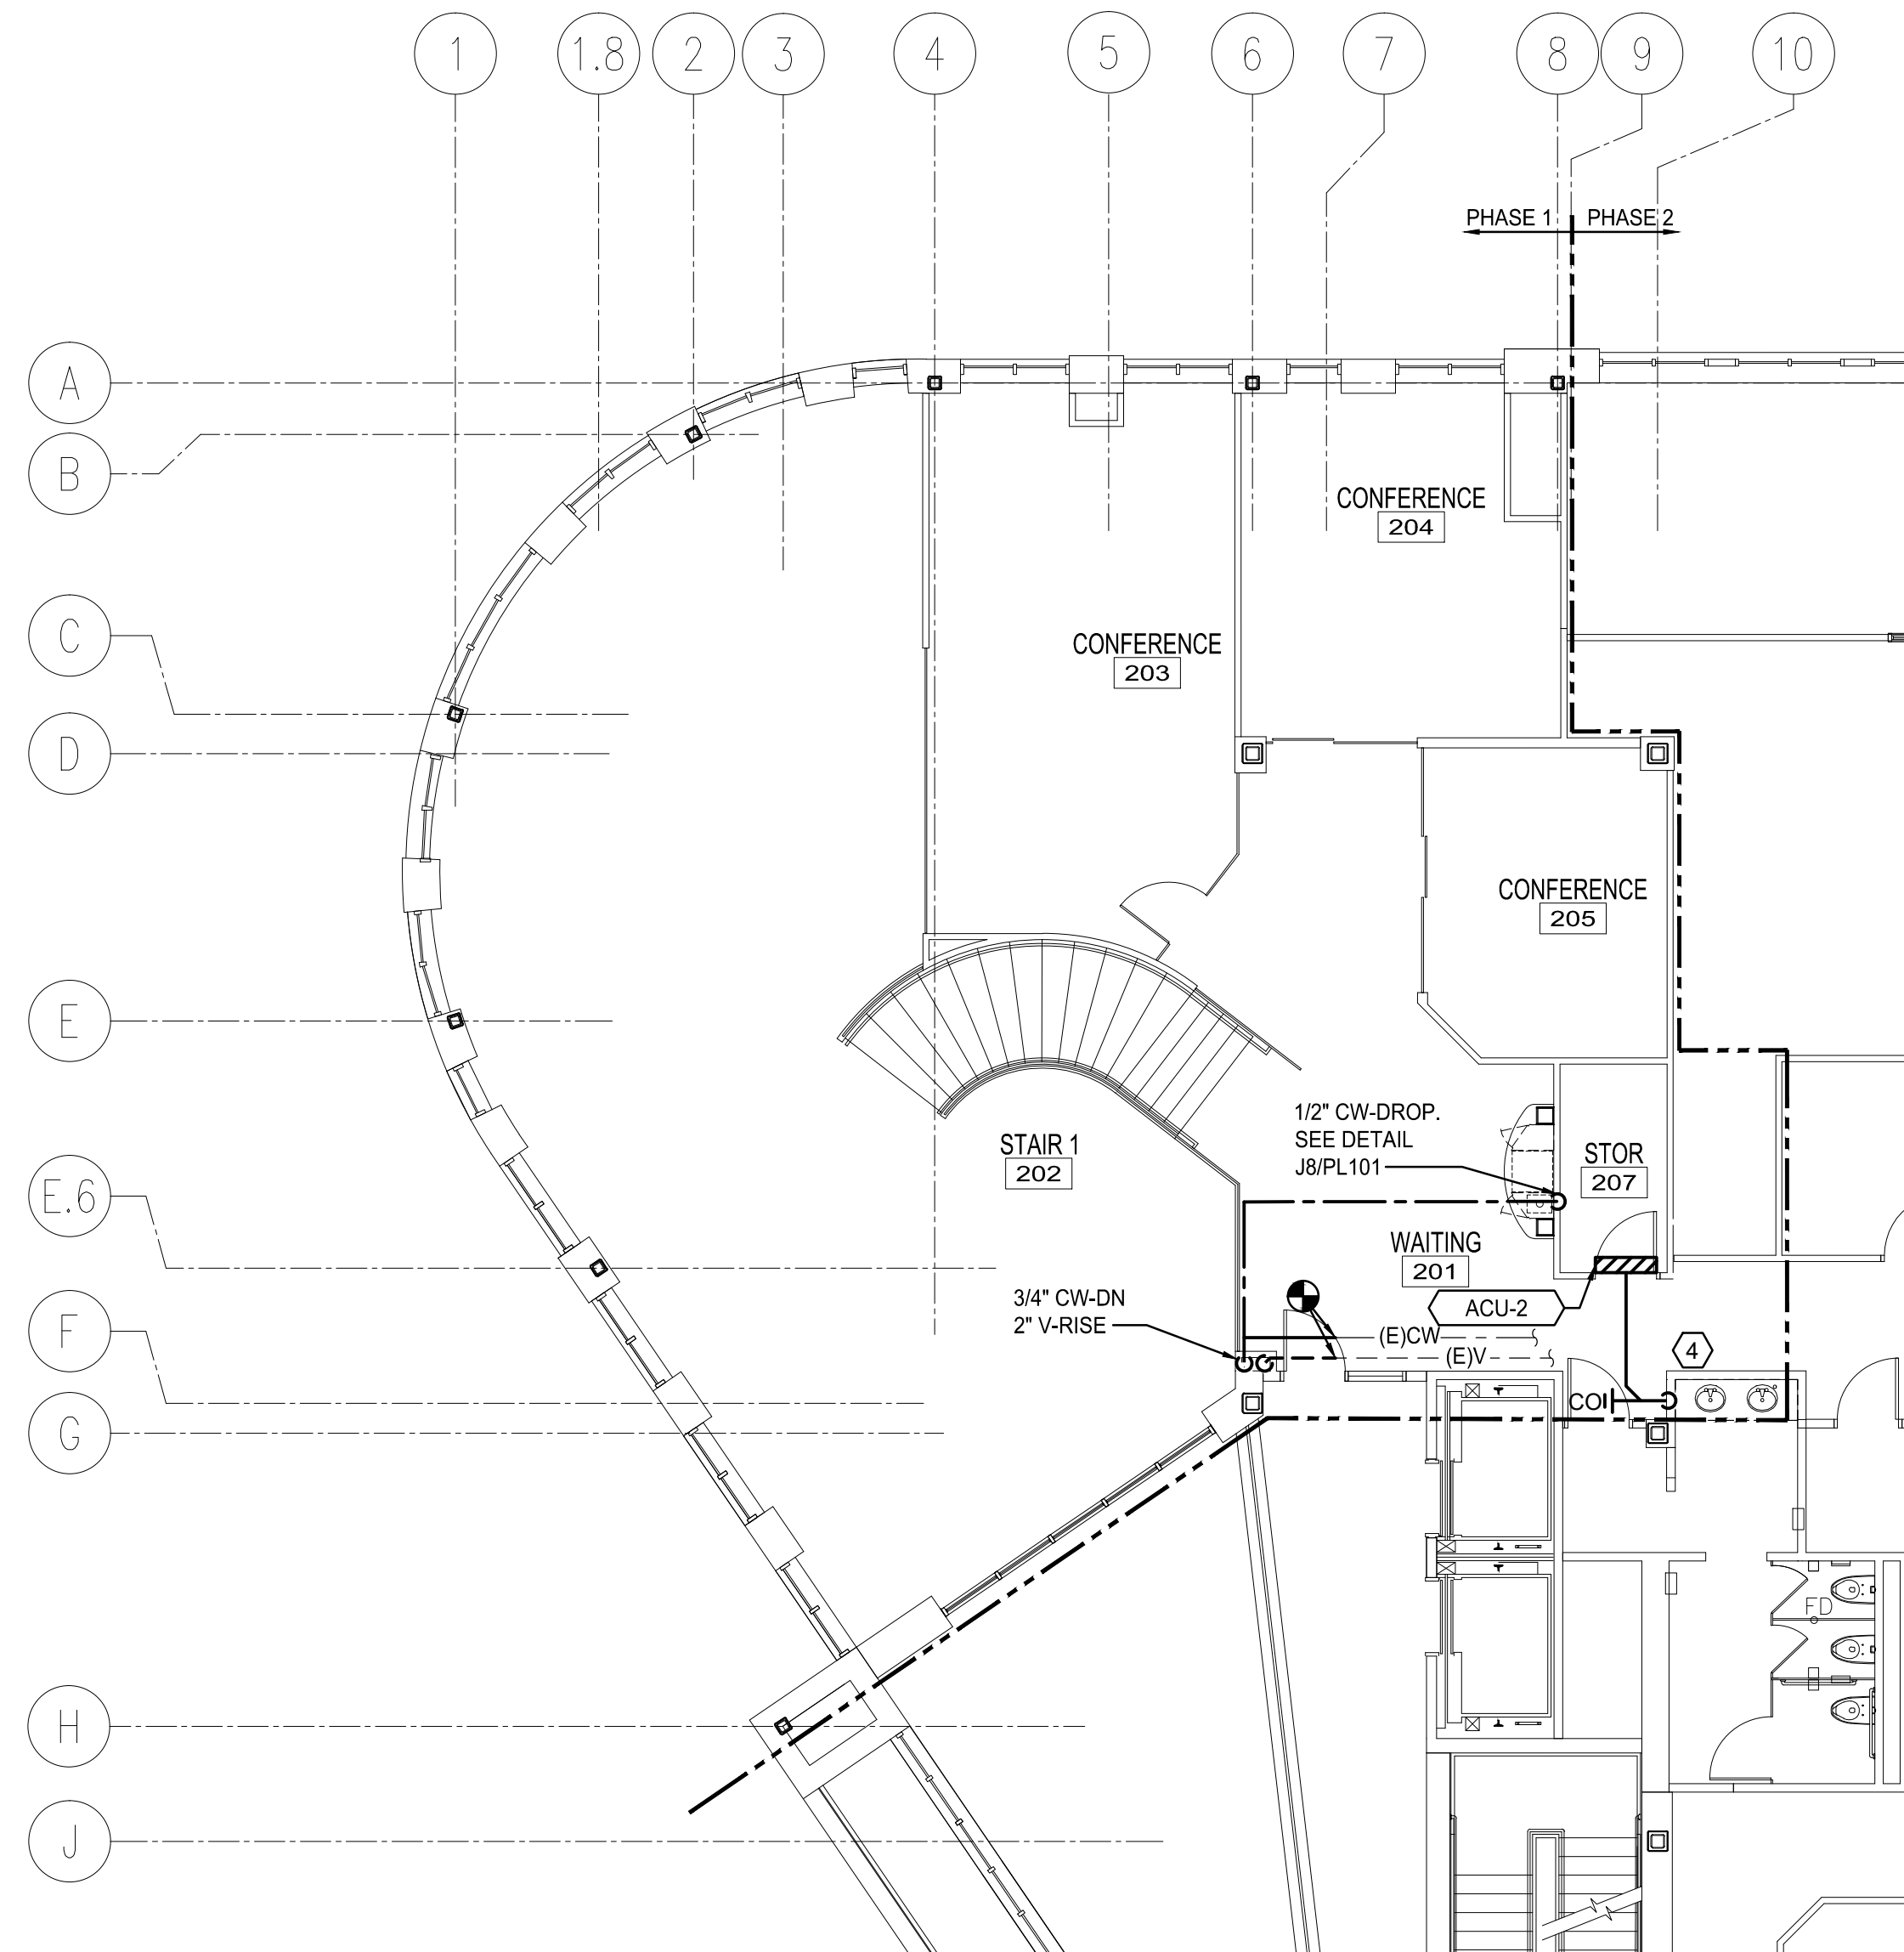

A8 SECOND FLOOR PLUMBING NEW WORK PLAN
 1/8" = 1'-0"