



NOTES:  
 CONDUITS MAY BE SLEPT A MAX 48" SLEEP. CONDUIT ALIGNMENT SHALL AVOID BOOTBY SQUARE.  
 CONDUITS MAY BE STACKED TO LIMIT TRENCH WIDTH.

NOTES:  
 1. THIS PLAN REPRESENTS A PRELIMINARY LAYOUT OF THE CONDUIT AND UNDERGROUND VAULT LOCATIONS. FINAL ELECTRICAL SERVICE DRAWINGS TO BE PROVIDED BY CMP.  
 2. PRIMARY VOLTAGE CABLE WILL BE 500RCM CU 15KV URD & 3/4"AL 15KV URD  
 3. ALL CONSTRUCTION TO BE IN COMPLIANCE WITH CMP'S CONSTRUCTION STANDARDS AND THE LATEST EDITION OF THE NATIONAL ELECTRICAL SAFETY CODE.  
 4. CONDUITS SHALL BE PROPERLY PITCHED TO DRAIN INTO TRANSFORMER FOUNDATIONS, MANHOLES OR SPLICE BOXES. THREE INCHES PER 100 FEET MINIMUM SLOPE.  
 5. INSTALL PULLING LINE IN EACH CONDUIT.  
 6. THE CONTRACTOR IS REQUIRED TO NOTIFY CMP BY CALLING THE LINE SUPERVISOR AT 791-1020 AT LEAST 72 HOURS BEFORE TRENCH EXCAVATION BEGINS.

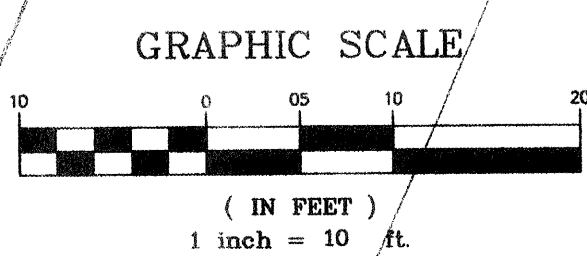

BID SET

REV	DATE	DESCRIPTION
2	08.15.06	ADD ADDITIONAL CONDUIT FOR CABLE & TELEPHONE (PR #1)
1	06.02.06	RELEASED FOR BIDS

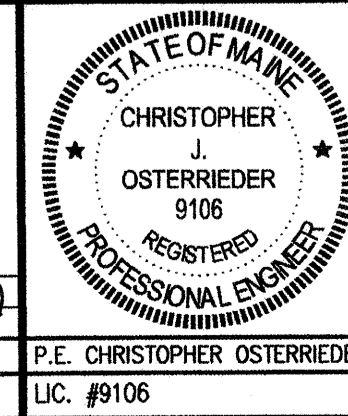

PROJECT: CUSTOM HOUSE SQUARE OFFICE BUILDING  
 SHEET TITLE: ELECTRICAL PLAN  
 CLIENT: OLYMPIA EQUITY INVESTORS, IVB

DeLUCA-HOFFMAN ASSOCIATES, INC.  
 778 MAIN STREET, SUITE 8  
 SOUTH PORTLAND, ME 04106  
 203.775.1121  
 WWW.DELUCAHOFFMAN.COM  
 DRAWN: LECJ DATE: NOV. 2005  
 DESIGNED: CJO SCALE: 1"=10'  
 CHECKED: CJO JOB NO. 2581  
 FILE NAME: 2581-SP  
 SHEET: C-4B

G:\2581\dwg\CONSTRUCTION SET\2581-SP-MOVE-VAULT (Round 2).dwg, ELECTRICAL (2), 10/10/2006 12:18:45 PM, cwintermute