

**REFLECTED CEILING PLAN LEGEND**

- 2x2' REVEALED EDGE SMOOTH FACE SUSPENDED ACOUSTICAL CEILING TILE AND WHITE PAINTED METAL GRID UNLESS NOTED OTHERWISE
- 2x4' SQUARE EDGE SMOOTH FACE SUSPENDED ACOUSTICAL CEILING TILE AND PAINTED METAL GRID. COLOR AS NOTED
- GYPSUM WALL BOARD WITH SMOOTH FINISH
- GYPSUM WALL BOARD WITH TEXTURED FINISH
- EXHAUST FAN GRILLE
- RETURN AIR GRILLE
- SUPPLY AIR DIFFUSER
- RECESSED DOWNLIGHT
- FLUORESCENT STRIP LIGHT
- 2x2' RECESSED FLUORESCENT LIGHT WITH PRISMATIC LENS
- 2x4' RECESSED FLUORESCENT LIGHT WITH PRISMATIC LENS
- PENDANT FIXTURE
- HALL WASHER RECESSED FIXTURE
- SURFACE MOUNTED FIXTURE
- HALL MOUNTED FIXTURE
- FLEXIBLE SUSPENDED LIGHT TRACK
- TRACK MOUNTED FIXTURE
- STRAIGHT LIGHT TRACK
- SQUARE RECESSED DOWNLIGHT
- DECORATIVE LIGHT FIXTURES
- LINEAR DIFFUSERS

**CEILING TYPE ABBREVIATIONS**


- TYPE 1 = (1) LAYER OF 5/8" GYP. BD.; 1/8" 25 GA. METAL FURRING CHANNELS AT 24" O.C. TIED TO 1/2" 16 GA. COLD ROLLED MAIN CHANNELS AT 48" O.C. SUSPENDED W/ 12 SWS HANGER WIRE FROM METAL FLOOR DECK; (2 HR. FIRE-RATED U.L. ASSEMBLY 656)
- TYPE 2 = (1) LAYER OF 5/8" GYP. BD.; 25 GA. METAL FRAMING AT 24" O.C. FASTENED TO STEEL STRUCTURE; (2 HR. FIRE-RATED U.L. ASSEMBLY 656)
- TYPE 3 = FIRE-RATED SUSPENDED ACOUSTICAL CEILING TILE WITH HOLD-DOWN CLIPS ONE PER 24" LENGTH; INTERSTITIAL SPACE; SUSPENDED W/ 12 SWS HANGER WIRE ATTACHED TO METAL FLOOR DECK OR JOISTS; (2 HR. FIRE-RATED U.L. ASSEMBLY 6205)
- TYPE 4 = NON-RATED S.A.C.T.; INTERSTITIAL SPACE; (2) LAYERS OF 5/8" GYP. BD.; (1) LAYER OF 1/2" 440 SOUND BARRIER BY HOMASOTE OR EQUAL; 1/2" 16 GA. COLD ROLLED CROSS CHANNELS AT 24" O.C. TIED TO 1/2" 16 GA. COLD ROLLED MAIN CHANNELS AT 24" O.C. SUSPENDED W/ 12 SWS HANGER WIRE FROM RSIC-DC04 SOUND ISOLATION CLIPS BY PAC INTERNATIONAL ATTACHED TO METAL FLOOR DECK; 6" LAYER OF THERMAFIBER SOUND ATTENUATION FIRE BLANKETS (6AFB) OR EQUAL FITTED TIGHTLY IN PLACE (NO VOIDS); (2 HR. FIRE-RATED U.L. ASSEMBLY 656)
- TYPE 5 = NON-RATED 5/8" GYP. UNO.; INTERSTITIAL SPACE; (2) LAYERS OF 5/8" GYP. BD.; (1) LAYER OF 1/2" 440 SOUND BARRIER BY HOMASOTE OR EQUAL; 1/2" 16 GA. COLD ROLLED CROSS CHANNELS AT 24" O.C. TIED TO 1/2" 16 GA. COLD ROLLED MAIN CHANNELS AT 24" O.C. SUSPENDED W/ 12 SWS HANGER WIRE FROM RSIC-DC04 SOUND ISOLATION CLIPS BY PAC INTERNATIONAL ATTACHED TO METAL FLOOR DECK; 6" LAYER OF THERMAFIBER SOUND ATTENUATION FIRE BLANKETS (6AFB) OR EQUAL FITTED TIGHTLY IN PLACE (NO VOIDS); (2 HR. FIRE-RATED U.L. ASSEMBLY 656)
- TYPE 6 = (2) LAYERS OF 5/8" GYP. BD.; (1) LAYER 3/4" RIGID POLYURETHANE INSULATION; 1/8" 25 MSG GALV. STEEL FURRING CHANNELS 16" O.C.; 1/2" 16 GA. COLD ROLLED CHANNELS SPACED 24" O.C. SUSPENDED W/ 12 SWS HANGER WIRE FROM RSIC-DC04 SOUND ISOLATION CLIPS BY PAC INTERNATIONAL ATTACHED TO METAL FLOOR DECK AT 48" O.C. MAX.; (2) LAYER OF FIBERGLASS BATT FITTED TIGHTLY IN PLACE (NO VOIDS); (2 HR. FIRE-RATED U.L. ASSEMBLY D501)
- TYPE 7 = (1) LAYER OF 5/8" GYP. BD.; MAIN RUNNERS AT 4" O.C. PERPENDICULAR TO STEEL JOISTS; CROSS TEES PERPENDICULAR TO MAIN RUNNERS SPACED 16" O.C.; SYSTEM TYPE 650C BY CHICAGO METALLIC SUSPENDED W/ 12 SWS HANGER WIRE FROM RSIC-DC04 SOUND ISOLATION CLIPS BY PAC INTERNATIONAL ATTACHED TO METAL FLOOR DECK; 6" LAYER OF THERMAFIBER SOUND ATTENUATION FIRE BLANKETS (6AFB) OR EQUAL FITTED TIGHTLY IN PLACE (NO VOIDS); (2 HR. FIRE-RATED U.L. ASSEMBLY 656)
- TYPE 8 = (1) LAYER OF 5/8" GYP. BD.; 25 GA. GALV. 7/8" DEEP METAL FURRING CHANNEL AT 24" O.C. SECURED W/ DOUBLE STRAND OF 18 SWS GALV. HANGER WIRE TO 1/2" 16 GA. COLD ROLLED CHANNELS SPACED 48" O.C. SUSPENDED W/ 12 SWS HANGER WIRE FROM STEEL ROOF JOIST (1 HR. FIRE-RATED U.L. ASSEMBLY P514)
- TYPE 9 = FIRE-RATED SUSPENDED ACOUSTICAL CEILING TILE WITH HOLD-DOWN CLIPS ONE PER 24" LENGTH; INTERSTITIAL SPACE; SUSPENDED W/ 12 SWS HANGER WIRE ATTACHED TO STEEL ROOF JOISTS; (1 HR. FIRE-RATED U.L. ASSEMBLY P225)
- TYPE 10 = (1) LAYER OF 5/8" EXTERIOR GYP. BD.; CONTINUOUS 10 MIL. POLY. VAPOR BARRIER SEAL ALL JOINTS; 25 GA. GALV. 7/8" DEEP METAL FURRING CHANNEL AT 24" O.C. SECURED W/ DOUBLE STRAND OF 18 SWS GALV. HANGER WIRE TO 1/2" 16 GA. COLD ROLLED CHANNELS SPACED 48" O.C. SUSPENDED W/ 12 SWS HANGER WIRE FROM STEEL ROOF JOIST (1 HR. FIRE-RATED U.L. ASSEMBLY P514)
- TYPE 11 = (1) LAYER OF 5/8" EXTERIOR GYP. BD.; 25 GA. GALV. 7/8" DEEP METAL FURRING CHANNEL AT 24" O.C. SECURED W/ DOUBLE STRAND OF 18 SWS GALV. HANGER WIRE TO 1/2" 16 GA. COLD ROLLED CHANNELS SPACED 48" O.C. SUSPENDED W/ 12 SWS HANGER WIRE FROM STEEL ROOF JOIST (1 HR. FIRE-RATED U.L. ASSEMBLY P514)

DATE	REVISION	SCHEDULE
07-01-10	ADD CEILING LAYOUT	08-25-10
	REVISE COLUMN LINE TAG 9.5 TO 9.1	

**COPECHED**  
 CONSTRUCTION CORPORATION  
 11 CORPORATE DRIVE, BELMONT, NH 03320  
 PHONE (603) 737-9090 FAX (603) 737-9191

**FIRST FLOOR REFLECTED CEILING PLAN**

PROJECT: Hotel, Restaurant, & Portside Residences Portland ME  
 DATE: 06-21-10  
 SCALE: 1/8"=1'-0"  
 DRAWN BY: dwb  
**A26**  
 SHEET:

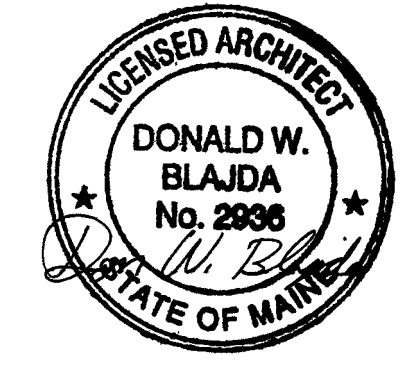

© COPYRIGHT 2010 BY D.C.C.