



PORTLAND MAINE

Strengthening a Remarkable City, Building a Community for Life - www.portlandmaine.gov



Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Date: 12/15/14

Jeff Levine, AICP, Director
Director of Planning and Urban Development

Tammy Munson
Director, Inspections Division

Electronic Signature and Fee Payment Confirmation

Notice: Your electronic signature is considered a legal signature per state law.

By digitally signing the attached document(s), you are signifying your understanding this is a legal document and your electronic signature is considered a **legal signature** per Maine state law. You are also signifying your intent on paying your fees by the opportunities below.

I, the undersigned, intend and acknowledge that no permit application can be reviewed until payment of appropriate permit fees are **paid in full** to the Inspections Office, City of Portland Maine by method noted below:

Within 24-48 hours, upon receipt of an e-mailed invoice from Building Inspections, which signifies that my electronic permit application and corresponding paperwork have been received, determined complete, entered by an administrative representative, and assigned a permit number, I then have the following four (4) payment options:

- to provide an on-line electronic check or credit/debit card (we now accept American Express, Discover, VISA, and MasterCard) payment (along with applicable fees beginning July 1, 2014),
- call the Inspections Office at (207) 874-8703 and speak to an administrative representative to provide a credit/debit card payment over the phone,
- hand-deliver a payment method to the Inspections Office, Room 315, Portland City Hall,
- or deliver a payment method through the U.S. Postal Service, at the following address:

City of Portland
Inspections Division
389 Congress Street, Room 315
Portland, Maine 04101

Once my payment has been received, this then starts the review process of my permit. **After all approvals have been met and completed, I will then be issued my permit via e-mail.** No work shall be started until I have received my permit.

Chris Hotham

Applicant Signature: 2014.12.08 08:22:50 -05'00'


Date: 12/8/14

I have provided digital copies and sent them on: _____

Date: 12/8/14

NOTE: All electronic paperwork must be delivered to buildinginspections@portlandmaine.gov or by physical means ie; a thumb drive or CD to the office.

Room 315 - 389 Congress Street- Portland, Maine 04101 (207) 874-8703 - Fax: 874-8716 - TTY: 874-8936

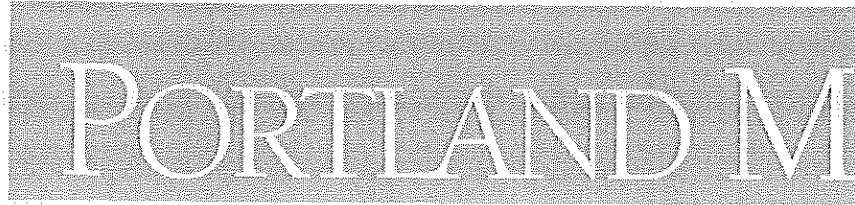

Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Date: 12/15/14

Strengthening a Remarkable City, Building a Community for Life - www.portlandmaine.gov

Jeff Levine, AICP, Director
Director of Planning and Urban Development

Tammy Munson
Director, Inspections Division

Electronic Signature and Fee Payment Confirmation

Notice: Your electronic signature is considered a legal signature per state law.

By digitally signing the attached document(s), you are signifying your understanding this is a legal document and your electronic signature is considered a *legal signature* per Maine state law. You are also signifying your intent on paying your fees by the opportunities below.

I, the undersigned, intend and acknowledge that no permit application can be reviewed until payment of appropriate permit fees are *paid in full* to the Inspections Office, City of Portland Maine by method noted below:

Within 24-48 hours, once my complete permit application and corresponding paperwork has been electronically delivered, I intend to **call the Inspections Office** at 207-874-8703 and speak to an administrative representative and provide a credit/debit card over the phone.

Within 24-48 hours, once my permit application and corresponding paperwork has been electronically delivered, I intend to **hand deliver** a payment method to the Inspections Office, Room 315, Portland City Hall.

I intend to deliver a payment method through the U.S. Postal Service mail once my permit paperwork has been electronically delivered.

Chris Hotham
Applicant Signature: 2014.12.08 08:25:45 -05'00'


Date: 12/8/14

I have provided digital copies and sent them on:


Date: 12/8/14

NOTE: All electronic paperwork must be delivered to buildinginspections@portlandmaine.gov or by physical means ie; a thumb drive or CD to the office.

Room 315 - 389 Congress Street- Portland, Maine 04101 (207) 874-8703 - Fax: 874-8716 - TTY: 874-8936

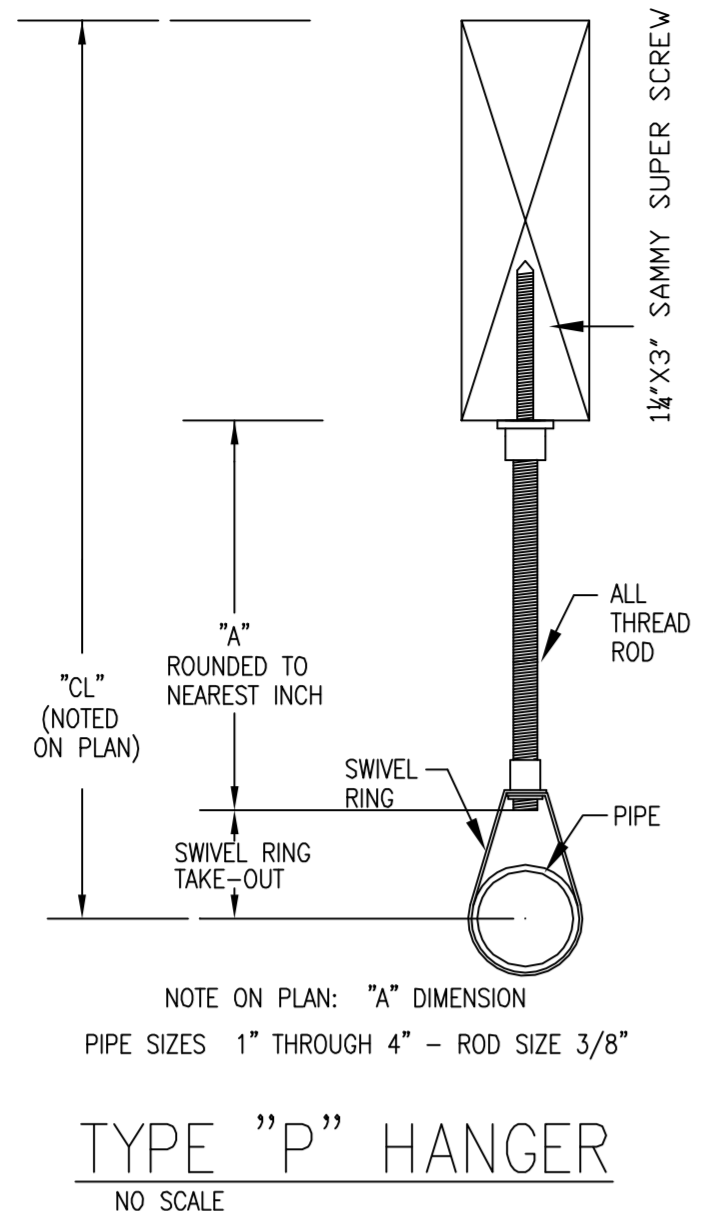

EXISTING PIPE SIZED PER SCHEDULED SYSTEM
 REPLACE EXISTING PENDANT & UPRIGHT SPRINKLERS WITH NEW TO ACCOMMODATE NEW FLOOR PLAN & ACT CEILING
 EXISTING MAINS & BRANCH LINES TO REMAIN
 ALL NEW PIPING WILL BE STEEL

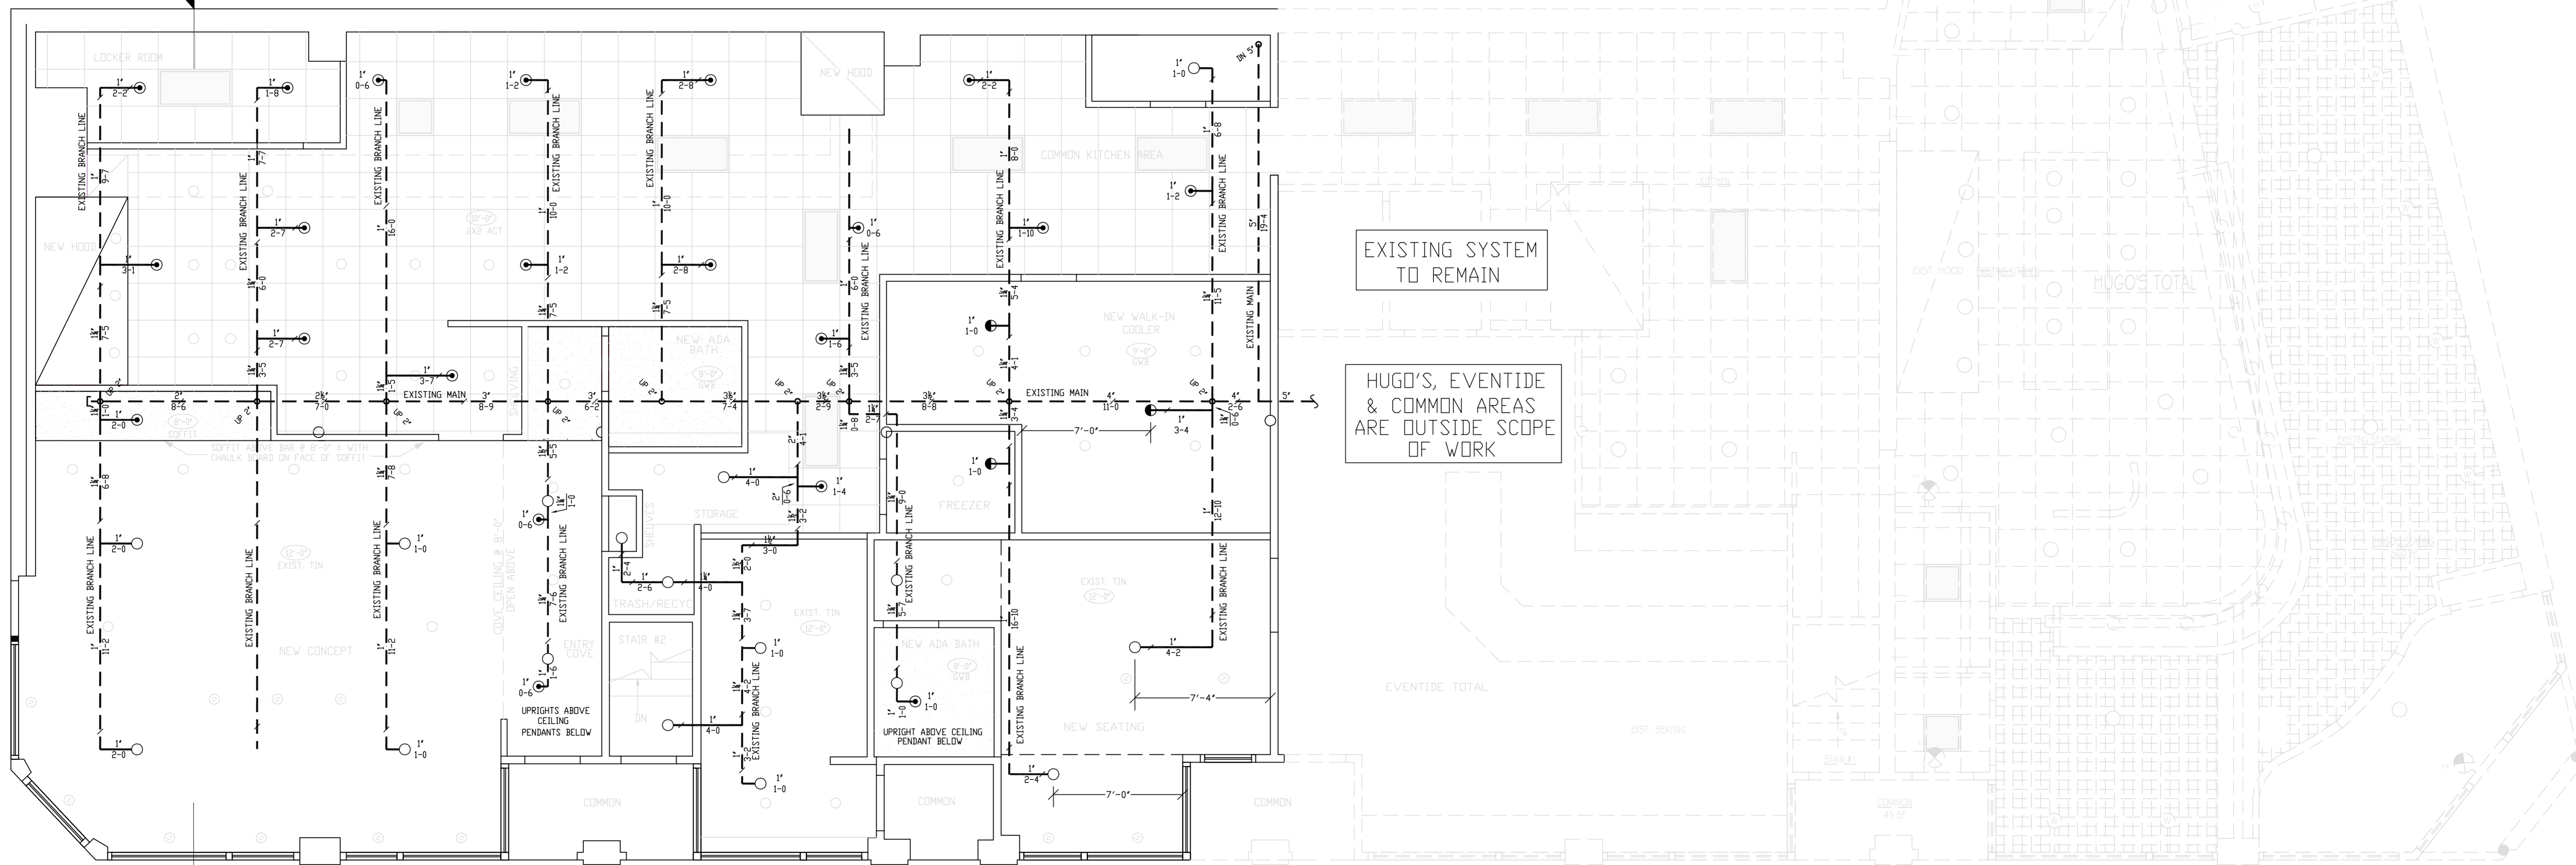

GROUND FLOOR FIRE PROTECTION
 SCALE 1/4"=1'-0"
 QUANTITY ○ = 21
 QUANTITY ⊙ = 17
 QUANTITY ⊕ = 3
 --- = EXISTING MAINS & BRANCH LINES
 --- = NEW ARM OVERS

REVISIONS	NOTES
1.	K=5.6 UPRIGHT & PENDANT SPRINKLER COVERAGE 15'X15'

SPRINKLER TYPE	IDENTIFICATION NO.	MFG.	ESC.	MODEL	FINISH	ORIFICE	TEMP.	SYMBOL	QUANT.
QUICK RESP. UPRIGHT K= 5.6	TY3131	TYCO	N/A	TY-FRB	BRASS	1/2"	155°	○	17
QUICK RESP. PENDANT K= 5.6	TY3231	TYCO	2 PIECE	TY-FRB	WHITE	1/2"	155°	⊙	21
DR. DRY PENDANT K= 5.6	TY3295	TYCO	SEMI-REC.	DS-1	WHITE	1/2"	155°	⊕	3
TOTAL SPRINKLERS THIS DRAWING									41

STANDARD SYMBOLS	STANDARD SYMBOLS
○ = POST INDICATOR VALVE	⊕ = ALARM CHECK VALVE
⊙ = KEY VALVE	⊕ = RISER W/ALARM VALVE
⊕ = FIRE HYDRANT	⊕ = RISER W/DRY VALVE
⊕ = FIRE DEPT. CONNECTION	⊕ = RISER W/ELEC. FLOW SWITCH
⊕ = O.S. & Y GATE VALVE	⊕ = RISER W/DELUGE VALVE
⊕ = SWING CHECK VALVE	⊕ = WATER MOTOR BELL
⊕ = NEW UNDERGROUND	⊕ = ELECTRIC BELL
⊕ = EXIST UNDERGROUND	⊕ = FLUSH FIRE DEPT. CONNECTION

INSPECTIONS
1.
2.
3.
4.
5.

RESPONSIBLE MANAGING SUPERVISOR #348
 CONTRACTOR LICENSE #295

HUGO'S RESTAURANT RENOVATION 2014
 80-90 MIDDLE STREET
 PORTLAND, MAINE 04101
FIRE PROTECTION PLAN

FREEDOM FIRE PROTECTION, INC.
 209 QUAKER RIDGE ROAD
 CASCO, MAINE 04015

JOB No. M0199
 DATE 12/2/14
 DRAWN BY M/JN
 SCALE AS NOTED
 SHEET No. FP-2 of 2



Water-Based Fire Suppression System Permit Application Checklist

Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Date: 12/15/14

All of the following information is required and must be submitted. Checking off each item as you prepare your application package will ensure your package is complete and will help to expedite the permitting process.

Complete and submit the following for all systems:

- Vectored pdf plans and documents included (same as submitted to the State Fire Marshal where applicable)*
- Sprinkler installation costs: \$9,380.00
- State Sprinkler license number: 295
- State Sprinkler Permit / log number: 2141487
- Life Safety Code Occupancy Classification: Light Hazard
- Is this new work or a renovation to an existing system? Update to existing
- Will the system be a combination sprinkler and standpipe system? No
- The water supply is: Municipal Pump and tank Other: _____
- A copy of the state sprinkler permit with RMS sign off is required prior to the final inspection
- Design complies with City Code Ch. 10 and Fire Department Regulations Ch 6: Yes

The following checks lists are to be completed as applicable:

NFPA 13D sprinkler check list (Rooming and Lodging & Small Residential Board and Care only)

- Is this check list applicable? _____
- What edition of NFPA 13D is the designed to? _____
- Is the building part of a mixed occupancy? _____
- Will all habitable areas and closets be sprinklered? _____
- Will the entrance foyers be sprinklered? _____
- Is this a multipurpose piping system? _____
- Does the system use pex piping? _____
- Will the water supply meet the requirements for a two-family dwelling? _____
- Will water flow activate the fire alarm system? _____
- Will the valves be electrically supervised? _____
- A city plumbing permit has been pulled: _____



Reviewed for Code Compliance
Inspections Division
Approved with Conditions

NFPA 13R sprinkler check list

- Is this check list applicable? _____
- What edition of NFPA 13R is the designed to? _____
- Building construction type: _____
- Will the sprinkler system provide complete or partial coverage of the building? _____
- Will covered exterior balconies, decks and ground floor patios be sprinklered? _____
- Size of riser assembly: _____
- Fire department connection- number of 2 ½" inlets: _____
- Electrical supervision will be provided via the fire alarm system per NFPA 101:9.7.2: _____
- Is the nearest fire hydrant within 100 ft. of the FDC? _____
- The completed *Contractor's Material and Test Certificate for Aboveground Piping* shall be provided at the completion of the job? _____

Date: 12/15/14

NFPA 13 sprinkler check list

- Is this check list applicable? Yes
- What edition of NFPA 13 is the designed to? 2010
- Building construction type: Existing
- Will the sprinkler system provide complete or partial coverage of the building? Complete
- System type (See NFPA 13:3.4): Wet
- NFPA 13 Occupancy Classification (Hazard): Light/Ordinary Group 1
- Is the structure high-rise (see NFPA 101:3.3.32.7)? No
- Size of riser assembly: 6"
- Fire department connection- number of 2 ½" inlets: Existing
- Electrical supervision will be provided via the fire alarm system per NFPA 101:9.7.2: Existing
- Is the nearest fire hydrant within 100 ft. of the FDC? N/A
- The completed *Contractor's Material and Test Certificate for Aboveground Piping* shall be provided at the completion of the job? Yes

NFPA 14 standpipe check list

- Is this check list applicable? _____
- What edition of NFPA 14 is the designed to? _____



Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Date: 12/15/14

- What class of standpipe is this? _____
- Is the system automatic or manual? _____
- Is the system wet or dry (see NFPA 14:5.4.1.4)? _____
- Is the structure high-rise (see NFPA 101:3.3.32.7)? _____
- What is the minimum residual pressure for the most remote hose connection (see NFPA 14:7.8.1 and 7.8.2)? _____
- What is the maximum static pressure at hose connections (see NFPA 14:7.8.3)? _____
- Are floor control valve assemblies provided (see NFPA 14:6.3.5)? _____
- Number of standpipes (see NFPA 14:3.3.11); _____
- Minimum required flow rate (see NFPA 14:7.10); _____
- Fire department connection- number of 2 ½" inlets (see NFPA 14:7.12.3); _____
- What is the pressure required at the FDC inlets to deliver the system demand (see NFPA 14:6.4.5.2.2); _____
- Is the nearest fire hydrant within 100 ft. of the FDC (see NFPA 14:6.4.5.4)? _____
- The completed *Standpipe Contractor's Material and Test Certificate for Aboveground Piping and Underground Piping* as applicable shall be provided at the completion of the job (see NFPA 14:11.1.3); _____

NFPA 20 fire pump check list (not required for NFPA 13D systems)

- Is this check list applicable? _____
- What edition of NFPA 20 is the designed to? _____
- What is the water source? _____
- Is the pump and associated equipment listed for fire service? _____
- What is the minimum required flow rate? _____
- What is the pump driver type? _____
- Is the pump design less than 7 hp? _____
- If less than 7 hp does the pump have a general listing and has its use been approved by the State Fire Marshal's Office? _____
- Will the equipment be protected in accordance with NFPA 14:5.12? _____
- Is the pump installed at least 50 ft. from the protected premises? _____
- If not what is the fire resistance separation provided (see NFPA 14:5.12.1.1)? _____



Reviewed for Code Compliance
Inspections Division
Approved with Conditions

NFPA 24 private fire mains and hydrants check list

- Is this check list applicable? _____
- All information shall be provided per NFPA 24:4.1.3 prior to construction? _____ Date: 12/15/14
- Design/installation shall comply with City Code Ch. 10 and Fire Department Regulations Ch 2:

- What is the minimum fire main size serving a fire hydrant? _____
- What is the minimum fire main size not serving a fire hydrant? _____
- What is the minimum fire flow available from the water supply? _____
- If the water supply is stored water, what is the quantity available? _____
- The completed *Contractor's Material and Test Certificate for Underground Piping* shall be provided at the completion of the job? _____
- The completed *City of Portland Test and Maintenance Report and Hydrant Flow Test Report* shall be provided at the completion of the job? _____

*** See Applicant Submittal Requirements for Electronic Plan Review.**

Separate permits are required for internal and external plumbing, & electrical installations.

For questions on Fire Department requirements call the Fire Prevention Officer at (207) 874-8405.

Please submit all of the information outlined in this application checklist. If the application is incomplete, the application may be refused.

In order to be sure the City fully understands the full scope of the project, the Planning and Development Department may request additional information prior to the issuance of a permit. For further information or to download copies of this form and other applications visit the Inspections Division on-line at www.portlandmaine.gov, or stop by the Inspections Division office, room 315 City Hall or call 874-8703.

This is not a Permit; you may not commence any work until the Permit is issued.



Water-Based Fire Suppression System Permit Application



If you or the property owner owes real estate or personal property taxes or user c
within the City, payment arrangements must be made before permits of any

Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Date: 12/15/14

Address/Location of Construction: 80 - 90 Middle St Portland, Me 04104		
Total Square Footage of Proposed Structure:		3036 sqft +/-
Tax Assessor's Chart, Block & Lot Chart# Block# Lot# 029 L004001	Applicant Name: Freedom Fire Address: Protection 209 Quaker Ridge Rd City, State & Zip: Casco Me 04015	Telephone: 207-627-4109 207-318-9992 Email: wwales@maine.rr.com
Lessee/Owner Name : Andrew Taylor (if different than applicant) Address: 100 Silver St Portland, Me 04104 Telephone & E-mail: (617) 694-2700	Contractor Name: Same As (if different from Applicant) Owner Address: City, State & Zip: Telephone & E-mail:	Cost Of Work: \$ 9,380.00 Fees: first \$1000 = \$25 fee + \$11 for every other \$1000 of Cost of work Total Fees : \$ 113.00
Current use (i.e. single family) <u>Restaurant</u> If vacant, what was the previous use? <u>N/A</u> Proposed Specific use: <u>Expansion of restaurant</u> Is property part of a subdivision? <u>NO</u> If yes, please name _____ Project description: Modify existing sprinkler system to cover new floor plan and ceiling on 1st floor		
Who should we contact when the permit is ready: Freedom Fire Protection Att: Bill Wales		
Address: 209 Quaker Ridge Road		
City, State & Zip: Casco, Maine 04015		
E-mail Address: wwales@maine.rr.com or markrad@maine.rr.com		
Telephone: (OFFICE) 207-627-4109 (CELL) 207-318-9992		

Please submit all of the information outlined on the applicable checklist. Failure to do so causes an automatic permit denial.

In order to be sure the City fully understands the full scope of the project, the Planning and Development Department may request additional information prior to the issuance of a permit. For further information or to download copies of this form and other applications visit the Inspections Division on-line at www.portlandmaine.gov, or stop by the Inspections Division office, room 315 City Hall or call 874-8703.

I hereby certify that I am the Owner of record of the named property, or that the owner of record authorizes the proposed work and that I have been authorized by the owner to make this application as his/her authorized agent. I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in this application is issued, I certify that the Code Official's authorized representative shall have the authority to enter all areas covered by this permit at any reasonable hour to enforce the provisions of the codes applicable to this permit.

Chris Hotham Signature: 2014.12.08 08:25:12 -05'00'	Date: 12/8/14
---	----------------------

This is not a permit; you may not commence ANY work until the permit is issued.