


2. PRODUCTS
A. TILE
1) TILE TYPES: AS LISTED ON THE MATERIALS AND FINISH LEGEND.
2) FURNISH TILE MANUFACTURED IN ACCORDANCE WITH ANSI A137.1.
3) SPECIAL SHAPES: UNLESS OTHERWISE INDICATED OR SPECIFIED, FURNISH SPECIAL SHAPES AS STANDARD WITH THE TILE MANUFACTURER FOR UNIFORM TRANSITIONS AND CONCEALED EDGES IN THE FINISHED INSTALLATION. SPECIAL SHAPES INCLUDE BULLNOSES, DOUBLE BULLNOSES, CORNER BULLNOSES, AND COVE ASSEMBLIES.
B. ACCESSORY MATERIALS: AS FOLLOWS, UNLESS OTHERWISE RECOMMENDED BY THE TILE MANUFACTURER:
1) CLEAVAGE MEMBRANE:
A) IN ACCORDANCE WITH ANCI A108.02 - 3.8.
B) ROOFING FELT, REINFORCED ASPHALT PAPER, OR POLYETHYLENE SHEETING.
2) REINFORCING MESH:
A) IN ACCORDANCE WITH ANCI A108.1A.
B) 2" X 2" X 16/16 GAGE WELDED WIRE MESH OR APPROVED.
3) TILE WATERPROOFING MEMBRANE: ONE OF THE FOLLOWING.
A) BOSTIK "HYDROMEM" ULTRA-SET."
B) MAPEI CORP. "PRP 315."
C) LATICRETE INTERNATIONAL "9235."
4) TILE SETTING MATERIALS:
A) THINSET MORTAR: IN ACCORDANCE WITH ANCI A118.4; PORTLAND CEMENT WITH 100 PERCENT ACRYLIC LATEX ADDITIVE
B) THINSET MORTAR: "KERABOND" WITH "UNIVERSAL KERALASTIC" BY MAPEI CORP., "211 CRETE FILLER POWDER" WITH 4237 LATEX THIN-SET MORTAR ADDITIVE, BY LATICRETE INTERNATIONAL, INC., HYDROMENT "TILE-MATE PREMIUM" WITH "447 FLEX-A-LASTIC" BY BOSTIK, OR APPROVED.
C) RAPID SET THIN BED MORTAR: "GRANIRAPID" WITH "KER 318 FLEXIBLE ADMIXTURE" BY MAPEI CORP., HYDROMENT "SINGLE FLEXERS" BY BOSTIK OR "211 CRETE FILLER POWDER" WITH "4237 LATEX THIN-SET MORTAR ADDITIVE" AND "011 RAPID SET LATEX" (PROPORTIONS AS RECOMMENDED BY THE MANUFACTURER FOR THE SETTING TIME REQUIRED), BY LATICRETE INTERNATIONAL, INC.
D) MEDIUM BED MORTAR: "GRANIRAPID" BY MAPEI CORP., HYDROMENT "MEDIUM BED MORTAR" BY BOSTIK, OR "228 THICK BED MORTAR MIX" WITH "3701 LATEX MORTAR ADMIX" BY LATICRETE INTERNATIONAL, INC., OR APPROVED.
E) RAPID SET MEDIUM BED MORTAR: "GRANIRAPID" BY MAPEI CORP., OR "211 CRETE FILLER POWDER" WITH "3701 LATEX MORTAR ADMIX" AND "011 RAPID SET LATEX" (PROPORTIONS AS RECOMMENDED BY THE MANUFACTURER FOR THE SETTING TIME REQUIRED), BY LATICRETE INTERNATIONAL, INC., OR APPROVED.
F) THICK BED MORTAR: NON-PROPRIETARY:
(1) CEMENT: ASTM C150, TYPE I.
(2) HYDRATED LIME: ASTM C206, TYPE S, OR ASTM C207, TYPE S.
(3) SAND: ASTM C144.
(4) WATER: CLEAN AND FREE FROM AMOUNTS OF MATTER DELETERIOUS TO SETTING BED MATERIALS.
(5) PROPORTIONING: IN ACCORDANCE WITH TCNA HANDBOOK
G) ORGANIC ADHESIVES: ANCI A138.1, TYPE I, PROVIDE PRIMER/SEALER AS RECOMMENDED BY THE ADHESIVE MANUFACTURER.
5) CEMENTITIOUS GROUT: ONE OF THE FOLLOWING; COLOR MATCH AS SCHEDULED ON THE DRAWINGS.
A) MAPEI CORP. "ULTRACOLOR PLUS" OR "KERACOLOR S."
B) BOSTIK "HYDROMENT CERAMIC TILE GROUT."
C) LATICRETE INTERNATIONAL, INC. "LATACRETE PERMACOLOR."
6) CEMENTITIOUS UNSANDED GROUT; COLOR MATCH AS SCHEDULED ON THE DRAWINGS.
A) MAPEI CORP. "KERACOLOR U."
B) LATICRETE INTERNATIONAL, INC. "1600 SERIES UNSANDED GROUT" WITH "1776 GROUT ADMIX PLUS."
C) BOSTIK HYDROMENT "CERAMIC TILE GROUT /JOINT FILLER" WITH "425 FLEXIBLE GROUT ADMIXTURE."
7) METAL SCREED: AS MANUFACTURED BY SCHLÜTER SYSTEMS, INC. (800-225-8902), OR CERAMIC TOOL COMPANY, (800-236-5230); CLEAR ANODIZED ALUMINUM TILE EDGING TRIM; SIZES AS REQUIRED FOR INSTALLATION OF TOP OF SCREED FLUSH WITH TOP OF TILE, AS DETAILED.
8) SOLID SURFACING THRESHOLD; AS SCHEDULED ON THE DRAWINGS.
9) SILOXANE TYPE TILE SEALER: MIRACLE SEALANTS "511-H20" BY MIRACLE SEALANTS AND ABRASIVES COMPANY (800-350-1901).

C. SCREED INSTALLATION:
1) INSTALL SCREEDS AT TILE FIELD EDGES AT THE LOCATIONS INDICATED.
2) ACCURATELY CUT TO LENGTH FOR FLUSH TIGHTLY BUTTED JOINTS. PROVIDE MITER CUT ANGLE JOINTS. REMOVE BURRS AT FIELD CUTS.
3) INSTALL IN LONGEST POSSIBLE LENGTHS, EXCEPT THAT NO SCREED SECTION SHALL BE LONGER THAN 12 FEET OR SHORTER THAN 4 FEET IN LENGTH FOR CONTINUOUS RUNS GREATER THAN 16 FEET.
4) INSTALL SCREEDS FREE FROM WAVES AND VARIATIONS IN HEIGHT; FLUSH WITH TOP OF ADJACENT TILE SURFACES.
5) SET SCREEDS DIRECTLY IN SETTING BED AS THE TILE INSTALLATION PROCEEDS. COMPLY WITH SCREED MANUFACTURER'S INSTRUCTIONS TO ACHIEVE MORTAR TIGHTLY COMPACTED BETWEEN SCREED AND TILE EDGE.
6) GRIND SCREED JOINTS AS NECESSARY TO CORRECT MINOR MISALIGNMENT AND TO EASE SHARP OUTSIDE CORNERS.
D. SOLID SURFACING THRESHOLDS:
1) INSTALL AT TILE FIELD EDGE AT DOOR OPENINGS INDICATED.
2) ADHERE SOLID SURFACING THRESHOLDS DIRECTLY TO SOLID WOOD BLOCKING AS DETAILED ON THE DRAWINGS.
3) POSITION SOLID SURFACING THRESHOLD TO MAINTAIN ADA COMPLIANCE FOR DOOR THRESHOLDS.
E. EXPANSION JOINTS:
1) PLACE EXPANSION JOINTS AT CONTROL AND EXPANSION JOINTS IN CONCRETE SLABS, AND AT INTERSECTIONS WITH WALLS AND COLUMNS.
2) JOINT SIZES: SET TO MATCH WIDTH OF TYPICAL GROUTED JOINT; BUT IN NO CASE LESS THAN 1/4". LEAVE EXPANSION JOINTS FREE OF MORTAR.
3) SEALANT MATERIALS AND INSTALLATION ARE SPECIFIED IN SECTION 079200.
F. GROUTING:
1) COMPLY WITH PROVISIONS OF ANCI A108.10.
2) MIX GROUTS IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
3) GROUT ALL JOINTS, EXCEPT EXPANSION JOINTS, IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. FLOAT JOINTS TO A SLIGHTLY CONCAVE PROFILE.
4) REMOVE EXCESS GROUT FROM TILE SURFACES IN ACCORDANCE WITH THE GROUT AND TILE MANUFACTURER'S RECOMMENDATIONS. DO NOT USE EXCESS AMOUNTS OF WATER.
5) PROTECT ADJACENT SURFACES FROM DAMAGE CAUSED BY CLEANING AGENTS. DO NOT USE CLEANERS WHICH WOULD DAMAGE TILE OR GROUT SURFACES.
6) DO NOT GROUT JOINTS INDICATED TO RECEIVE SEALANTS, INCLUDING INSIDE RIGHT ANGLE CORNER JOINTS BETWEEN FLOORS AND WALLS OF COLUMN BASES. GROUT JOINTS PERPENDICULAR TO EXPANSION JOINTS SHALL BE FINISHED FLUSH WITH TILE EDGES.
7) CURED GROUT JOINTS SHALL BE MADE FREE OF EFFLORESCENCE, PRIOR TO SEALING.
G. CURING: CURE INSTALLATION IN ACCORDANCE WITH THE GROUT MANUFACTURER'S RECOMMENDATIONS. PROTECT TILE AND GROUT DURING CURING OPERATIONS.
H. PROTECTION:
1) PROTECT TILE INSTALLATIONS FROM DAMAGE.
2) REPLACE ALL DAMAGED TILES.
I. CLEANING:
1) IN ACCORDANCE WITH SECTION 015000 AND SECTION 017700.
2) COORDINATE FINAL CLEANING WITH WORK OF SECTION 079200. DO NOT BEGIN CLEANING OPERATIONS UNTIL TILE EXPANSION JOINTS SEALANTS ARE FULLY CURED.
3) WASH AND THOROUGHLY RINSE ALL TILE. LEAVE ALL TILE SURFACES CLEAN.
J. TILE SEALING:
1) APPLY STAIN REPELLENT SEALER TO ALL FLOOR TILE AND FLOOR AND WALL TILE GROUT, INCLUDING THOSE WITH PREVIOUS TREATMENTS, IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS TO ACHIEVE MAXIMUM PENETRATION INTO TILE BODY AND GROUTS.
2) APPLY SEALER AT EARLIEST POSSIBLE DATE ALLOWED BY GROUT AND SEALER MANUFACTURER.
3) WIPE TILE SURFACES AFTER APPLICATION AS NECESSARY TO REMOVE ALL VISIBLE SEALER RESIDUE.

3. EXECUTION
A. MOISTURE TESTING OF CONCRETE SLABS: PERFORM MOISTURE TESTS IN ACCORDANCE WITH ASTM F1889 OR F2170 TO DETERMINE THE VAPOR EMISSION RATE FROM CONCRETE FLOORS. NOTIFY THE ARCHITECT OF READINGS IN EXCESS OF 3 LBS PER 1000 SQ. FT. IN A 24 HOUR PERIOD, OR 75% RELATIVE HUMIDITY (RH).
B. PREPARATION:
1) USE LATEX FILLER TO PATCH CRACKS, SMALL HOLES, AND FOR MINOR LEVELING. ENSURE FLOOR SURFACE IS SMOOTH AND FLAT TO PLUS OR MINUS 1/8 INCH/10 FEET.
2) SUBSTRATES SHALL BE SOUND, DRY, SMOOTH, LEVEL, CLEAN, AND FREE OF CRACKS, VOIDS, RIDGES, FOREIGN MATERIALS AND SUBSTANCES.
3) POWER VACUUM UNDERLAYMENT SURFACE IMMEDIATELY PRIOR TO INSTALLATION.
4) AT ALTERNATE B ONLY, INSTALL SLAB WATERPROOFING DIRECT TO SLAB IN ACCORDANCE WITH MANUFACTURER'S DIRECTIONS.
C. INSTALLATION:
1) INSTALL AND FINISH WOOD FLOORING IN ACCORDANCE WITH NWFA STANDARDS AND AS SPECIFIED BELOW.
2) FLOATING SUBFLOOR (AT BASE BID AND ALTERNATE BID 'B' ONLY):
A) AT BASE BID, SET MOISTURE BARRIER IN FULL COVERAGE OF ADHESIVE. LAP SHEETS A MINIMUM OF 6 INCHES AND TAPE.
B) INSTALL FIRST LAYER OF PLYWOOD OVER VAPOR BARRIER OR WATERPROOFING WITH STAGGERED END JOINTS PARALLEL TO DIRECTION OF FINISHED FLOORING.
C) SPACE ADJOINING SHEETS 1/8" APART. SPACE 3/4" FROM WALLS AND ALL VERTICAL OBSTRUCTIONS.
D) LAY SECOND LAYER AT 90 DEGREES TO FIRST LAYER WITH STAGGERED END JOINTS. OFFSET SEAMS BETWEEN FIRST AND SECOND LAYER.
E) ATTACH LAYERS OF PLYWOOD TOGETHER AT 12" O. C. WITH STAPLES OR SCREWS. DO NOT PENETRATE VAPOR BARRIER.
3) PLYWOOD UNDERLAYMENT (AT ALTERNATE BID A):
A) ACCURATELY CUT AND LOOSE LAY PLYWOOD UNDERLAYMENT OVER MOISTURE BARRIER.
B) LAY WITH LONG DIMENSION OF PLYWOOD PARALLEL TO LONG DIMENSION OF FLOORING FIELD, END JOINTS STAGGERED.
C) LEAVE 1/4 INCH TO 1/2 INCH GAP BETWEEN PANELS; LEAVE 3/8 INCH GAP AT CASEWORK AND AT LINE OF ADJOINING TILE EDGE; LEAVE 3/4 INCH GAP AT WALLS.
D) WHEN ALL UNDERLAYMENT PANELS ARE IN PLACE, FASTEN TO CONCRETE SLAB WITH POWDER ACTUATED FASTENERS. FASTEN CENTER OF UNDERLAYMENT PANEL FIRST, THEN WORK TOWARDS EDGES. SPACE FASTENERS UNIFORMLY OVER THE SHEET, USING A MINIMUM OF 12 FASTENERS PER 4 X 8 SHEET.
4) FLOORING INSTALLATION:
A) INSTALL FINISH FLOORING OVER UNDERLAYMENT WITH NAILS IN STRICT COMPLIANCE WITH MANUFACTURER'S INSTRUCTIONS AND NWFA SPECIFICATIONS.
B) PATTERN: LAY FLOORING IN WITH STRIPS ARRANGED AS INDICATED ON THE DRAWINGS. LAY FLOORING SYMMETRICAL ABOUT ROOM CENTER LINE. FIT NEATLY TO VERTICAL INTERRUPTIONS.
C) TONGUE AND GROOVE MATCH OR SPLINE SIDE TO END JOINTS.
D. FINISHING:
1) SANDING:
A) PROVIDE LOCAL LIGHT MACHINE SANDING USING FINE GRIT ONLY TO REMOVE CONSTRUCTION MARKS AND OFFSETS, WITHOUT REMOVING FACTORY TEXTURES AND "DEFECTS". HAND SAND TO REMOVE SANDER MARKS AND BLEND TO SURROUNDING FINISH.
B) TAKE PRECAUTIONS TO CONTAIN DUST CAUSED BY SANDING OPERATIONS. POWER VACUUM CLEAN.
C) ALLOW NO TRAFFIC ON FLOOR UNTIL FINISHING IS COMPLETE, OR, COVER SANDED FLOOR WITH PROTECTIVE PAPER IF THERE ARE TO BE DELAYS IN FINISHING.
2) TRANSPARENT FINISH:
A) APPLY ONE COAT OF TRANSPARENT SEALER IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND AS SPECIFIED BELOW.
B) ABRABE THE CURED SEALER COAT WITH CONDITIONING PAD.
C) VACUUM AND TACK THOROUGHLY AFTER ABRADING.
D) APPLY THREE COATS OF TRANSPARENT FINISH IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND AS SPECIFIED BELOW.
E) APPLY SECOND AND THIRD COAT BY ALLOWING PREVIOUS COAT TO DRY THEN BUFF WITH CONDITIONING PAD TO REMOVE IRREGULARITIES.
F) APPLY WOOD FILLER TO ALL HOLES LARGER THAN 3/8 INCH DIAMETER PRIOR TO FINAL COAT OR FINISH.
G) REMOVE DUST BY VACUUM AND DAMP CLOTH IMMEDIATELY BEFORE APPLYING EACH COAT.
3) PROTECTION: PROVIDE AND MAINTAIN AS REQUIRED, PROTECTION OF FINISHED HARDWOOD FLOORING DURING REMAINDER OF CONSTRUCTION PERIOD TO PREVENT DAMAGE OR DETERIORATION TO FLOORING AND FINISH PRIOR TO TIME OF FINAL ACCEPTANCE.

B. PREPARATION
1) CLEAN FLOORS OF DUST, DIRT, AND OTHER SUBSTANCES WHICH WOULD BE DETRIMENTAL TO THE PROPER PERFORMANCE OF ADHESIVE AND CARPET.
2) INSTALL SUBFLOOR FILLER TO FILL LOW SPOTS, CRACKS, CONSTRUCTION JOINTS, HOLES AND OTHER DEFECTS; AND AS REQUIRED TO ADJUST LEVEL TO MEET ADJACENT FINISHES. FEATHER TO MAXIMUM SLOPE OF 1/8 INCH IN 1 FOOT; FLOAT TO SMOOTH, FLAT, HARD SURFACE. PROHIBIT TRAFFIC OVER FILLER.
C. INSTALLATION
1) CARPET INSTALLATION SHALL BE TIGHT AND FLAT TO THE SUBFLOOR, SECURELY BONDED IN POSITION, AND SHALL PRESENT A UNIFORM APPEARANCE. PROVIDE COLOR, PATTERN, AND TEXTURE MATCH WITHIN EACH AREA. SEAMS SHALL BE STRONG, TIGHTLY BUTTED, AND FLAT.
2) INSTALL CARPETS IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
3) CARPET SHALL BE GLUE MOUNTED.
4) VERIFY MATCHING OF CARPET PRIOR TO CUTTING AND ENSURE THAT THERE IS NO VISIBLE VARIATION BETWEEN DYE LOTS.
5) CUT CARPET, WHERE REQUIRED IN A MANNER TO ALLOW PROPER SEAM AND PATTERN MATCH. ENSURE CUTS ARE STRAIGHT AND TRUE AND UNFRAYED.
6) MAKE SEAMS STRAIGHT AND UNIFORM.
7) SEAMING SHALL BE BY HAND SEWING OR WITH HOT MELT TAPE METHODS.
8) DO NOT CHANGE RUN OF PILE IN ANY ONE ROOM.
9) ENSURE MONOLITHIC COLOR, PATTERN AND TEXTURE MATCH WITHIN EACH DISTINCT ROOM.
10) INSTALL EDGING STRIPS WHERE CARPET TERMINATES AT OTHER FLOOR COVERINGS. USE FULL LENGTH PIECES ONLY. BUTT TIGHT TO VERTICAL SURFACES. WHERE SPLICING CANNOT BE AVOIDED, BUTT ENDS TIGHT, FLUSH, AND ACCURATELY ALIGNED.
D. REMAINERS: UPON COMPLETION OF THE INSTALLATION, CONTACT THE ARCHITECT FOR SELECTION OF CARPET REMAINING AFTER TRIMMING. CAREFULLY WRAP AND MARK SEPARATELY THE SELECTED REMAINERS. REMOVE AND DISPOSE OF REMAINDER AT A LEGAL OFF-SITE LOCATION. DELIVER TO A LOCATION ON SITE AS DIRECTED. REMOVE AND DISPOSE OF REMAINDER.
E. CLEANUP:
1) THE PREMISES SHALL BE KEPT FREE FROM UNNECESSARY ACCUMULATION OF TOOLS, EQUIPMENT AND SURPLUS MATERIALS DURING THE PROGRESS OF THE WORK.
2) REMOVE THREADS WITH SHARP SCISSORS. REMOVE SPOTS WITH MANUFACTURER'S RECOMMENDED SPOT REMOVER.
3) THOROUGHLY POWER VACUUM ENTIRE SURFACE USING EQUIPMENT WITH MOTOR DRIVEN BRUSHES.
4) PROTECT CARPET FROM DAMAGE DURING REMAINDER OF CONSTRUCTION AND MOVE-IN PERIOD.

097733 - FRP WALL PANELS
1. GENERAL
A. SECTION INCLUDES: FIBERGLASS REINFORCED POLYESTER (FRP) WALL PANEL SYSTEM.
2. PRODUCTS
A. APPROVED MANUFACTURERS:
1) CRANE KEMLITE, JOLIET, IL.
2) LASCOPANEL PRODUCTS, FLORENCE, KY.
3) MARLITE, DOVER, OH.
B. MATERIALS:
1) FIBERGLASS REINFORCED POLYESTER PANEL:
A) DESCRIPTION: COMPOSITE PANEL CONSISTING OF UNIFORM FIBERGLASS GLASS FIBERS EMBEDDED IN ORGANIC RESIN, AND CURED UNDER HEAT AND PRESSURE.
B) FIRE RATING: CLASS A FIRE RATING.
C) THICKNESS: 0.09 INCH.
D) COLOR: MANUFACTURER'S STANDARD "WHITE."
E) TEXTURE: EMBOSSED TEXTURE.
2) ADHESIVE: LOW VOC ADHESIVE AS RECOMMENDED BY THE PANEL MANUFACTURER FOR THE SUBSTRATE INDICATED.
3) SEALANT: MANUFACTURER'S STANDARD SILICONE SEALANT; USDA APPROVED INSTALLATION.
4) TRIM MOLDS: MANUFACTURER'S STANDARD; COLOR TO MATCH PANELS.
3. EXECUTION
A. PREPARATION: COORDINATE INSTALLATION WITH THE INSTALLERS OF ADJACENT AND INTEGRAL CONSTRUCTION TO ALLOW FOR INSTALLATION OF FRP PANELS PRIOR TO THE INSTALLATION OF ESCUTCHEONS, COVER PLATES, LOUVER FLANGES, AND OTHER COMPONENTS TO BE INSTALLED OVER OR THROUGH FRP PANELS.
B. INSTALLATION:
1) ADHESIVELY BOND PANELS IN ACCORDANCE WITH THE PANEL MANUFACTURER'S RECOMMENDATIONS.
2) ACCURATELY CUT AND FIT PANELS AROUND OBSTRUCTIONS; SCRIBE FIT AT EDGES. ALLOW SUFFICIENT SPACE TO SEAL JOINTS WITH SEALANT.
3) DO NOT INSTALL PANELS WITH EDGE OR SURFACE DAMAGE. REPLACE WITH NEW UNDAMAGED MATERIAL. ALL PANELS WHICH BECOME CHIPPED OR DAMAGED PRIOR TO FINAL ACCEPTANCE.
4) PROVIDE J MOLDING AT ALL EXPOSED EDGES. PROVIDE H MOLDING AT ALL RIGHT BUTT JOINTS. H MOLDINGS SHALL NOT BE RUN BEHIND BASE FINISH MATERIAL. PROVIDE TRIM MOLDS AT INSIDE AND OUTSIDE CORNERS.
5) SEAL ALL JOINTS BETWEEN PANELS AND MOLDS, AND BETWEEN FRP SYSTEM AND ADJACENT CONSTRUCTION.
6) OMIT FRP PANEL BEHIND ADHESIVELY MOUNTED CORNER GUARDS.

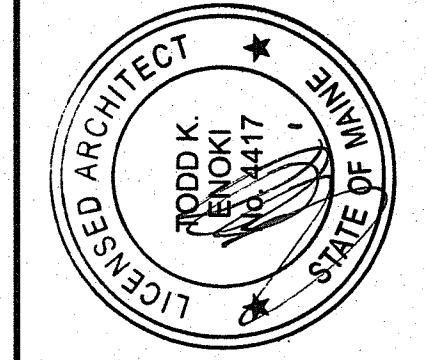

CALLISONRTKL™
A DESIGN CONSULTANCY OF ARCADIS
CALLISONRTKL, INC.
www.callisonrtkl.com

west elm
Downtown Portland
164 Middle Street
Portland, ME 04101
PROJECT #006-160335.00

Table with 3 columns: ISSUED / REVISED, PRELIMINARY SET, LL COORDINATION SET, LL/PERMIT SET. Dates: 09/08/16, 11/08/16, 11/17/16.

098100 - ACOUSTIC INSULATION
1. GENERAL
A. SECTION INCLUDES: BATT INSULATION INSTALLED IN STUD FRAMED GYPSUM BOARD WALL CAVITIES.
2. PRODUCTS
A. ACOUSTIC INSULATION: ASTM C865, TYPE I; UNFACED GLASS OR MINERAL FIBER BATTS, BLANKETS, OR ROLLS; MINIMUM FIRE HAZARD CLASSIFICATION RATING OF 25/50 PER ASTM E84; MINIMUM 3-INCH THICK, UNLESS REQUIRED OTHERWISE TO MEET THE STC REQUIREMENTS INDICATED OR SPECIFIED; WIDTHS TO FRICTION-FIT BETWEEN STUDS, WHERE INDICATED FOR INSTALLATION IN STUD WALLS.
B. ACOUSTICAL SEALANT: NON-HARDENING, NON-SKINNING, FOR USE IN CONJUNCTION WITH GYPSUM BOARD, SIMILAR TO USG "ACOUSTICAL SEALANT."
C. SPRAYED FOAM: DOWN CORNING "FIRE STOP 2001" SILICON FOAM" OR APPROVED.
D. ACCESSORIES: FURNISH OTHER ACCESSORIES SUCH AS FASTENERS AND RETAINERS, NOT SPECIFICALLY DESCRIBED, BUT REQUIRED FOR A COMPLETE INSTALLATION.
3. INSTALLATION:
A. INSTALL INSULATION IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS, AND AS INDICATED.
B. INSTALL INSULATION WITHOUT GAPS OR VOIDS.
C. TRIM INSULATION NEATLY TO FIT SPACES. USE INSULATION MATERIALS FREE OF DAMAGE.
D. SEALANT:
1) INSTALL ACOUSTICAL SEALANT AROUND PERIMETER OF ALL ACOUSTICALLY INSULATED PARTITIONS; ONE CONTINUOUS BEAD AT EACH SIDE OF FRAMING MEMBER INTERFACE WITH SUBSTRATE.
2) SEAL ALL PENETRATIONS THROUGH ACOUSTICAL ASSEMBLIES, EXCEPT FOR PENETRATIONS IN FIRE RATED CONSTRUCTION TO RECEIVE FIRESTOPPING.
E. PROVIDE SPRAYED FOAM TO SEAL THE FLUTE OPENINGS WHERE ACOUSTICAL PARTITIONS ARE INSTALLED TIGHT TO METAL DECK ASSEMBLIES.

099000 - PAINTING
1. GENERAL
A. SECTION INCLUDES: FIELD APPLIED PAINT SYSTEMS.
B. SUBMITTALS:
1) MATERIALS LIST:
A) SUBMIT A TYPEWRITTEN LIST OF MATERIALS PROPOSED. ORGANIZE LIST TO INDICATE PAINTING SYSTEMS TO BE USED ON EACH SUBSTRATE. INCLUDE MANUFACTURER'S SPECIFICATIONS AND OTHER DATA AS REQUIRED TO VERIFY COMPLIANCE WITH THE SPECIFIED REQUIREMENTS.
B) PROVIDE WRITTEN CERTIFICATION STATING THAT THE COATINGS SUBMITTED ARE THE PAINT SYSTEM MANUFACTURER'S HIGHEST GRADE PRODUCTS OF THE TYPES APPLICABLE TO THE WORK OF THIS SECTION.
2) SAMPLES: 3 SAMPLES OF EACH PROPOSED PAINT FINISH ON AN 8"X10" CARD, REFERENCE MANUFACTURER, TYPE OF PAINT, COLOR, SHEEN, SUBSTRATE, AND APPLICATION.

SPECIFICATIONS
A-905

OWNER: WILLIAMS-SONOMA, INC.
3250 Van Ness Avenue
San Francisco, CA 94109
T 415 616 8602
F 415 439 8164
www.williams-sonoma.com