


F
E
D
C
B
A

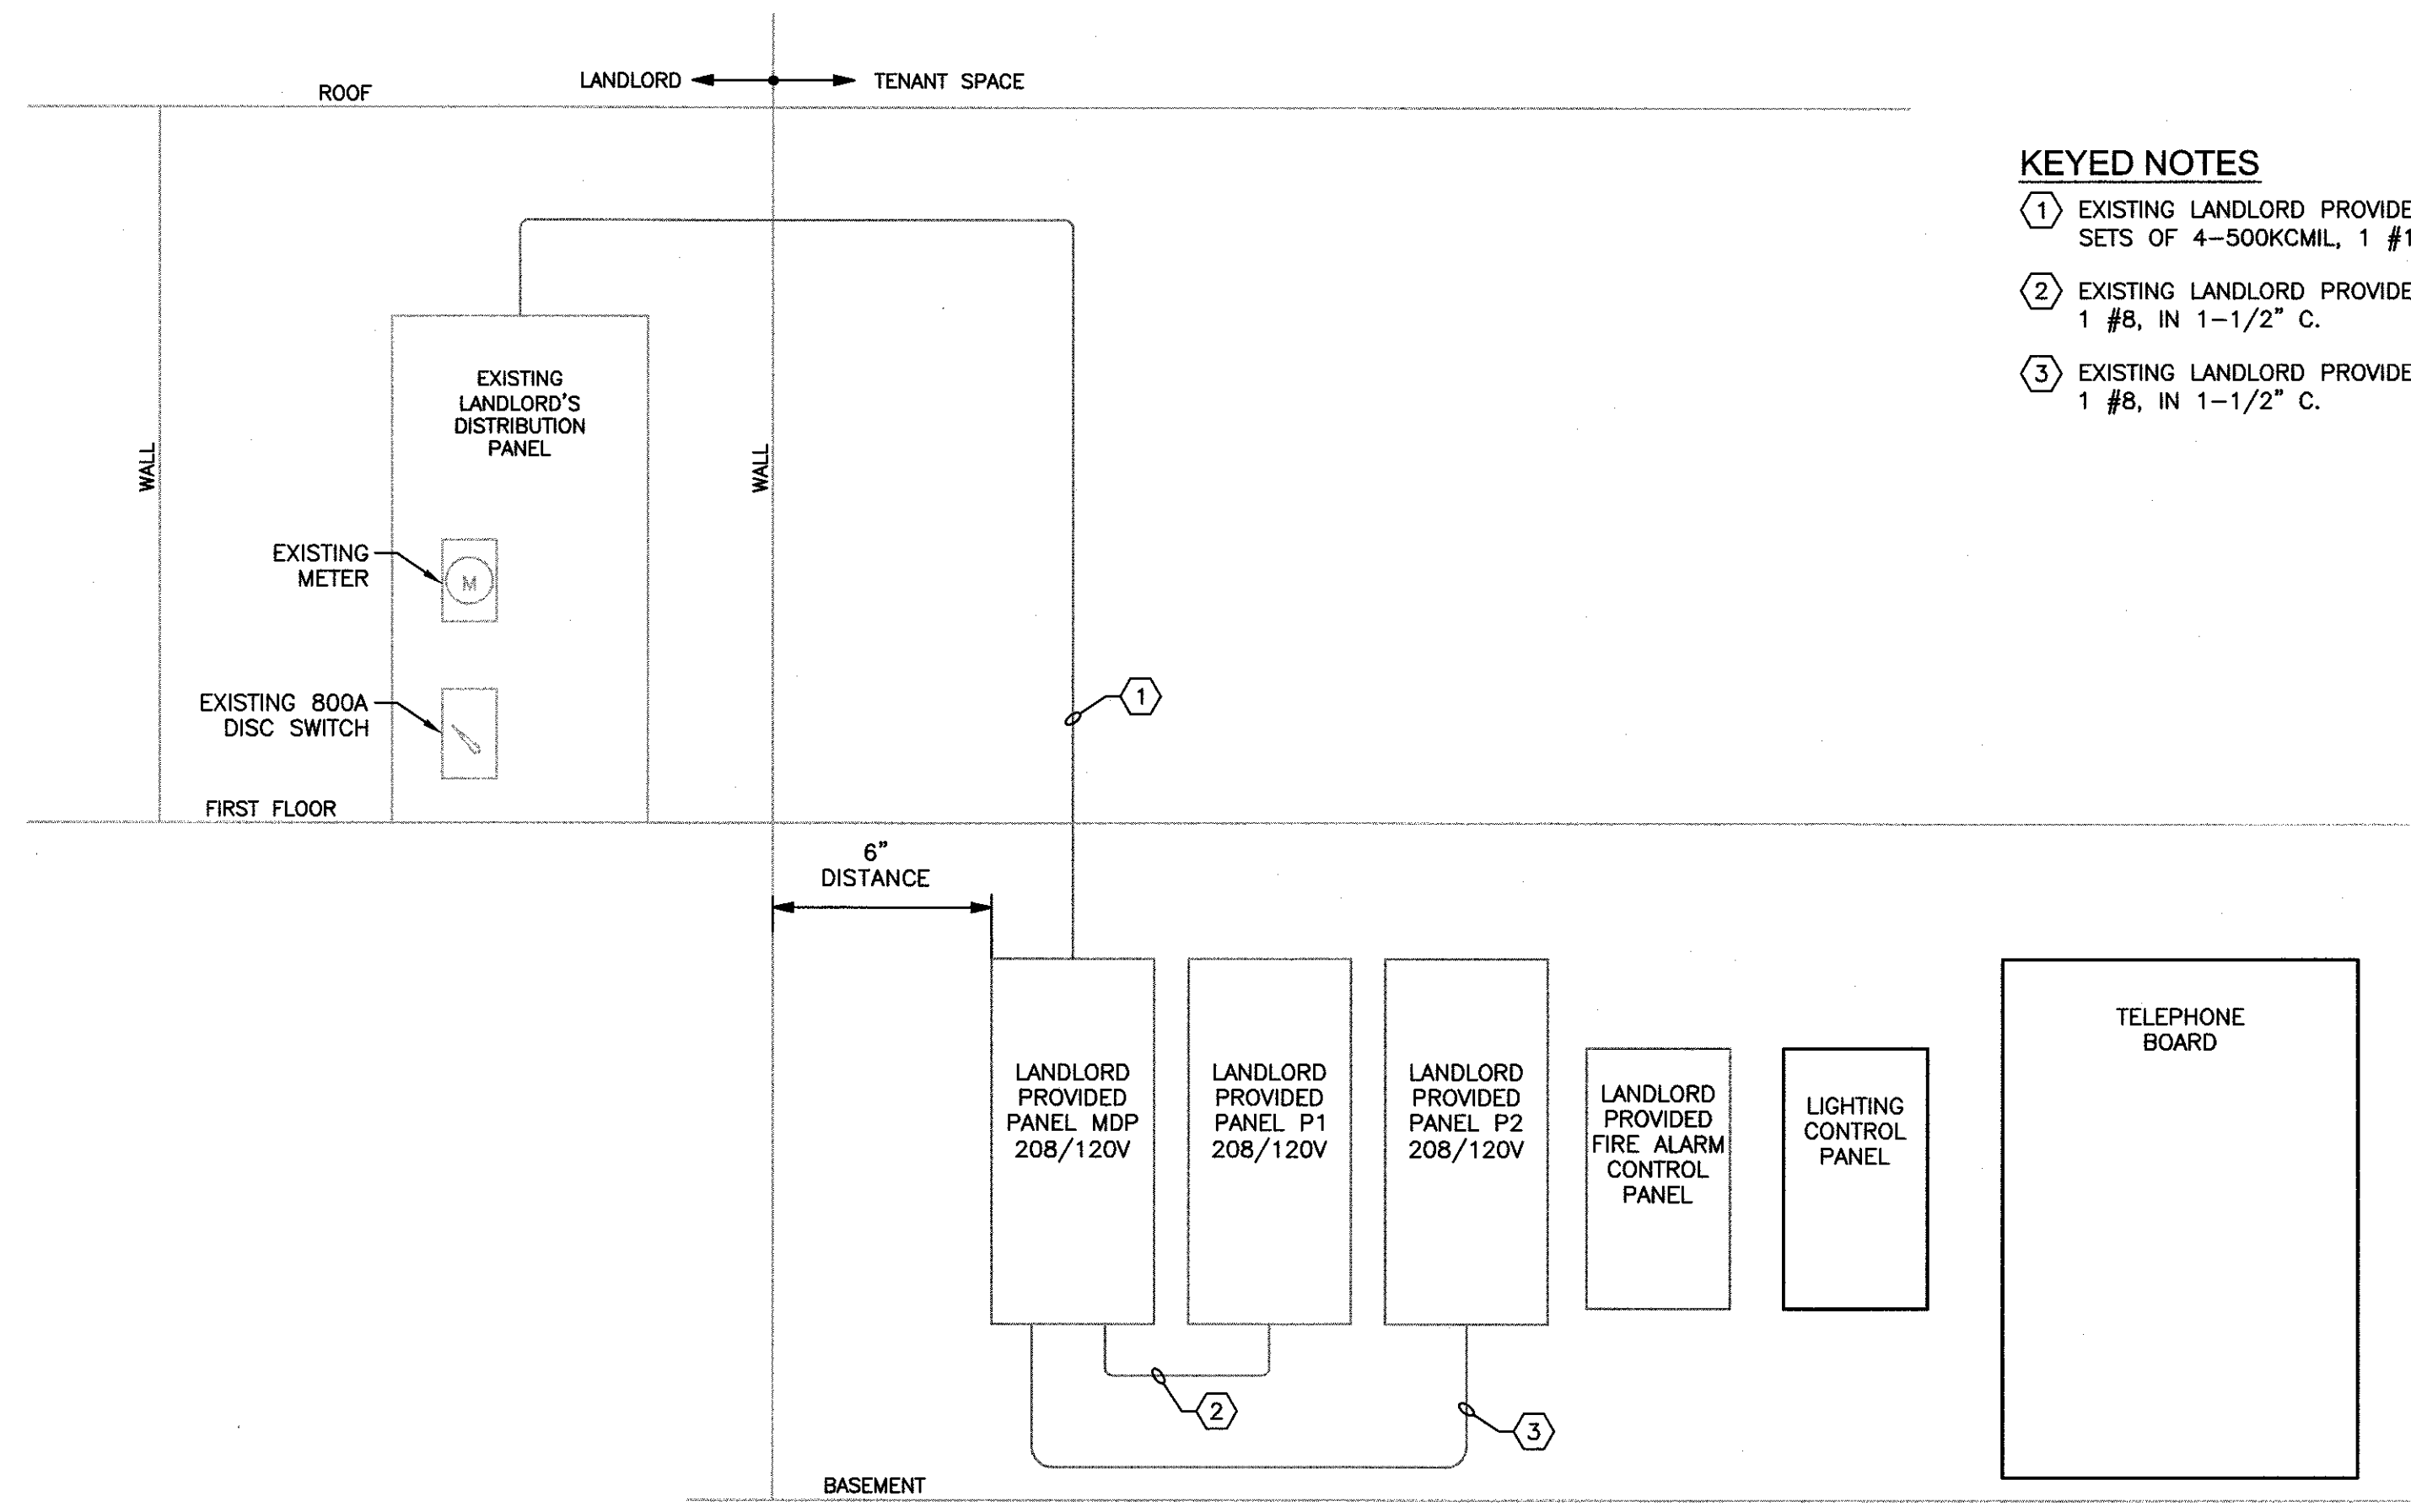

- KEYED NOTES**
- ① EXISTING LANDLORD PROVIDED AND INSTALLED (2) SETS OF 4-500KCMIL, 1 #1/0 GND., IN (2) 3" C.
 - ② EXISTING LANDLORD PROVIDED AND INSTALLED 4 #1, 1 #8, IN 1-1/2" C.
 - ③ EXISTING LANDLORD PROVIDED AND INSTALLED 4 #1, 1 #8, IN 1-1/2" C.

ELECTRICAL RISER DIAGRAM

1
NOT TO SCALE

ELECTRICAL LOAD SUMMARY						
DESCRIPTION	ACTUAL CONNECTED KVA	DEMAND FACTOR	ACTUAL DEMAND KVA	N.E.C. CONNECTED KVA	N.E.C. DEMAND FACTOR	N.E.C. DEMAND KVA
TRACK LIGHTING	11	1.25	13.8	160 ****	1.25	24
GENERAL LIGHTING	5.94	1.25	7.43	5.94	1.25	7.43
SHOW WINDOW LIGHTING ALLOW.	---	***	---	0 FT 0 KVA	200W/LF	0
GEN. PURPOSE RECEPTACLE	23.2	1.0 < 10KVA 0.5 > 10KVA	16.6	23.2	1.0 < 10KVA 0.5 > 10KVA	16.6
MOTOR(S) (208V)	31.4	1.0 + 25% LARGEST	31.4	31.4	1.0 + 25% LARGEST	31.4
FIXED ELECTRIC SPACE HTG. (208V)	23.5 *	1.0	23.5 *	23.5 *	1.0	23.5 *
AIR CONDITIONING EQUIPMENT (208V)	68.1 *	1.0 + 25% LARGEST **	68.1 *	68.1 *	1.0 + 25% LARGEST **	68.1 *
ELECTRIC WATER HEATER	1.5	1.25	1.88	1.5	1.25	1.88
MISCELLANEOUS LOADS	7	1.0	7	7	1.0	7
TOTAL	148		146	156		156

NOTES: * USE GREATER VALUE OF THE TWO CATEGORIES WHERE LOADS ARE NON-CONCURRENT.
 ** 125% OF LARGEST COMPRESSOR MOTOR IN SYSTEM. APPLIES TO ONLY ONE UNIT.
 *** ACTUAL SHOW WINDOW LIGHTING IS INCLUDED IN TRACK AND GENERAL LIGHTING SECTIONS.
 **** TOTAL SUM OF CURRENT LIMITERS IN AMPS

MINIMUM FEEDER = $156 \text{ KVA} \times 1000 = 434 \text{ A}$
 AMPACITY 208×1.73

ELECTRICAL SERVICE AMPACITY = 800 A @ 208V, 3 PH

OWNER:
WILLIAMS-SONOMA, INC.
 3250 Van Ness Avenue
 San Francisco, CA 94109
 T 415 616 8602
 F 415 439 8164
 www.williams-sonoma.com

EEA
 EEA Consulting Engineers
 6515 Vaughn Ranch Road, Suite 200
 Austin, Texas 78739-2514 USA
 512.744.4400 main 512.744.4444 fax
 www.eeace.com

State of Registration MAINE
 Firm Registration No. N/A
 EEA Project No. 20166538

Michael N. Hart
 No. 10507
 LICENSED PROFESSIONAL ENGINEER

west elm
 Downtown Portland
 164 Middle Street
 Portland, ME 04101
 PROJECT #006-160335.00

ISSUED / REVISED	DATE
PRELIMINARY SET	09/08/16
LL COORDINATION SET	11/08/16
LL/PERMIT SET	11/21/16

ELECTRICAL RISER DIAGRAM

E-401