

POWER KEYED NOTES

- ① - ⑤ NOT USED.
- ⑥ DESIGN LAB STATION. CONCEAL RECEPTACLES AND ASSOCIATED CONDUIT AND CABLING WITHIN CASEWORK. COORDINATE RECEPTACLE LOCATIONS WITH CASEWORK SHOP DRAWINGS AND WITH DETAILS.
- ⑦ GENERAL PURPOSE DUPLEX RECEPTACLE MOUNTED AT 18" A.F.F..
- ⑧ JUNCTION BOXES FOR CONDUIT FROM DESIGN LAB DESK AND PRINTER STATION. SEE CONDUIT DETAIL ON SHEET E-202 FOR SIZES.
- ⑨ NOT USED.
- ⑩ AIPHONE WALL MOUNT INTERCOM AT 48" A.F.F.
- ⑪ PROVIDE SURFACE-MOUNTED RECEPTACLE ABOVE TOP WINDOW MULLION, MAXIMUM 18" ABOVE TOP MULLION.
- ⑫ PROVIDE FLUSH FLOOR BOX, LEGRAND EVOLUTION PRODUCTS, #6ATCPNK (COORDINATE COVERPLATE COLOR WITH ARCHITECT), AND NEMA 5-20R RECEPTACLE. SEE ARCHITECTURAL PLANS FOR EXACT LOCATIONS. THE FLOOR BOX COVERS SHOULD ALL BE OPENING IN THE SAME DIRECTION.
- ⑬ FOR DEVICE SHOWN, RUN 1/2" CONDUIT IN FLOOR UNDERLAYMENT SPACE. DO NOT RUN CONDUIT PARALLEL WITH WOOD FLOORING, COORDINATE CONDUIT ROUTING WITH FLOORING CONTRACTOR AND ARCHITECT PRIOR TO LAYOUT TO ACCOMMODATE CONDUIT CUT-OUTS IN PLYWOOD. SEE SPECIFICATION SECTION 3.02.B.5.
- ⑭ CONDUIT UNDER FLOOR SLAB.
- ⑮ PROVIDE A 20A, 1P MOTOR RATED SWITCH FOR WATER HEATER.
- ⑯ MOUNT 35" A.F.F. TO BOTTOM OF HAND DRYER. COORDINATE EXACT LOCATION WITH ARCHITECTURAL ELEVATIONS PRIOR TO ROUGH-IN.
- ⑰ NOT USED.
- ⑱ FIRE ALARM DEVICE.
- ⑲ - ⑳ NOT USED.
- ㉑ CHIME MOUNTED AT 96" A.F.F.
- ㉒ J-BOX FOR MOTORIZED DAMPER. COORDINATE WITH MECHANICAL CONTRACTOR FOR EXACT LOCATION.
- ㉓ J-BOX FOR SECURITY KEYPAD. COORDINATE EXACT LOCATION WITH G.C. PRIOR TO ROUGH-IN.
- ㉔ NOT USED.
- ㉕ SOUND SYSTEM EQUIPMENT CABINET. REFER TO DETAIL FOR ADDITIONAL REQUIREMENTS INCLUDING LV CONDUIT.
- ㉖ NOT USED.
- ㉗ HVAC SENSOR LOCATIONS.
- ㉘ T-STAT LOCATIONS. COORDINATE PLACEMENT WITH ARCHITECT. REFER TO SHEET M-112 FOR T-STAT NUMBERS.
- ㉙ BURGLAR ALARM KEYPAD AT 44" A.F.F.
- ㉚ BURGLAR ALARM SOUNDER AT 96" A.F.F.
- ㉛ PROVIDE FLUSH FLOOR BOX, COMMERCIAL ROLL FORMED PRODUCTS 2000, #C2606-25-U (BOX) WITH #2606-A-SS STAINLESS STEEL COVERPLATE AND (2) NEMA 5-20R RECEPTACLES. SEE ARCHITECTURAL PLANS FOR EXACT LOCATIONS.
- ㉜ PROVIDE (2) FLUSH FLOOR BOXES, COMMERCIAL ROLL FORMED PRODUCTS 2000, #C2606-25-U (BOX) WITH #2606-A-SS STAINLESS STEEL COVERPLATE, (1) TELEPHONE OUTLET AND (3) DATA OUTLETS. SEE ARCHITECTURAL PLANS FOR EXACT LOCATIONS.
- ㉝ - ㉞ NOT USED.
- ㉟ EXISTING LANDLORD INSTALLED GFI WP RECEPTACLE AND DISCONNECT AT UNIT.

POWER GENERAL NOTES


- A. ▽ (1) PROVIDE AND INSTALL RACEWAY AND BOX FOR LV SYSTEMS.
- B. REFER TO MECHANICAL PLAN SET FOR MECHANICAL EQUIPMENT INFORMATION.
- C. REFER TO LIGHTING CONTROL PANEL SCHEDULE ON SHEET E-003 FOR CONTROLLED RECEPTACLE CIRCUITS.
- D. REMOVE ALL EXISTING ELECTRICAL EQUIPMENT NOT SHOWN ON ELECTRICAL PLANS REMOVE ALL CONDUIT AND CONDUCTOR PACK TO PANEL.

ALL ABANDONED AND/OR UNUSED COMPONENTS CREATED OR EXPOSED DURING CONSTRUCTION, INCLUDING BUT NOT LIMITED TO HVAC, CABLES, PIPING, WIRING, AND ASSOCIATED SUPPORTS AND/OR ATTACHMENTS SHALL BE REMOVED.

THE FIRE ALARM PLANS ARE A DEFERRED SUBMITTAL AND WILL BE SUBMITTED BY A LICENSED FIRE ALARM CONTRACTOR SUBMITTED BY THE GENERAL CONTRACTOR.

COORDINATE EXACT LOCATION OF FLOOR BOXES WITH ARCHITECTURAL DRAWINGS PRIOR TO ROUGH-IN.

FIRE ALARM SYSTEM SHOWN ON ELECTRICAL DRAWINGS ARE FOR SCHEMATIC AND BIDDING PURPOSES ONLY. FIRE ALARM SYSTEM CONTRACTOR SHALL SUBMIT FIRE DRAWINGS, EQUIPMENT CUT SHEETS, ETC... PER LOCAL CODE AND NFPA72 TO LOCAL AUTHORITIES HAVING JURISDICTION AND OWNER'S INSURANCE COMPANY FOR APPROVAL PRIOR TO ORDERING EQUIPMENT. ENGINEER WILL NOT APPROVE FIRE ALARM DRAWINGS, EQUIPMENT CUT SHEETS, ETC. INCLUDE IN BID ALL COSTS FOR PERMITS AND FEES. ALL PANELS AND PERIPHERAL DEVICES SHALL BE STANDARD PRODUCT OF SINGLE MANUFACTURER AND SHALL DISPLAY THE MANUFACTURER'S NAME ON EACH COMPONENT. ACCEPTABLE MODELS (UNLESS LANDLORD REQUIRES DIFFERENT): SILENT KNIGHT 5204 OR 5207, ADEMCO 100, FIRELITE 9200 SERIES.

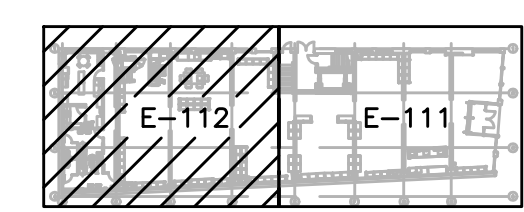

KEYPLAN
N.T.S.



SCALE: 1/4" = 1'-0" @ FULL SIZE

PARTIAL POWER PLAN

OWNER:
WILLIAMS-SONOMA, INC.
3250 Van Ness Avenue
San Francisco, CA 94109
T 415 616 8602
F 415 439 8164
www.williams-sonoma.com



EEA Consulting Engineers
6615 Yaught Ranch Road, Suite 200
Austin, Texas 78730-2314 USA
512.744.4400 main 512.744.4444 fax
www.eea.com

State of Registration: MAINE
Firm Registration No. N/A
EEA Project No. 20166538

DRAWN BY: BMW
CHECKED BY: SMR

west elm
Downtown Portland
164 Middle Street
Portland, ME 04101
PROJECT #006-160335-00

ISSUED / REVISED	DATE
PRELIMINARY SET	09/08/16
LL COORDINATION SET	11/08/16
LL/PERMIT SET	11/21/16

PARTIAL POWER PLAN

E-112