



CONDUIT RISER DIAGRAM

1
NOT TO SCALE

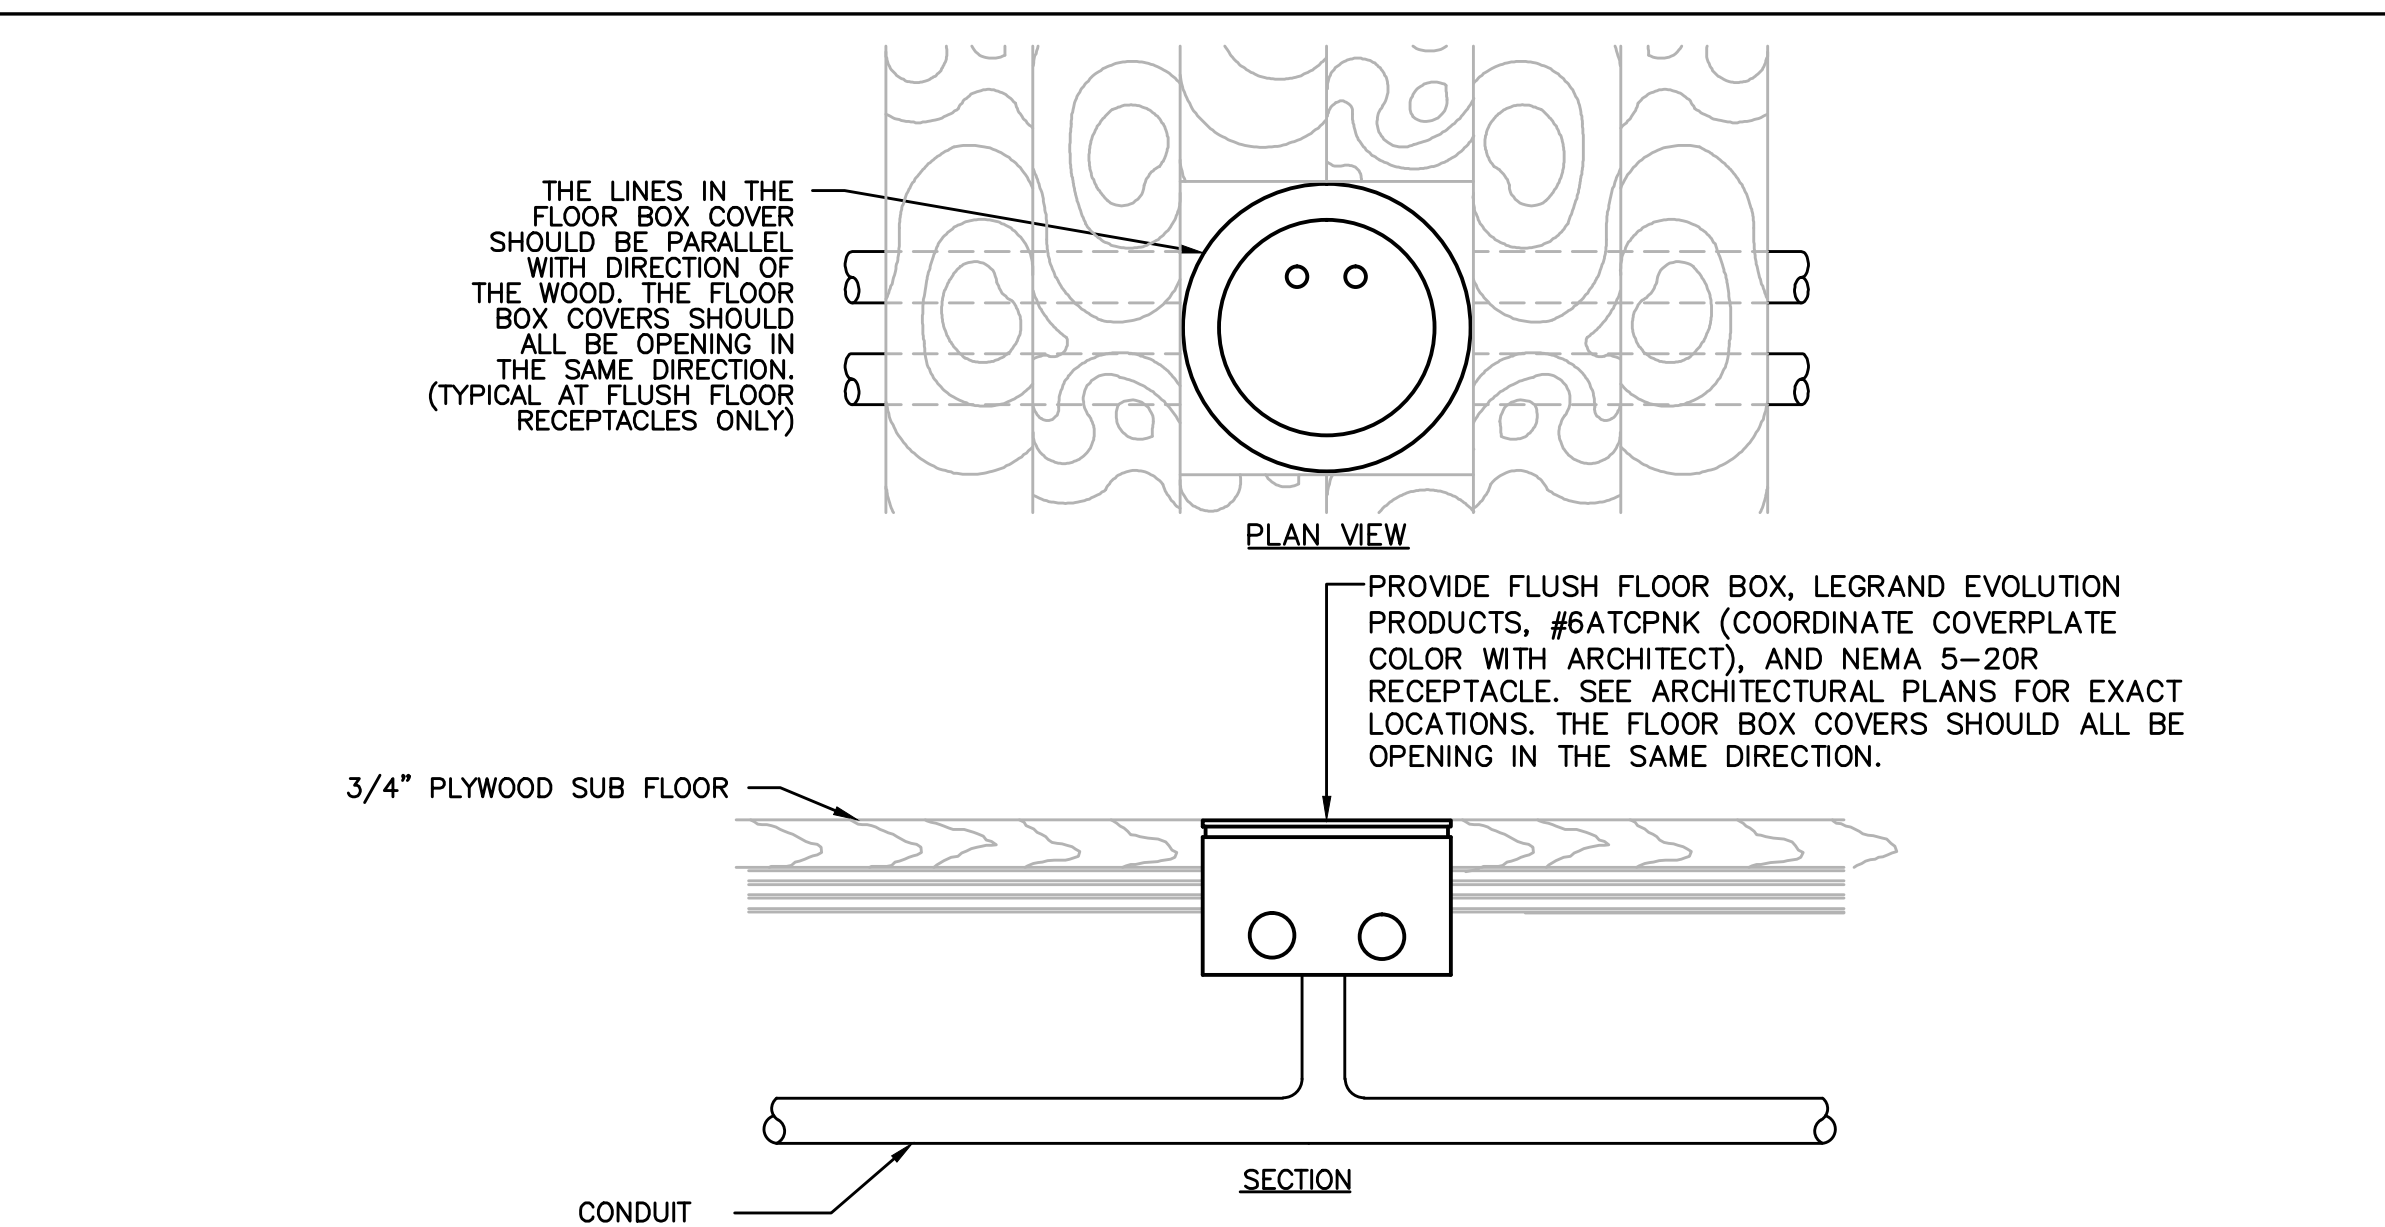


TYPICAL FLOOR BOX AND CONDUIT DETAIL

5
NOT TO SCALE

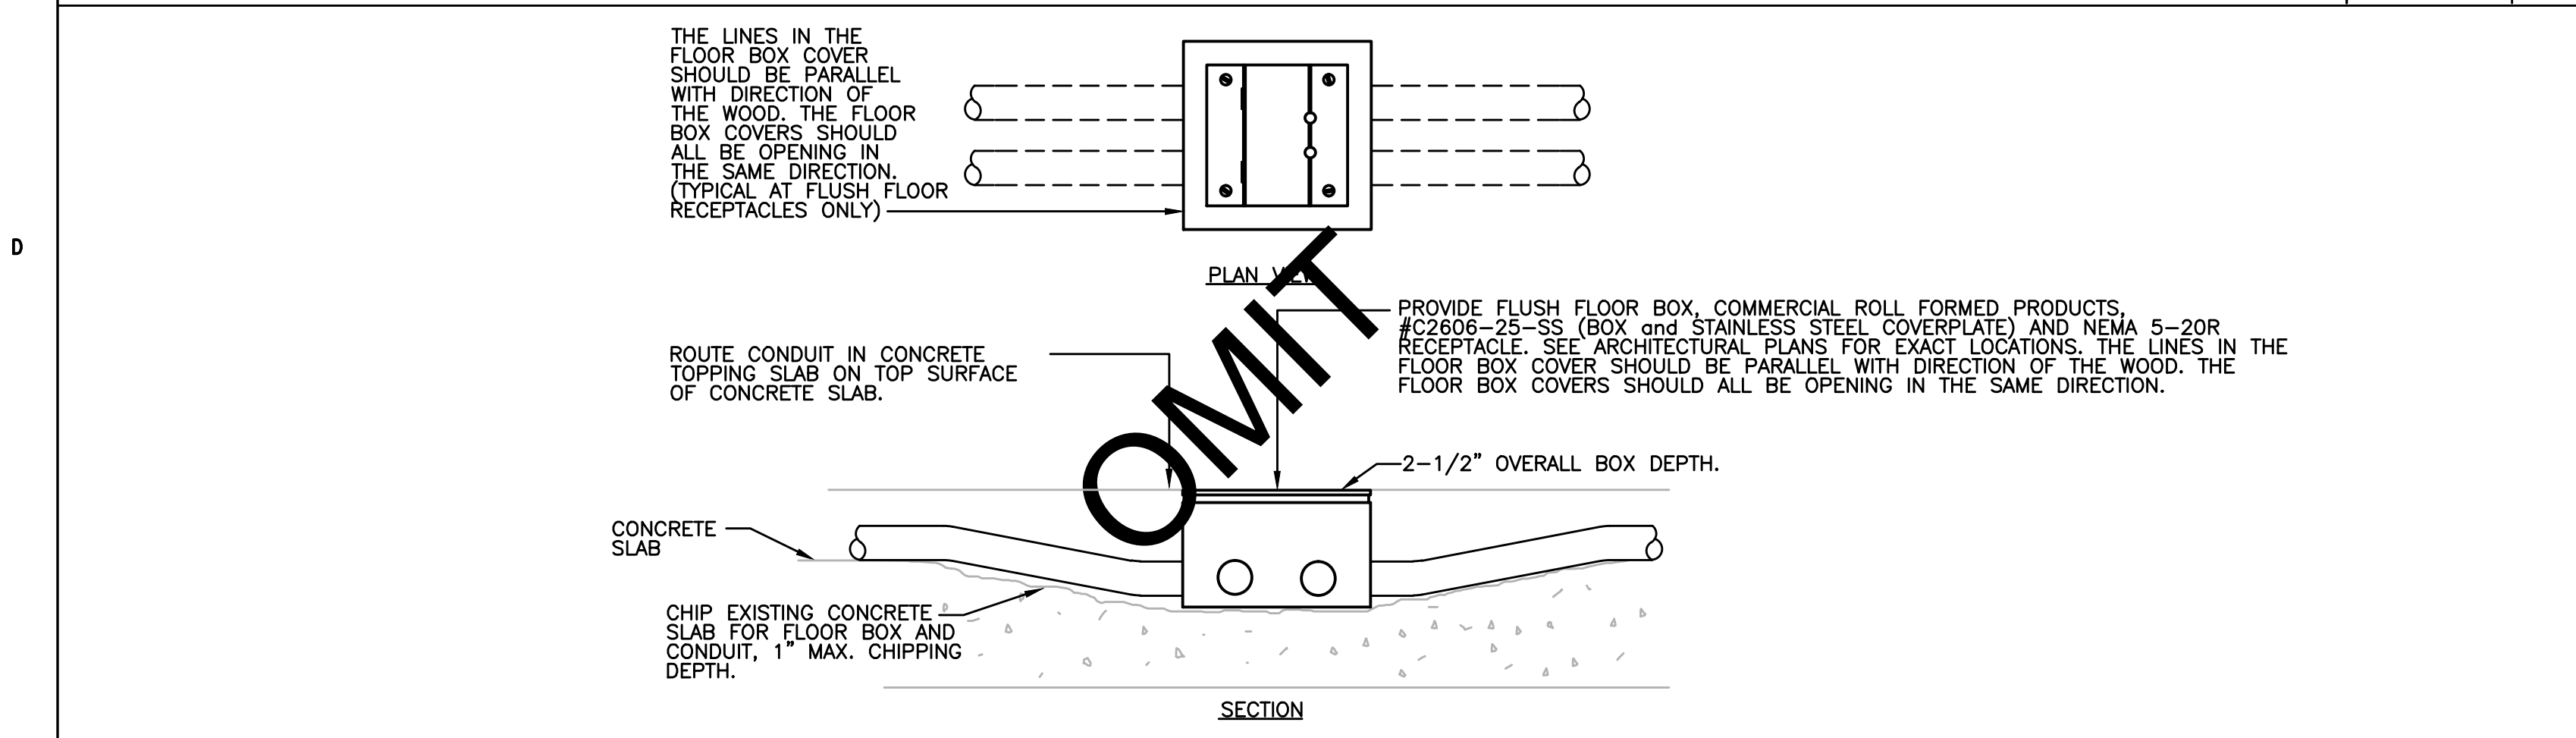


FLOOR BOX AND CONDUIT DETAIL FOR ELEVATED SITUATIONS

2
NOT TO SCALE

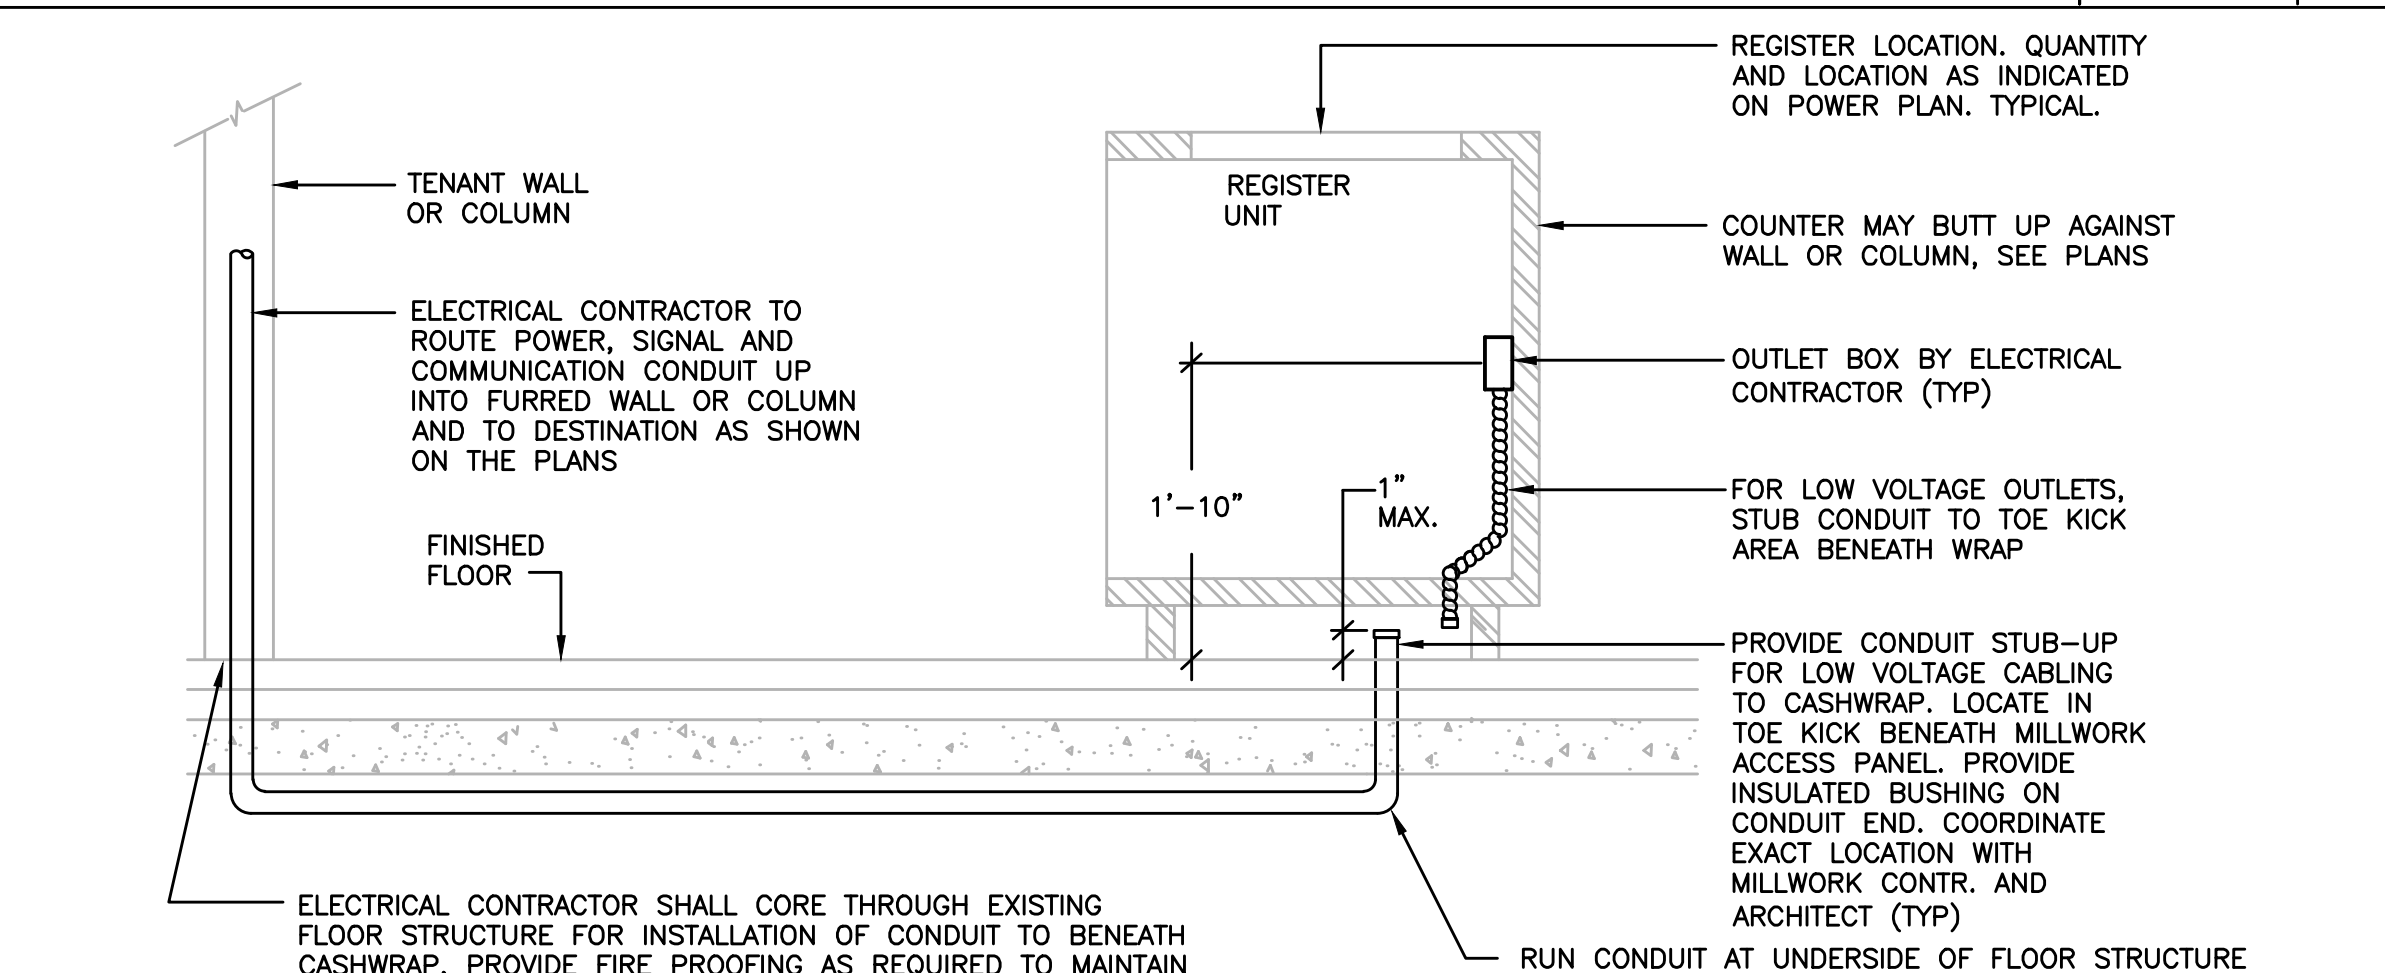


CASHWRAP ELEVATED FLOOR INSTALLATION

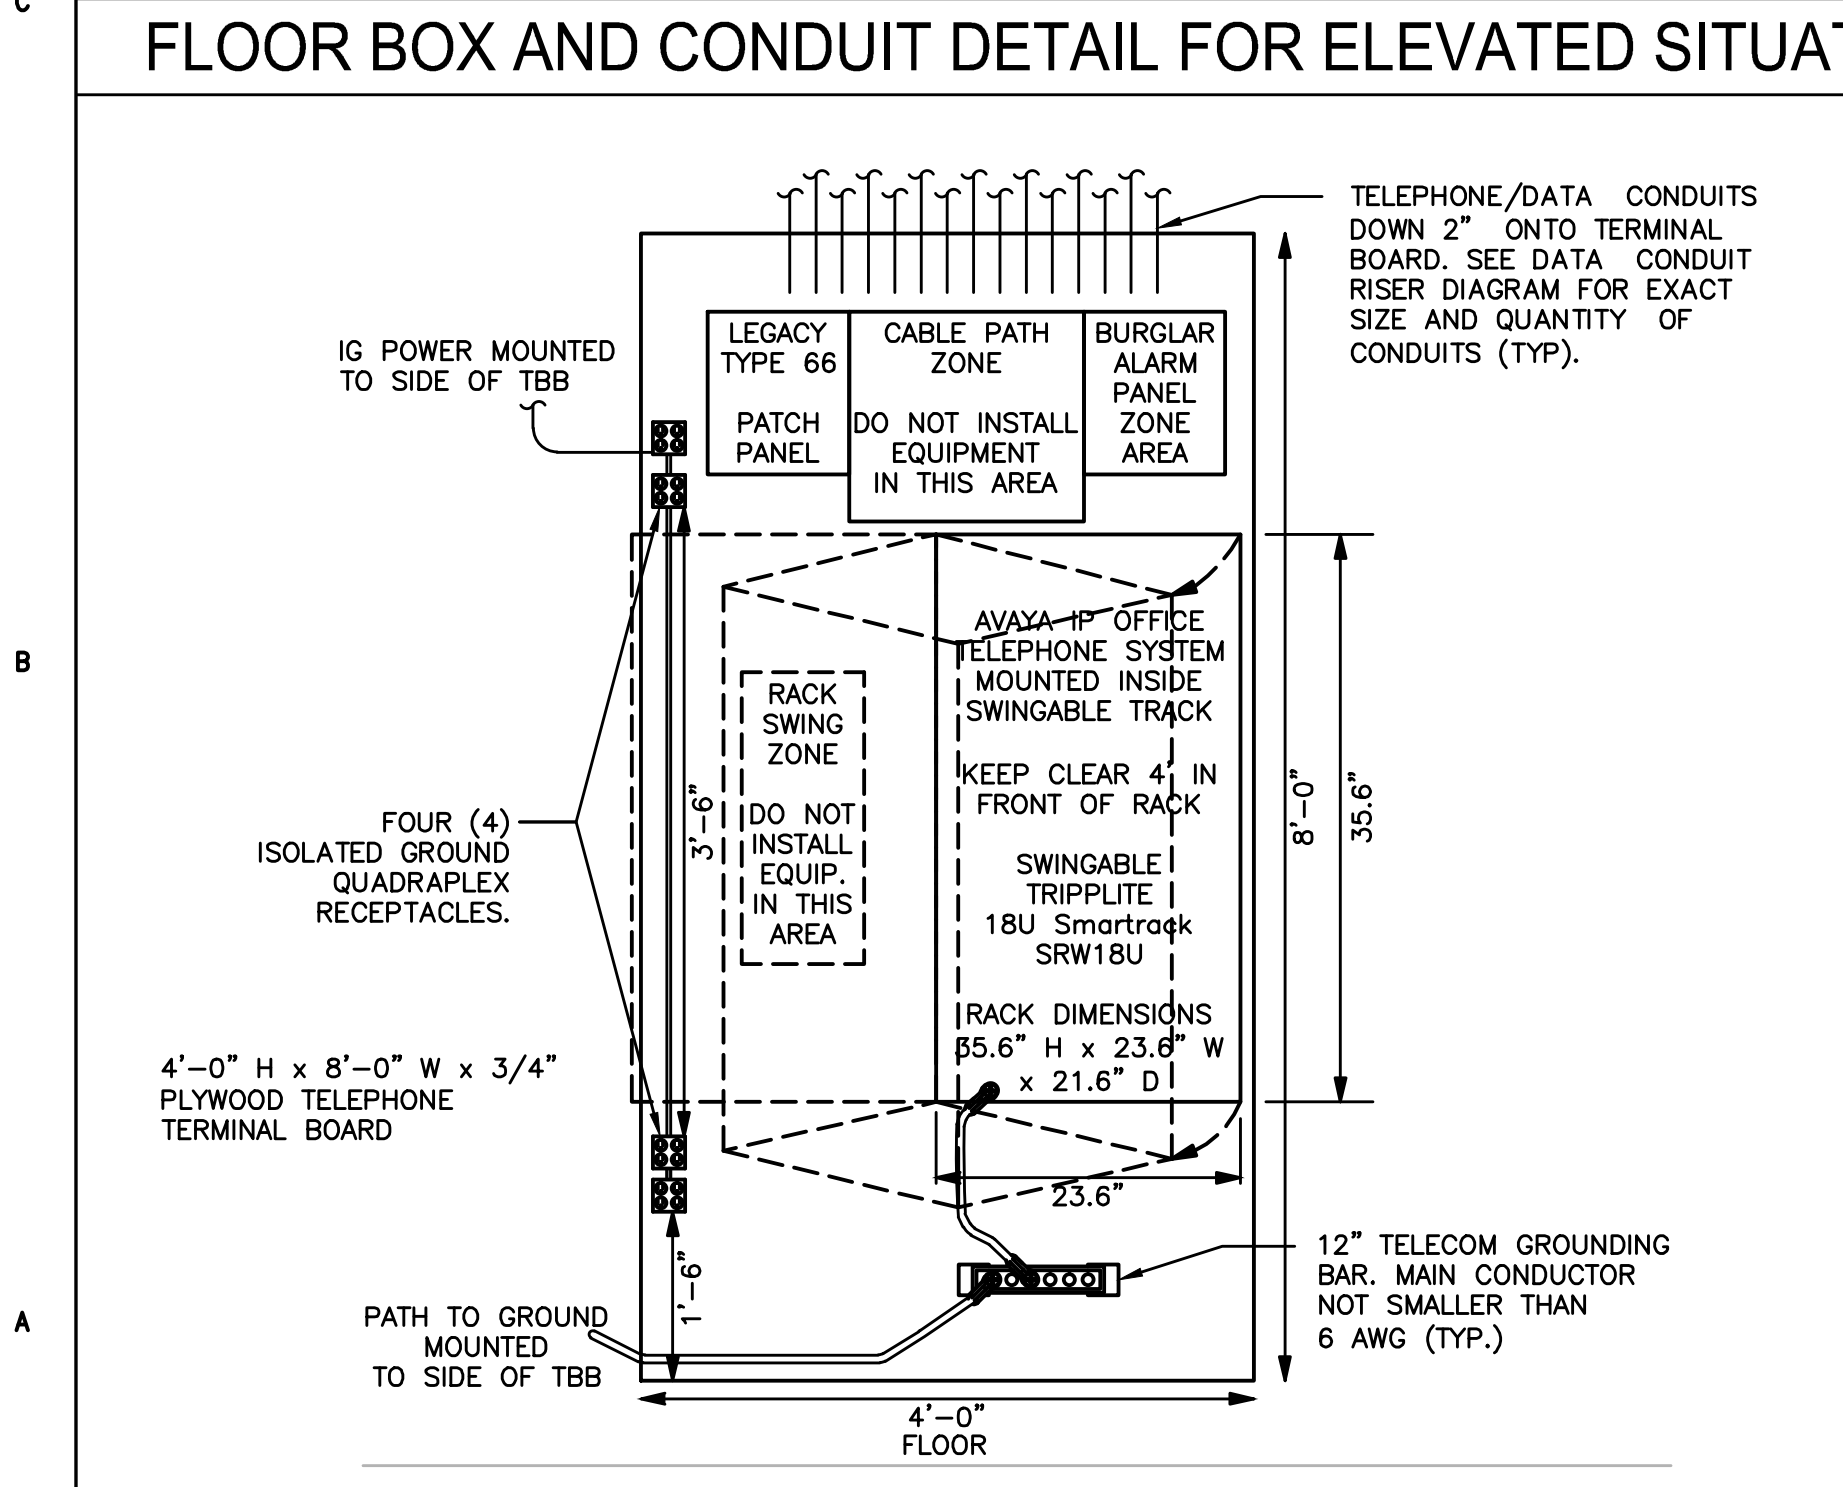


TELEPHONE TERMINAL BOARD (TTB) ELEVATION

3
NOT TO SCALE

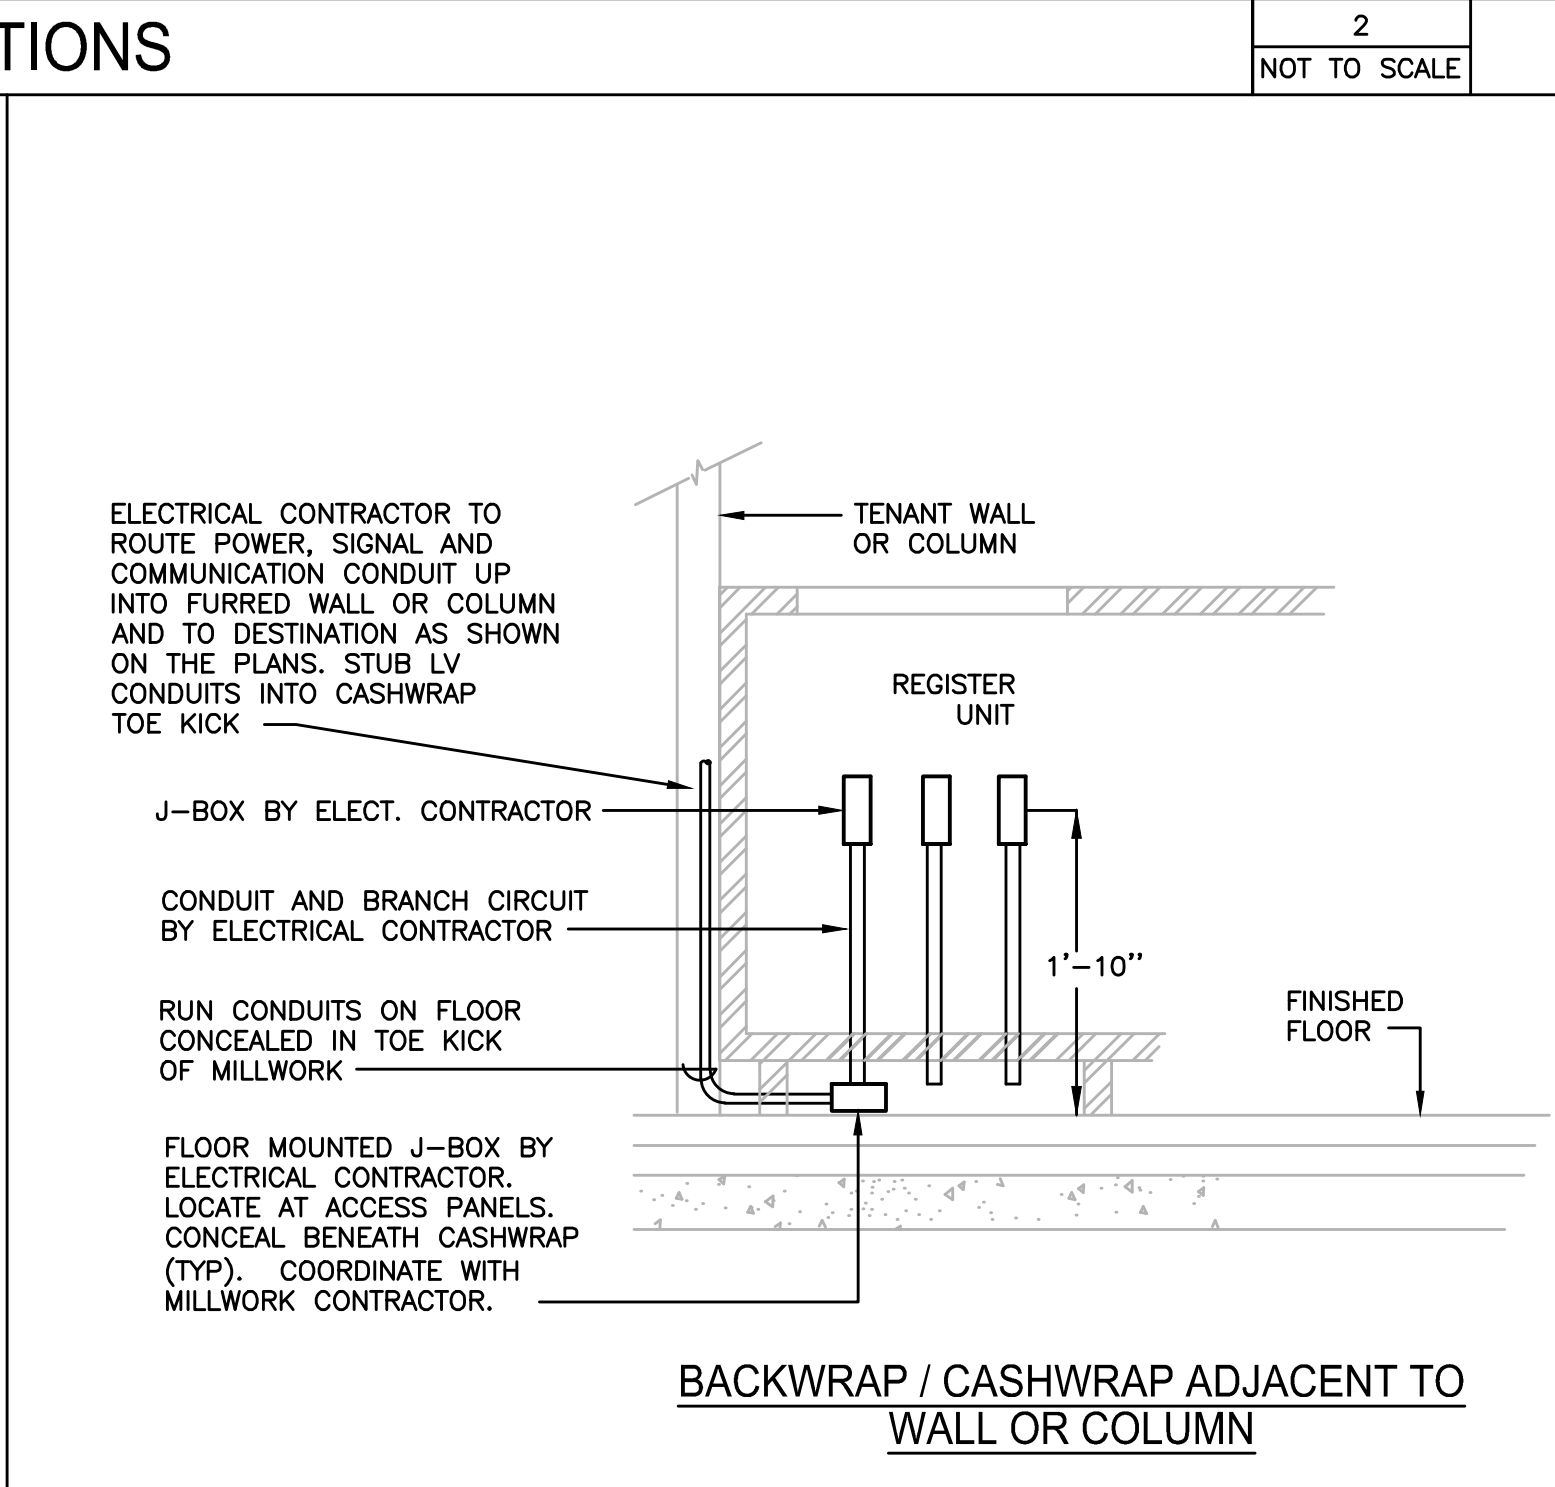

CASHWRAP SERVICE CONDUIT ELEVATION

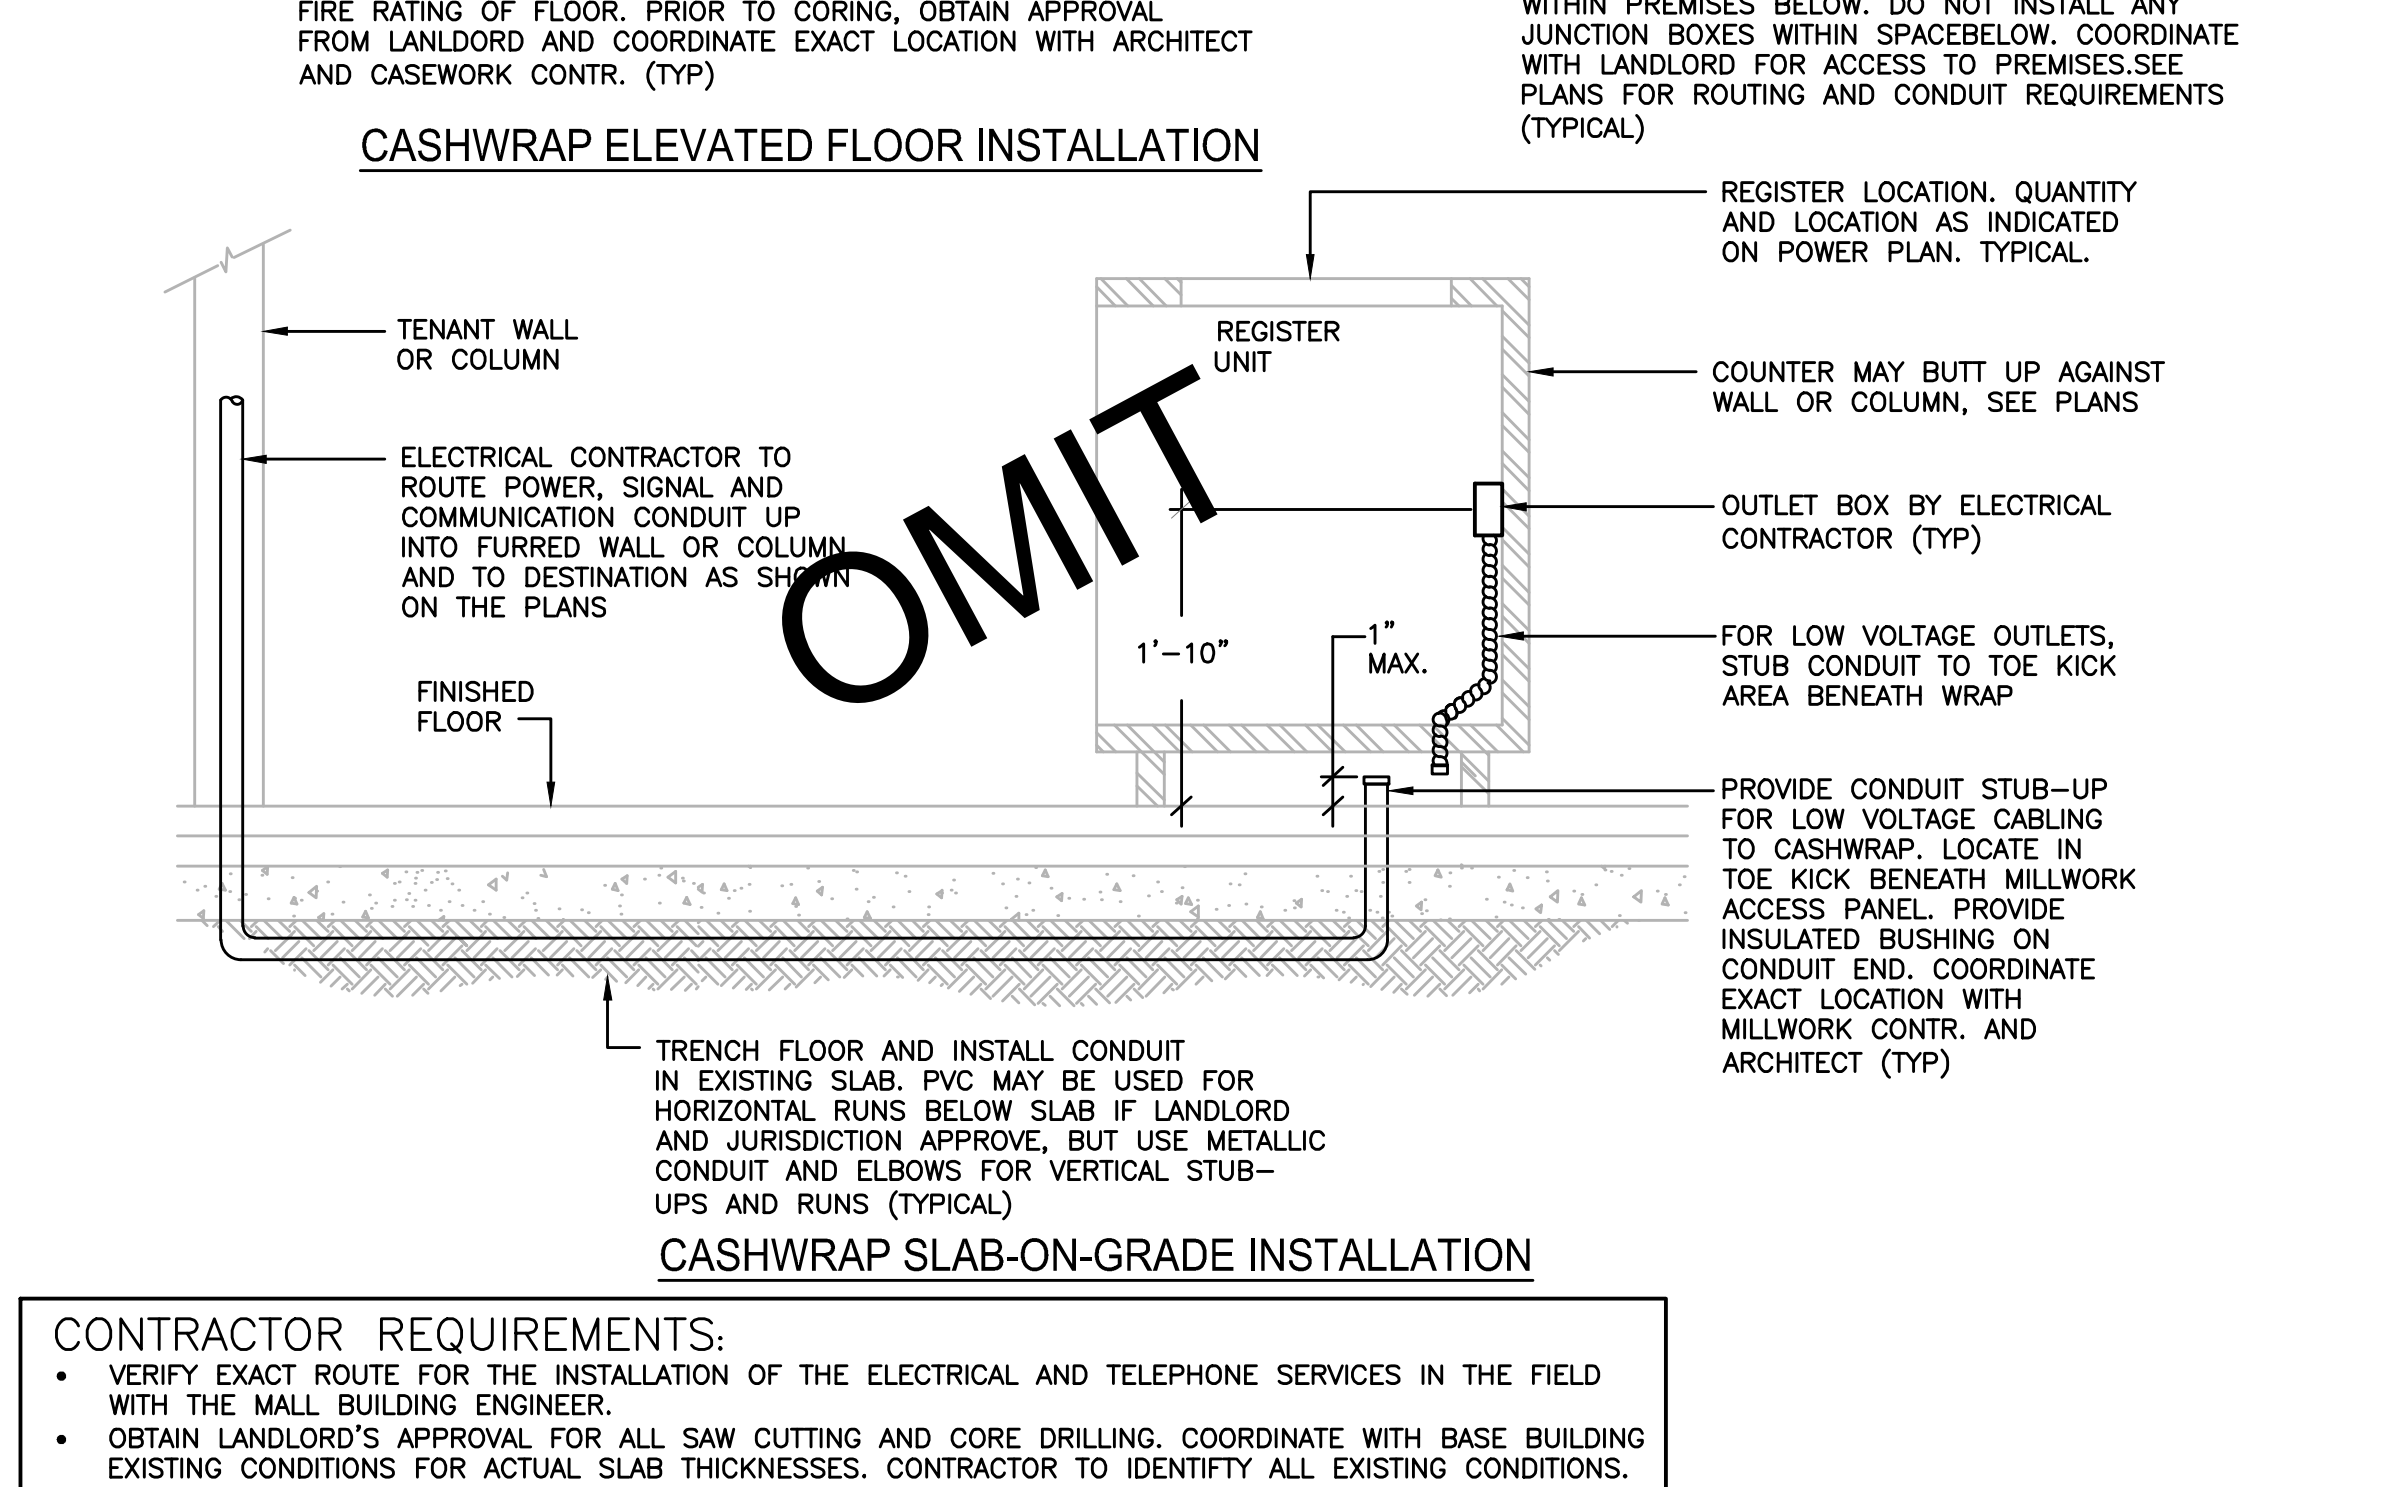

CASHWRAP SLAB-ON-GRADE INSTALLATION

- CONTRACTOR REQUIREMENTS:
- VERIFY EXACT ROUTE FOR THE INSTALLATION OF THE ELECTRICAL AND TELEPHONE SERVICES IN THE FIELD WITH THE MALL BUILDING ENGINEER.
 - OBTAIN LANDLORD'S APPROVAL FOR ALL SAW CUTTING AND CORE DRILLING. COORDINATE WITH BASE BUILDING EXISTING CONDITIONS FOR ACTUAL SLAB THICKNESSES. CONTRACTOR TO IDENTIFY ALL EXISTING CONDITIONS.

6
NOT TO SCALE

OWNER:
WILLIAMS-SONOMA, INC.
3250 Van Ness Avenue
San Francisco, CA 94109
T 415 616 8602
F 415 439 8164
www.williams-sonomainc.com

EEA
EEA Consulting Engineers
6615 Vaughn Ranch Road, Suite 200
Austin, Texas 78730-2314 USA
512.744.4400 main 512.744.4444 fax
www.eea.com
State of Registration: MAINE
Firm Registration No. N/A
EEA Project No. 20166538
DRAWN BY: BMW
CHECKED BY: SMR

west elm
Downtown Portland
164 Middle Street
Portland, ME 04101
PROJECT #006-160335-00

ISSUED / REVISED	DATE
PRELIMINARY SET	09/08/16
LL COORDINATION SET	11/08/16
LL/PERMIT SET	11/21/16

ELECTRICAL
DETAILS

E-202