2009 IBC: CODE DATA	
USE GROUP CLASSIFICATION	I-2
OCCUPANT LOAD	120 SF/PP SLEEPING / 240 SF/PP INPATIENT TREATMENT AREAS
TYPE OF CONSTRUCTION	TYPE IIA
FIRE RATING:	
EXTERIOR BEARING WALLS	1 HOUR
EXTERIOR NON-BEARING WALLS	0 HOUR
INTERIOR BEARING WALLS	1 HOUR
COLUMNS	1 HOUR
BEAMS, GIRDERS, TRUSSES	1 HOUR
FLOOR CONSTRUCTION	1 HOUR
ROOF CONSTRUCTION	1 HOUR
WING B AREA	12,273 SQ FT.
RENOVATION AREA	3,346 SQ FT.
FIRE SUPPRESSION:	
FIRE WALLS	2 HOUR
PARTY WALLS / FIRE PARTITIONS	1 HOUR
STAIR ENCLOSURES	NA
SHAFTS	NA
CORRIDORS	O HOUR
FLAME SPREAD RATINGS:	
INTERIOR WALL & CEILING FINISH REQUIREMENTS	SPRINKLERED BUILDING
REQUIRED VERTICAL EXITS	CLASS B
CORRIDORS	CLASS B
ROOMS OR ENCLOSED SPACES	CLASS B
INTERIOR FLOOR FINISH REQUIREMENTS	
CORRIDORS PROVIDING EXIT ACCESS	CLASS II
FIRE EXTINGUISHERS	1. LOCATIONS TO BE FIELD VERIFIED BY LOCAL FIRE CHIEF PRIOR TO INSTALLATION.
GENERAL NOTES	1. ALL PENETRATIONS OF SMOKE BARRIERS, PARTITIONS, FIRE RATED WALLS AND FLOORS SHALL BE SEALED WITH PROPER APPROVED MATERIALS. 2. ALL WORK SHALL CONFORM TO LOCAL AND STATE CODES, ORDINANCES AND REQUIREMENTS, ACCESSIBILITY PER A.D.A.A.G

A8 CODE DATA - NFPA 2009

NTS

NFPA 2009: CODE DATA	
USE GROUP CLASSIFICATION	CHAPTER 19 HEALTHCARE
OCCUPANT LOAD	120 SF/PP SLEEPING / 240 SF/PP INPATIENT TREATMENT AREAS
TYPE OF CONSTRUCTION	TYPE II (1,1,1)
FIRE RATING:	
EXTERIOR BEARING WALLS	1 HOUR
EXTERIOR/INTERIOR NON-BEARING WALLS	0 HOUR
INTERIOR BEARING WALLS	1 HOUR
COLUMNS	1 HOUR
BEAMS, GIRDERS, TRUSSES	1 HOUR
FLOOR/CEILING CONSTRUCTION	1 HOUR
ROOF/CEILING CONSTRUCTION	1 HOUR
WING B AREA	12,273 SQ.FT.
RENOVATION AREA	3,346 SQ.FT.
FIRE SUPPRESSION:	
HAZARD	1 HOUR
COMMON PATH OF TRAVEL	NA
DEAD END CORRIDOR	30 FEET
TRAVEL DISTANCE LIMIT	150 FEET
EXITS:	
STAIRWAY WIDTH	NA
SHAFTS	NA
CORRIDOR WIDTH	8'-0" MIN.
EXIT ACCESS CORRIDORS	1/2 HOUR (SMOKE BARRIER)
FLAME SPREAD RATINGS:	
INTERIOR WALL & CEILING FINISH REQUIREMENTS	SPRINKLERED BUILDING
EXIT	CLASS A
EXIT ACCESS CORRIDORS	CLASS A/B LOWER WALL
OTHER SPACES	CLASS A
INTERIOR FLOOR FINISH REQUIREMENTS	
EXIT	CLASS I OR II
CORRIDORS	CLASS I OR II
FIRE EXTINGUISHERS	1. LOCATIONS TO BE FIELD VERIFIED BY LOCAL FIRE CHIEF PRIOR TO INSTALLATION.
GENERAL NOTES	1. ALL PENETRATIONS OF SMOKE BARRIERS, PARTITIONS, FIRE RATED WALLS AND FLOORS SHALL BE SEALED WITH PROPER APPROVED MATERIALS. 2. ALL WORK SHALL CONFORM TO LOCAL AND STATE CODES, ORDINANCES AND REQUIREMENTS, ACCESSIBILITY PER A.D.A.A.G 3. PROVIDE NFPA 13R FIRE PROTECTION

A1 CODE DATA - IBC 2009

NTS

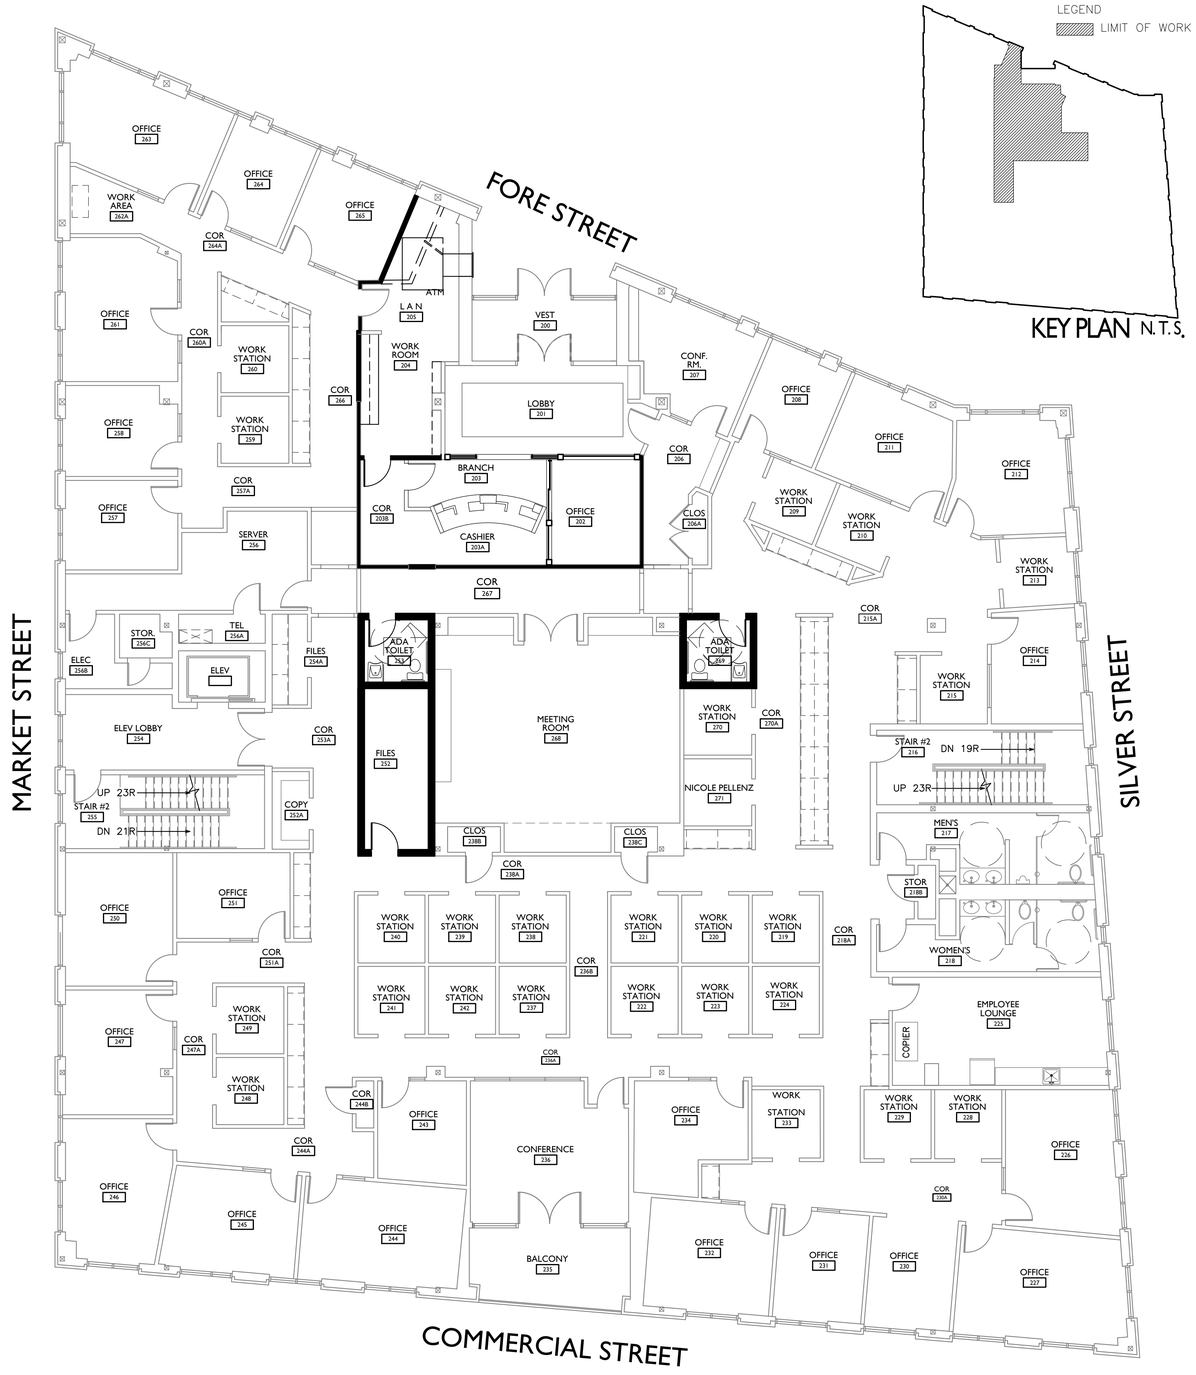

REVIEW SET: August 21, 2015

A8 LIFE SAFETY PLAN / TEMPORARY PARTITIONS

1/8" = 1'-0"

PLAN NORTH

Gawron Turgeon
ARCHITECTS
29 Black Point Road
Scarborough, Maine 04074
www.gawronturgeon.com
207-883-6307 tel 207-883-0361 fax

PEOPLES UNITED BANK
350 FORE STREET,
PORTLAND MAINE

REVISIONS		
#	DATE	DESCRIPTION

DATE:	3.26.15
PROJECT #	030415
DRAWN BY:	JME
CHECKED BY:	MET
DRAWING SCALE	AS NOTED

SHEET TITLE

CODE REVIEW & LIFE SAFETY PLAN

G102

© COPYRIGHT 1985-2013
REPRODUCTION OR REUSE OF THIS DOCUMENT WITHOUT WRITTEN PERMISSION OF GAWRON TURGEON ARCHITECTS IS PROHIBITED