

City of Portland, Maine - Building or Use Permit Application

389 Congress Street, 04101 Tel: (207) 874-8703, Fax: (207) 874-8716

Permit No: 04-0136	Issue Date:	CBL: 031 L035001
-----------------------	-------------	---------------------

Location of Construction: 30 Union Wharf	Owner Name: Proprietors Of Union Wharf	Owner Address: 36 Union Wharf	Phone:
Business Name:	Contractor Name: Portland Sheet Metal	Contractor Address: 93 Warren Ave. Portland	Phone:
Lessee/Buyer's Name	Phone:	Permit Type: HVAC	Zone: WC2

Past Use: Commercial / Manufacturing Lobster Products.	Proposed Use: Commercial / Manufacturing Lobster Products / Install Fantech exhaust fan	Permit Fee: \$48.00	Cost of Work: \$2,769.00	CEO District: 1
		FIRE DEPT: <input checked="" type="checkbox"/> Approved <input type="checkbox"/> Denied	INSPECTION: Use Group: Type:	

Proposed Project Description:
Commercial / Manufacturing Lobster Products / Install Fantech exhaust fan
*Application has been abandoned
and is expired. 1/23/08*

Signature: *MM* Signature:
PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.)
Action: Approved Approved w/Conditions Denied
Signature: Date:

Permit Taken By: ldobson	Date Applied For: 02/19/2004	Zoning Approval	
------------------------------------	--	------------------------	--

<ol style="list-style-type: none"> This permit application does not preclude the Applicant(s) from meeting applicable State and Federal Rules. Building permits do not include plumbing, septic or electrical work. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work.. 	Special Zone or Reviews <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan Maj <input type="checkbox"/> Minor <input checked="" type="checkbox"/> MM Date: <i>2/24/04</i>	Zoning Appeal <input type="checkbox"/> Variance <input type="checkbox"/> Miscellaneous <input type="checkbox"/> Conditional Use <input type="checkbox"/> Interpretation <input type="checkbox"/> Approved <input type="checkbox"/> Denied Date:	Historic Preservation <input checked="" type="checkbox"/> Not in District or Landmark <input type="checkbox"/> Does Not Require Review <input type="checkbox"/> Requires Review <input type="checkbox"/> Approved <input type="checkbox"/> Approved w/Conditions <input type="checkbox"/> Denied Date:
---	--	---	--

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provision of the code(s) applicable to such permit.

SIGNATURE OF APPLICANT	ADDRESS	DATE	PHONE
RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE		DATE	PHONE

City of Portland, Maine - Building or Use Permit

389 Congress Street, 04101 Tel: (207) 874-8703, Fax: (207) 874-8716

Permit No: 04-0136	Date Applied For: 02/19/2004	CBL: 031 L035001
------------------------------	--	----------------------------

Location of Construction: 30 Union Wharf	Owner Name: Proprietors Of Union Wharf	Owner Address: 36 Union Wharf	Phone:
Business Name:	Contractor Name: Portland Sheet Metal	Contractor Address: 93 Warren Ave. Portland	Phone:
Lessee/Buyer's Name	Phone:	Permit Type: HVAC	

Proposed Use: Commercial / Manufacturing Lobster Products / Install Fantech exhaust fan	Proposed Project Description: Commercial / Manufacturing Lobster Products / Install Fantech exhaust fan
---	---


Dept: Zoning	Status: Approved	Reviewer: Marge Schmuckal	Approval Date: 02/27/2004
Note:			Ok to Issue: <input checked="" type="checkbox"/>
Dept: Building	Status: Pending	Reviewer: Mike Nugent	Approval Date:
Note:			Ok to Issue: <input type="checkbox"/>
Dept: Fire	Status: Approved	Reviewer: Lt. MacDougal	Approval Date: 02/26/2004
Note:			Ok to Issue: <input checked="" type="checkbox"/>

Comments:
03/01/2004-mjn: Spoke with Don Nelson.Contractor..Hood spec'ed as aluminum...must be steel or stainless steel per building /mech. Code also need clearance form combustibles and structural info for sloor sytem above that this will be hung from...



FILL IN AND SIGN WITH INK

APPLICATION FOR PERMIT HEATING OR POWER EQUIPMENT

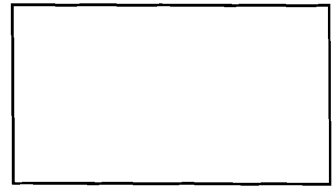

031 L 035001

FEB 19 2004

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location / CBL Union Wharf Use of Building Commercial Date 2/12/04
 Name and address of owner of appliance MORRISON'S MAINE COURSE, 48 Union Wharf
Portland 04112 Box 18166
 Installer's name and address Portland Sheetmetal, 93 WARREN AVE.
Portland, 04103 Telephone 797-9886

Location of appliance:

- Basement Floor hung from ceiling
 Attic Roof

Type of Fuel:

- Gas Oil Solid

Appliance Name: Fautech exhaust fan

U.L. Approved Yes No

Will appliance be installed in accordance with the manufacture's installation instructions? Yes No

IF NO Explain: _____

The Type of License of Installer:

- Master Plumber # _____
 Solid Fuel # _____
 Oil # _____
 Gas # _____
 Other Sheet metal

Type of Chimney:

- Masonry Lined
 Factory built NA
 Metal
 Factory Built U.L. Listing # _____
 Direct Vent
 Type _____ UL# _____

Type of Fuel Tank

- Oil NA
 Gas

Size of Tank _____

Number of Tanks _____

Distance from Tank to Center of Flame _____ feet.

Cost of Work: \$ 2769

Permit Fee: \$ 3948

Approved

Approved with Conditions

Fire: U.M.
 Ele.: _____
 Bldg.: _____

See attached letter or requirement

Inspector's Signature

Date Approved

Signature of Installer David J. [Signature]



W.H. DEMMONS, INC.

Maine Air Conditioning
Portland Sheet Metal
Demmons Roofing

93 Warren Ave. • Portland, ME 04101 •
Tel: 207.797.7000 • Fax: 207.878.3015
Visit Our Website: www.demmons.com

JOB *Molok's*


SHEET NO. _____ OF _____

CALCULATED BY *N* DATE *2/5/00*


CHECKED BY _____ DATE _____

SCALE _____

*EP-1 = Gray SC510
w/ 1/2" coll. for 1/2" dia. pipe
at 10' M*

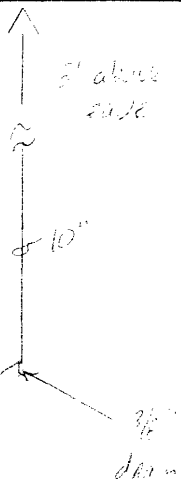

End of pipe height 10' from top

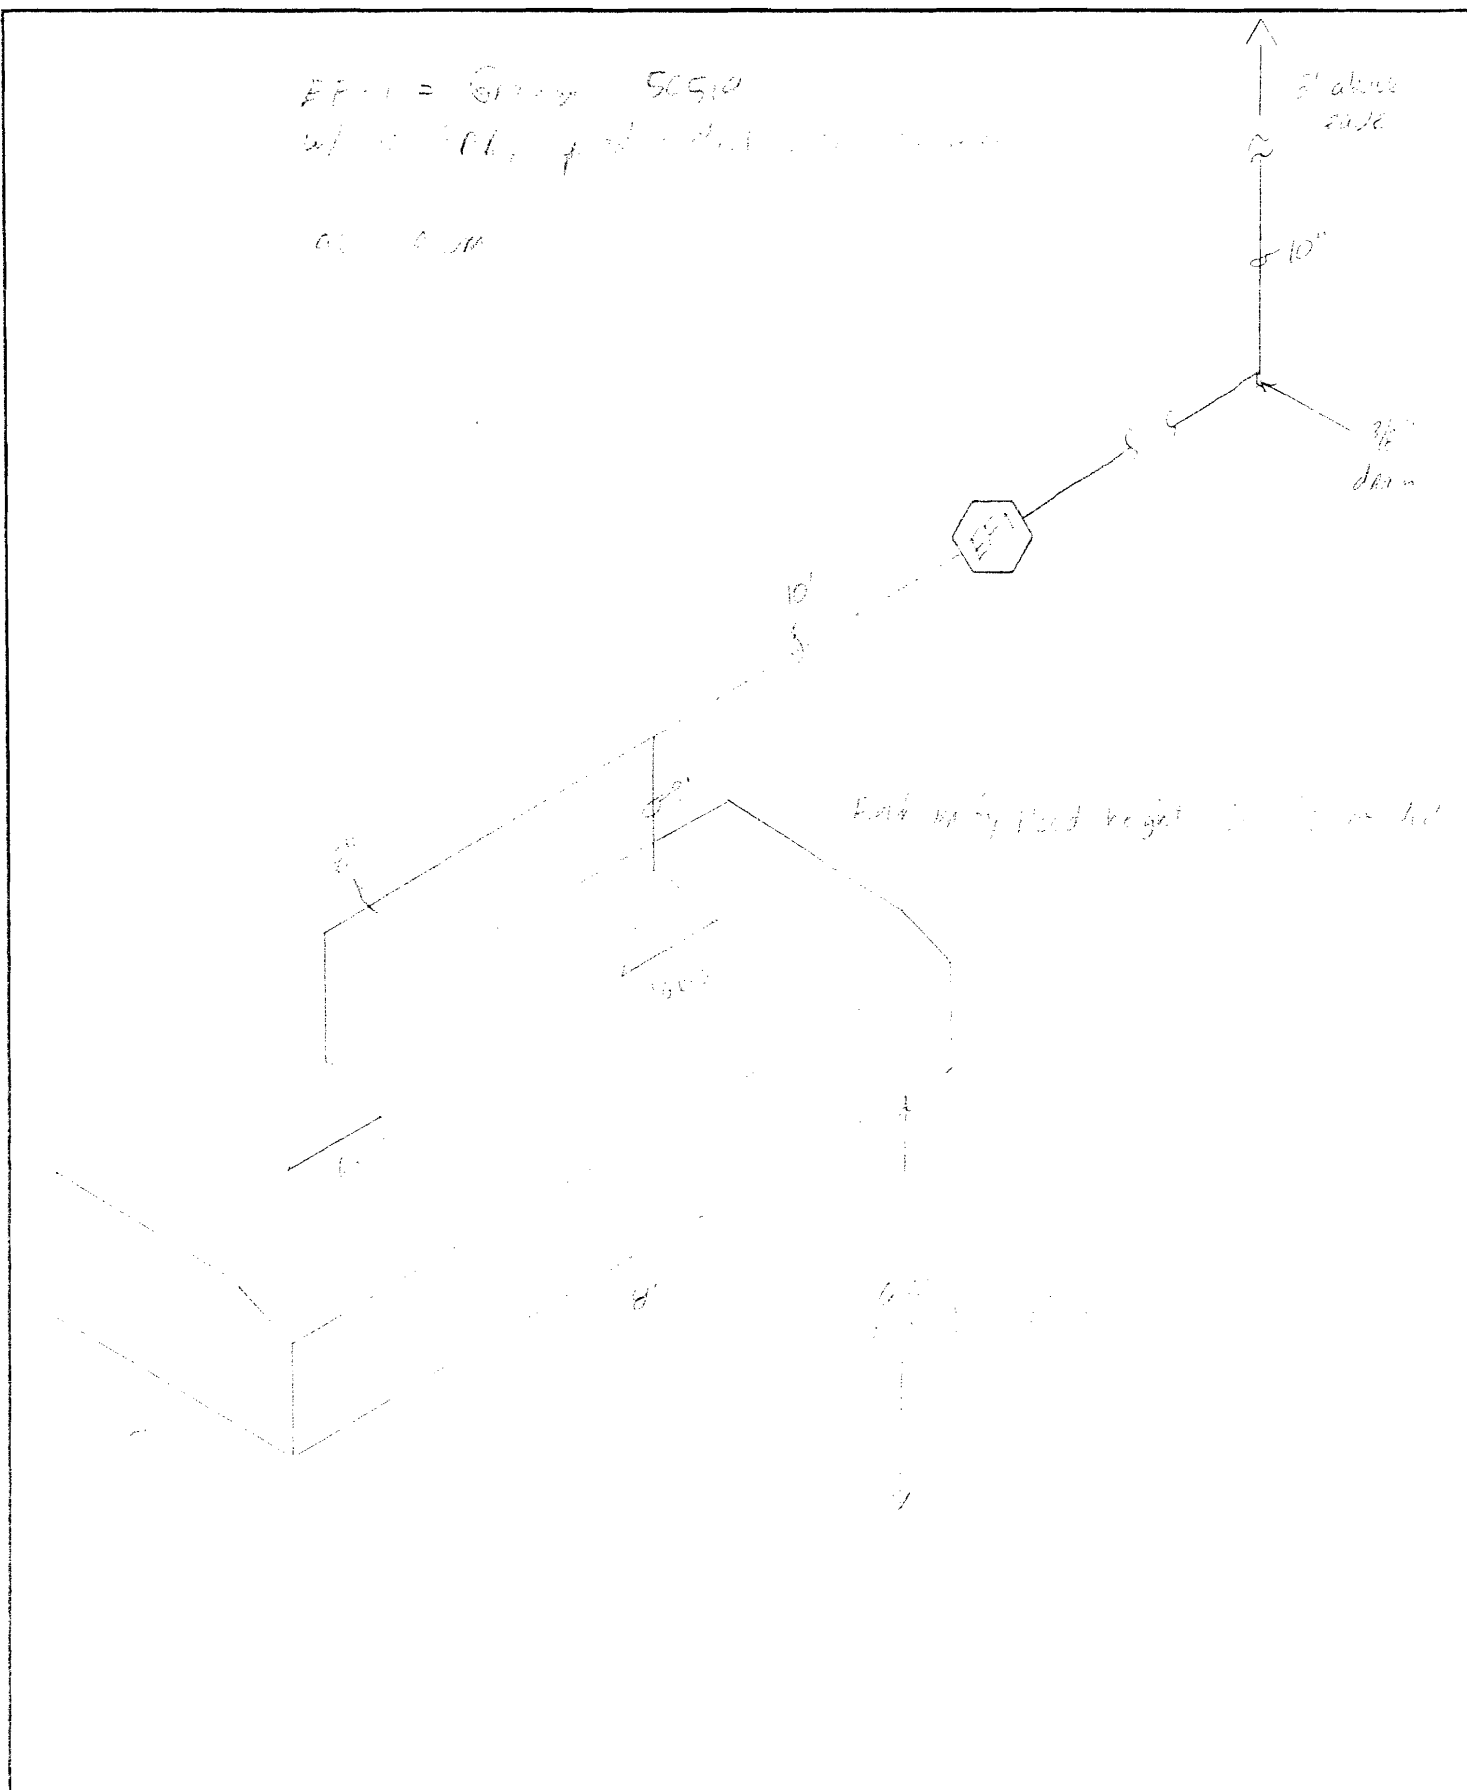

Morison's Maine Course
48 Union Wharf
Portland, Me. 04112

Soup kettle vapor exhaust;

.063 ga. aluminum hood 70 lbs.

Hood suspended from floor joists above with aluminum strapping and lag bolts

20 ga. spiral aluminum exhaust duct 10" dia., 60 lbs. Ductwork passes through one plywood sheathed wall and one steel panel exterior wall

One Fantech inline exhaust fan 115 volt AC, 12 lbs.

Power wiring by electrical contractor

Maximum exhaust temperature is 140 deg F