
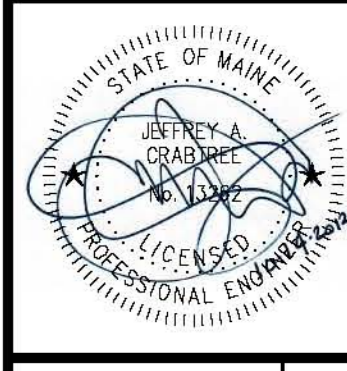


UTILIZE 3/4" PEX TUBING AT 12" O.C. INSTALLED ABOVE A COMPACTED GID INSULATION IN A 3" BED OF SAND. HX PROVIDE A 40% PROPYLENE CONTROL SYSTEM WITH A WIR350

NOTE: PROVIDE HYDRONIC RADIANT HEAT BELOW SIDEWALK AT THIS AREA (15' x 9')

ENLARGED FIRST FLOOR PLAN - HVAC  
SCALE: 1/4"=1'-0"

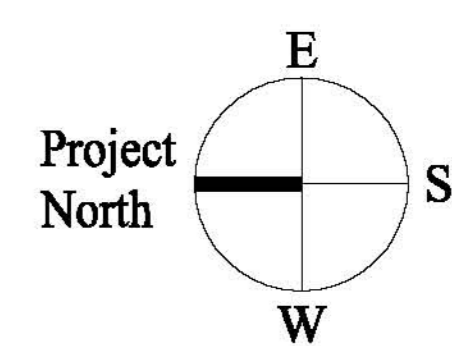

Prepared For:  
119 DEVELOPMENT LLC

Mechanical Engineer:  
Crabtree Engineering  
278 Amalia Cove  
Collierville, Tennessee 38017  
jce98@bellsouth.net

Architect:  
**ARCHETYPE** architects  
48 Union Wharf Portland, Maine 04101  
(207) 772-6022 Fax (207) 772-4056

Project:  
**PRESS HOTEL**  
390 CONGRESS STREET  
PORTLAND, MAINE

Revisions:  
1 | 13-07-01 | 30% Marriott Submission  
2 | 13-09-09 | 60% Marriott Sub. & Pric.  
3 | 13-10-14 | Issue for Bid & Marriott Revw

Date:  
08 OCT 13

Scale:  
1/8" = 1'-0"

**ENLARGED FIRST FLOOR PLAN - HVAC**

**M1.02**