


2ND FLOOR FRAMING PLAN
 1/8"=1'-0"

INDICATES NEW STEEL BEAM
 INDICATES EXISTING STEEL BEAM

THE EXISTING SLAB SOUTH OF GRID 10 IS TO BE LEVELLED WITH A CONCRETE TOPPING. TOPPING TO BE 1" THICK AT HIGH POINTS OF EXISTING SLAB AND UP TO APPROXIMATELY 2" THICK AT LOW POINTS. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS ADJACENT TO EXISTING STAIRS THAT WILL NOT BE LEVELLED.

APPLY TOPPING AS FOLLOWS:
 SCARIFY, TEST, SEAL AND BLOW CLEAN WITH COMPRESSED AIR.
 COAT WITH BONDING AGENT (ASTM C-892).
 PLACE TOPPING SLAB AND STEEL TROWEL FINISH.
 NET CURE FOR MIN 7 DAYS.

ALL DIMENSIONS AND ELEVATIONS MUST BE FIELD VERIFIED BY CONTRACTOR

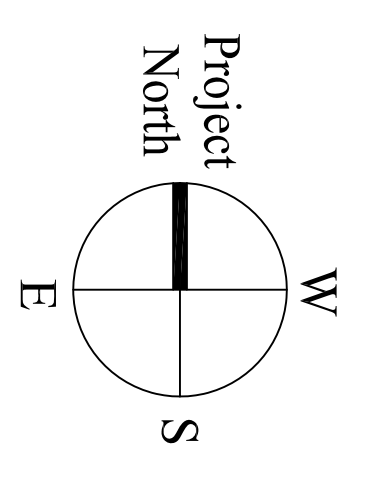


S1.03

Date: 01 July, 2013
 Scale: 1/8"=1'-0"
2ND FLOOR FRAMING PLAN

Revisions:	
1	1 Jul 2013 30% Marriott Submission
2	9 Sep 2013 60% Marriott Sub. & Pric.
3	14 Oct 2013 Bid & Marriott Review

Project: **Press Hotel**
 119 Exchange St.
 Portland, Maine 04101

Architect: **ARCHETYPE Architects**
 48 Union Wharf Portland, Maine 04101
 (207) 772-6022 Fax (207) 772-4056

Consulting Engineer:

 22 Oakmont Drive
 Old Orchard Beach ME
 04064-4121
 Tel 207.934.8038
 Fax 207.934.8039

Prepared For:
119 DEVELOPMENT, LLC
 P.O. Box 7468
 Portland, Me 04112