


5TH FLOOR FRAMING PLAN
1/8"=1'-0"

INDICATES NEW STEEL BEAM
INDICATES EXISTING STEEL BEAM

THE EXISTING SLAB SOUTH OF GRID 10 EXCEPT AT HISTORIC FLOOR FINISH AREA IS TO BE LEVELED WITH A CONCRETE TOPPING. TOPPING TO BE 1" THICK AT HIGH POINTS OF EXISTING SLAB AND UP TO APPROXIMATELY 2" THICK AT LOW POINTS. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS ADJACENT TO EXISTING STAIRS THAT WILL NOT BE LEVELED.

APPLY TOPPING AS FOLLOWS:
SCAFFOLD EXISTING SLAB AND BLOW CLEAN WITH COMPRESSED AIR.
COAT WITH BONDING AGENT (ASTM C-891).
PLACE TOPPING SLAB AND STEEL TROWEL FINISH.
CURE FOR MIN 7 DAYS.

ALL DIMENSIONS AND ELEVATIONS MUST BE FIELD VERIFIED BY CONTRACTOR

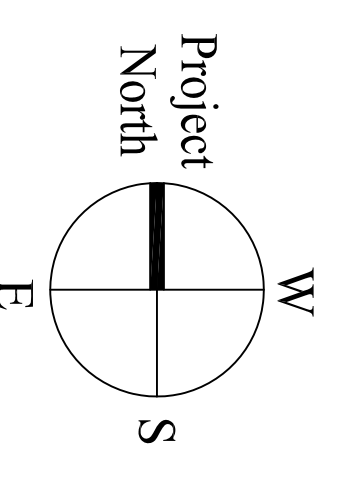

S1.06

Date: 01 July, 2013	Scale: 1/8"=1'-0"
5TH FLOOR FRAMING PLAN	

Revisions:	
1	1 Jul 2013 30% Marriott Submission
2	9 Sep 2013 60% Marriott Sub. & Pric.
3	14 Oct 2013 Bid & Marriott Review

Project: Press Hotel 119 Exchange St. Portland, Maine 04101

Architect: ARCHETYPE Architects 48 Union Wharf Portland, Maine 04101 (207) 772-6022 Fax (207) 772-4056

Consulting Engineer: DESIGN STRUCTURAL CONSULTING 22 Oakmont Drive Old Orchard Beach ME 04064-4121 Tel 207.934.8038 Fax 207.934.8039

Prepared For: 119 DEVELOPMENT, LLC P.O. Box 7468 Portland, Me 04112
