


ALL DIMENSIONS AND ELEVATIONS MUST BE FIELD VERIFIED BY CONTRACTOR

1ST FLOOR FRAMING PLAN  
1/8"=1'-0"

INDICATES NEW STEEL BEAM  
INDICATES EXISTING STEEL BEAM

THE EXISTING SLAB SOUTH OF GRID 10 IS TO BE LEVELED WITH A CONCRETE TOPPING. TOPPING TO BE 1" THICK AT HIGH POINTS OF EXISTING SLAB AND UP TO APPROXIMATELY 2" THICK AT LOW POINTS. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS ADJACENT TO EXISTING STAIRS THAT WILL NOT BE LEVELED.

APPLY TOPPING AS FOLLOWS:  
SCAFFOLD EXISTING SLAB AND BLOW CLEAN WITH COMPRESSED AIR.  
COAT WITH BONDING AGENT (ASTM C-892).  
PLACE TOPPING SLAB AND STEEL TROWEL FINISH.  
NET CURE FOR MIN 7 DAYS.

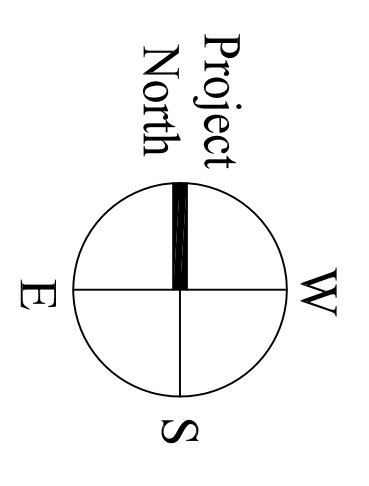

<h1>S1.02</h1>	Date: 01 July, 2013	Scale: 1/8"=1'-0"	Revisions: 1 1 Jul 2013 30% Marriott Submission 2 9 Sep 2013 60% Marriott Sub. & Pric. 3 14 Oct 2013 Bid & Marriott Review	Project: <b>Press Hotel</b> 119 Exchange St. Portland, Maine 04101	Architect: <b>ARCHETYPE</b> Architects 48 Union Wharf Portland, Maine 04101 (207) 772-6022 Fax (207) 772-4056	Consulting Engineer: <b>STRUCTURAL DESIGN CONSULTING</b> 22 Oakmont Drive Old Orchard Beach ME 04064-4121 Tel 207.934.8038 Fax 207.934.8039	Prepared For: <b>119 DEVELOPMENT, LLC</b> P.O. Box 7468 Portland, Me 04112
	<h2>1ST FLOOR FRAMING PLAN</h2>						