


6TH FLOOR / LOWER ROOF FRAMING PLAN
1/8"=1'-0"

INDICATES NEW STEEL BEAM
INDICATES EXISTING STEEL BEAM

THE EXISTING SLAB SOUTH OF GRID 10 IS TO BE LEVELED WITH A CONCRETE TOPPING. TOPPING TO BE 1" THICK AT HIGH POINTS OF EXISTING SLAB AND UP TO APPROXIMATELY 2" THICK AT LOW POINTS. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS ADJACENT TO EXISTING STAIRS THAT WILL NOT BE LEVELED.

APPLY TOPPING AS FOLLOWS:
SCABRIFIED EXISTING SLAB AND BLOW CLEAN WITH COMPRESSED AIR.
COAT WITH BONDING AGENT (ASTM C-892).
PLACE TOPPING SLAB AND STEEL TROWEL FINISH.
CURE FOR MIN 7 DAYS.

ALL DIMENSIONS AND ELEVATIONS MUST BE FIELD VERIFIED BY CONTRACTOR

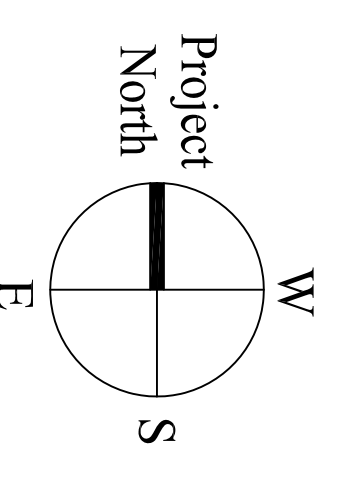

S1.07

Date:	01 July, 2013
Scale:	1/8"=1'-0"
6TH FLOOR / LOWER ROOF FRAMING PLAN	

Revisions:	
1	1 Jul 2013 30% Marriott Submission
2	9 Sep 2013 60% Marriott Sub. & Pric.
3	14 Oct 2013 Bid & Marriott Review

Project: **Press Hotel**

119 Exchange St.
Portland, Maine 04101

Architect: **ARCHETYPE Architects**

48 Union Wharf Portland, Maine 04101
(207) 772-6022 Fax (207) 772-4056

Consulting Engineer: **DESIGN STRUCTURAL CONSULTING**

22 Oakmont Drive
Old Orchard Beach ME
04064-4121
Tel 207.934.8038
Fax 207.934.8039

Prepared For: **119 DEVELOPMENT, LLC**

P.O. Box 7468
Portland, Me 04112