

REFER TO 1/8" ELECTRICAL PLANS FOR POWER AND LIGHTING IN THE COMMON AREAS


ACCESSIBLE AND HEARING IMPAIRED ROOMS PER ARCHITECTURAL PLANS:

201, 207 (HEARING); 222 (ACCESSIBLE)
 307, 322 (HEARING); 309, 323 (ACCESSIBLE)
 407, 422 (HEARING); 410 (ACCESSIBLE)
 502, 523 (HEARING); 516 (ACCESSIBLE)
 601 (HEARING & ACCESSIBLE), 614 (HEARING)
 701, 712 (HEARING); 710 (ACCESSIBLE)

VERIFY LOCATIONS PRIOR TO ROUGH-IN

- LIGHTING KEY NOTES:**
- 1 ILLUMINATED CLOSET ROD FURNISHED WITH INTERIOR PACKAGE, E.C. TO WIRE THEM TO DOOR SWITCH.
 - 2 GUEST ROOM MASTER LIGHT SWITCH. TURNS OFF ALL LIGHTS INCLUDING THE BATH ROOM LIGHTS. PROVIDE ALL INTERCONNECTING WIRING TO PERFORM THIS FUNCTION.

- LIGHTING GENERAL NOTES:**
1. ALL LT-101 J-BOXES TO BE MOUNTED AT +82" AFF.
 2. ALL J-BOXES FOR LT-102 VANITY SCONCE TO BE MOUNTED AT +64" AFF.
 3. ALL LT-103 & LT-103A J-BOXES FOR HEADBOARD SCONCE ARE TO BE MOUNTED AT +54" AFF.
 4. ALL CLOCK OUTLETS FOR LT-105 PICTURE LIGHT TO BE MOUNTED AT +60" AFF.
 5. LT-106 SHOWER LIGHT IS TO BE MOUNTED IN RECESSED CEILING POCKET. SEE DETAIL.
 6. SEE GUESTROOM BATH DRAWINGS, SHT. 107.XX FOR TYPICAL VANITY SCONCE LT-107 LOCATION.
 7. BEDSIDE GOOSENECK READING LIGHT LT-108 IS PLUG-IN. SEE HEADBOARD DETAIL FOR INFO.
 8. ALL LT-109 CORRIDOR PICTURE CLOCK OUTLETS TO BE MOUNTED AT +66" AFF.
 9. DRAPERY VALANCE IS GC PROVIDED. SEE DETAIL.
- GENERAL NOTES:**
1. REFER TO SHEET E3.01 FOR GUEST ROOM GENERAL NOTES AND ELECTRICAL SYMBOLS.

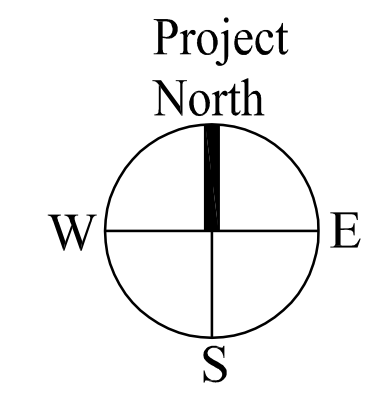

Prepared For: 119 Development, LLC P.O. Box 7468 Portland, ME 04112	Consultant: CHS ENGINEERING CONSTANCE HIGKEY SCOTT, PE 7846 WOOD OAK COVE CORDOVA, TN 38016 TEL: (901) 830-5300 EMAIL: chscot@chsengineering.com	Architect: ARCHETYPE architects 48 Union Wharf Portland, Maine 04101 (207) 772-6022 Fax (207) 772-4056	Project: Press Hotel 119 Exchange St. Portland, ME 04101	Revisions: ISSUED FOR BID 10/14/13	Date: PART B THIRD / FOURTH / FIFTH FLOOR 'GUESTROOM' ELECTRICAL PLANS E3.04
---	--	--	--	--	--