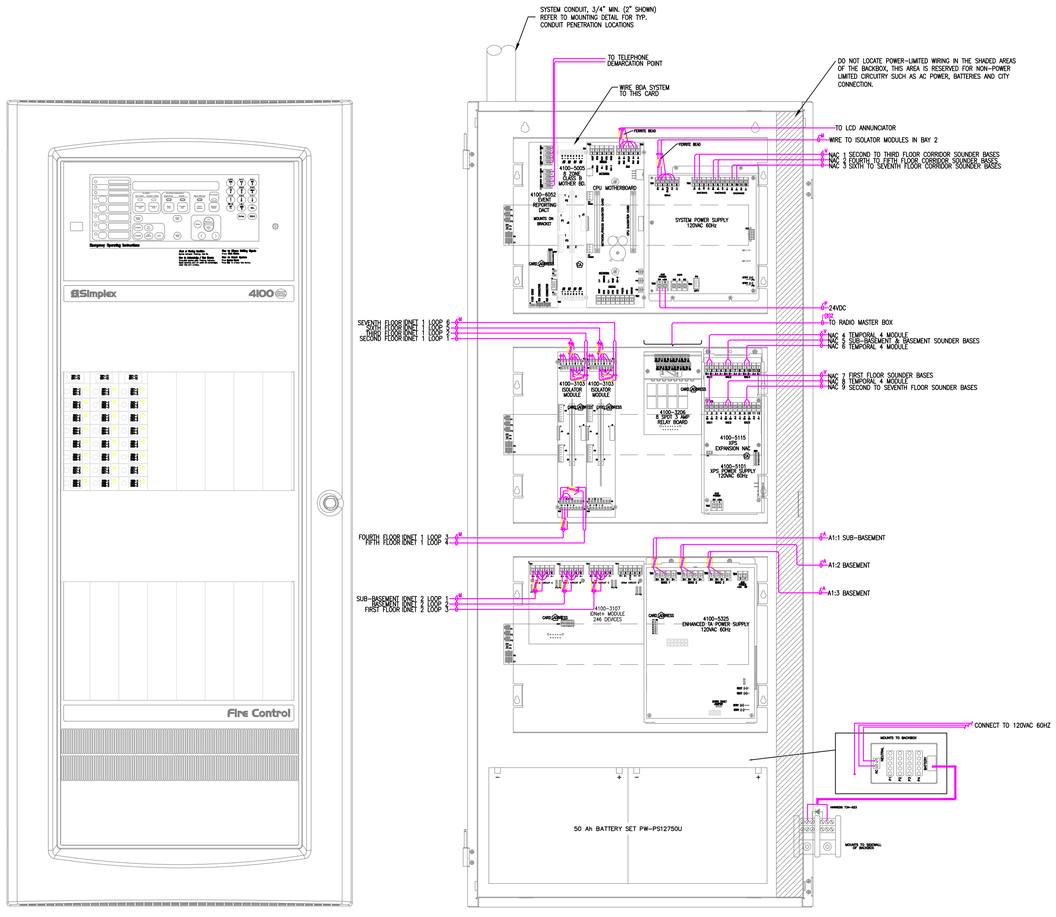

FIRE ALARM CONTROL PANEL
CABINET # 1 – BASEMENT
ELECTRICAL ROOM 007

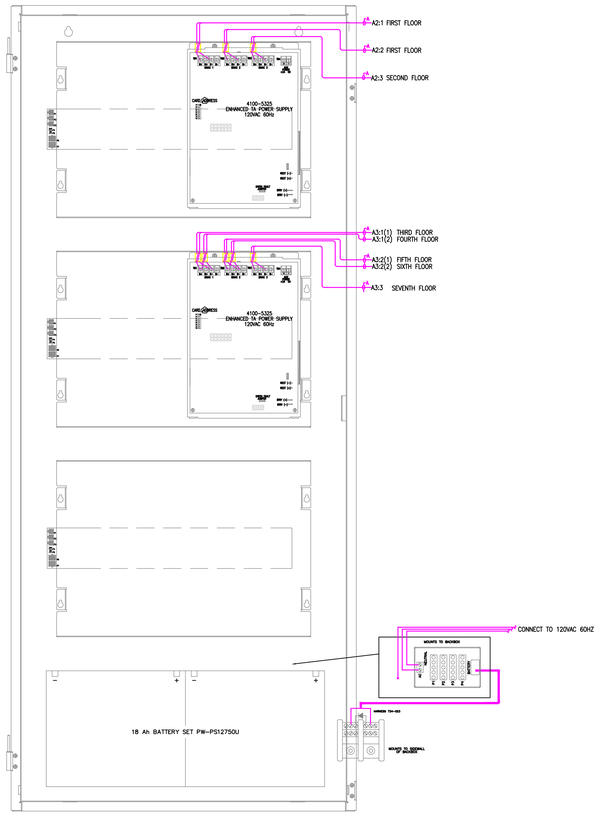

FIRE ALARM CONTROL PANEL
CABINET # 2 – BASEMENT
ELECTRICAL ROOM 007

tyco SimplexGrinnell
Safer. Smarter. Tyco.™
DISTRICT - 147
20 THOMAS DRIVE
WESTBROOK, ME 04092
SERVICE: 207-842-6440
PHONE: 207-842-6440
FAX: 207-842-8439

PRESS HOTEL

PRESS HOTEL
119 EXCHANGE ST
PORTLAND, ME

Revisions shown with △ revised

ISSUE LOG:				
MARK	DATE	CAD	CHK	DESCRIPTION
△	5-28-14	JD	KG	REVISED PER ENGINEERS COMMENTS & ADDED AOR SYSTEM

DRAWN BY:	JD
CHECKED BY:	KG
ISSUE DATE:	4/24/14
JOB #:	977465501
PROJECT #:	147:PRE-BOOKED

SIMPLEXGRINNELL © 2013

SYSTEM:
FIRE ALARM SYSTEM

SHEET:
PANEL DETAIL

FA-501

IMPORTANT NOTICE TO USER: By accepting or using this drawing, you agree to the following conditions: The information contained herein shall be at the sole risk of the user. This information may not be sold or transferred to any third party, used on other projects or additions to this project for which it was prepared, or used for completion of this project by any third party. SimplexGrinnell disclaims all liability for the use or reuse of altered files by the user or any third party and such use will be a user's sole risk. User shall, to the fullest extent permitted by law, defend, indemnify and hold SimplexGrinnell harmless from any and all claims for loss, damage or injury arising directly or indirectly therefrom.

LAST SAVED BY: JUDELACRUZ
LAST PRINTED: 5/29/2014 3:08:36 PM
24" x 36" - Arch D Size