City of Portland, Maine - Building or Use Permit Application 389 Congress Street, 04101, Tel: (207) 874-8703, FAX: 874-8716

Location of Construction: ** 29 Exchange Street Portland **	Owner: B6C Limited	- 91	Phone:		Permit No: 0859
Owner Address: 54 Burwell ave south portland	Lessee/Buyer's Name:	Phone: 773-2900	Business	Name:	PERMIT ISSUED
Contractor Name:	Address:	Phon	ie:		Permit Issued:
Past Use: Restaurant	Proposed Use:	COST OF WOR \$ FIRE DEPT.		PERMIT FEE: \$ 26.69 INSPECTION: 519199 Use Group: Type:	
		Cianaturat		BOCA 86-100	Zone: CBL: 032-E-009
Signature: Signature: Proposed Project Description: PEDESTRIAN ACTIVITIES DISTRICT (A.D.) Action: Approved Action: Approved Approved with Conditions: Denied					Zoning Approval: Special Zone or Reviews: Shoreland Wetland Flood Zone
		Signature:		Date:	□ Subdivision
 Permit Taken By: This permit application does not preclude the A Building permits do not include plumbing, sep Building permits are void if work is not started tion may invalidate a building permit and stop 	□ Site Plan maj □minor □mm □ Zoning Appeal □ Variance □ Miscellaneous □ Conditional Use □ Interpretation □ Approved				
CERTIFICATION I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit					□ Denied Historic Preservation □ Not in District or Landmark □ Does Not Require Review □ Requires Review Action: □ Appoved □ Approved with Conditions □ Denied Date:
SIGNATURE OF APPLICANT	ADDRESS:	DATE:		PHONE:	
RESPONSIBLE PERSON IN CHARGE OF WORK	K, TITLE rmit Desk Green–Assessor's Cana	y-D.P.W. Pink-Pu		PHONE:	

THIS IS NOT A PERMIT/CONSTRUCTION CANNOT COMMENCE UNTIL THE PERMIT IS ISSUED

Sign Permit Pre-Application Attached Single Family Dwellings/Two-Family Dwelling Multi-Family or Commercial Structures and Additions Thereto

In the interest of processing your application in the quickest possible manner, please complete the Information below for a Building or Use Permit.

NOTE**If you or the property owner owes real estate or personal property taxes or user charges on ANY PROPERTY within the City, payment arrangements must be made before permits of any kind are accepted.

Location/Addressof Construction (include Portion of Building):	Pertland me oyioit	* Robert Morrison
Total Square Footage of Proposed Structure Struct 319. 8 PT 59.	Square Footage of Lot	
Tax Assessor's Chart, Block & Lot Number Chart#033 Block#E Lot#009	Owner: Bot C Limited Hura Sun Bac	Telephone#: 207 -773 - 2900
Owner's Address: 54 Burnell ave S. Portland me oyist	Lessee/Buyer's Name (If Applicable) Fufi Hua Sun Bae Rest	Total Sq. Ft. of Sign Fee 8 States de
Proposed Project Description:(Please be as specific as possible)	Free Standing Sorret to display restruct	srant offerings.
Contractor's Name, Address & Telephone		Rec'd Dy
Current Use: Rest	Proposed Use: San	re

Signature of applicant:	Robert Man 1.	Date: 8-12-99
	Signage Permit Fee: \$30.00 plus	.20 per square foot of signage
		A BATS
		6661 5 1 900 L
		ALLO FOOTTAND, ME
		DEPT OF BUILDING INSPECTION

Double Sided IREE STANDING (HARLOORD) 412 " 1. 42 FUNI ROSTALANIT 27 Exchange ST BARTIANA 033-E-609

ARI INSURANCE AGENCY Fax:207-780-6377

Aug 11 1999 16:28 P.01

	SAUDI AUDI AUDI AUDI AUDI AUDI AUDI AUDI	ICATE OF LIA	CONTRACTOR DATA CONTRACTOR DATA			08/10/55	
PRODUCER ARI Insurance Group 25 Middle Street P.O. Box 567		ONLY ANI HOLDER.	THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW.				
	the second se	112.0567	COMPANY		FFORDING COVERAGE		
1501	PED		COMPANY	Peerless Insu	ance Co.		
	Fuji, Inc. 29 Exchange Street		B				
	Portland ME 041	010000	COMPANY				
			COMPANY				
T-IN CI	HAGES IS IS TO CERTIFY THAY THE POUCIES DICATED, NOTWITHSTANDING ANY RE ENTIFICATE MAY BE ISSUED OF MAY ICLUSIONS AND CONDITIONS OF SUC	S OF INSURANCE LISTED BELOW + QUIREMENT, TERM OR CONDITION PERTAIN, THE INSURANCE AFFORD	OF ANY CONTRACT OR DED BY THE POLICIES DE	HE INSURED NAMED OTHER DOCUMENT SCRIBED HEREIN IS	WITH RESPECT TO WHICH	THIS	
OR	TYPE OF INSURANCE	POLICY NUMBER	DATE (MM/00/11)	POLICY EXPIRATION DATE (MM/DD/M)	LIMI	15	
1	GENERAL LIABILITY	CBP9280705	11/06/98	11/06/99	GENERAL AGGREGATE	\$ 2,000,00	
	COMMERCIAL GENERAL LIABILITY				PRODUCTS - COMPIOP AGG	s 2,000,000	
	CLAIMS MADE X OCCUR				PERSONAL & ADV INJURY	\$ 1,000,00	
	OWNER'S & CONTRACTOR'S PROT		ł		EACH OCCURRENCE	\$ 1,000,00	
					FIRE DAMAGE (Any one fire)	\$ 250,00	
					MED EXP (Any one person)	\$ 5,00	
	AUTOMOBILE LIABILITY	CBP9280705	11/06/98	11/06/99	COMBINED SINGLE LIMIT	3 1,000,00	
	ALL OWNED AUTOS				BODILY INJURY (Per parson)	\$	
	X HRED AUTOS X NON-OWNED AUTOS				BODILY INJURY (Por scodent)	3	
			_		PROPERTY DAMAGE	3	
	GARAGE LIABILITY		1		AUTO ONLY - EA ACCIDENT	S	
	ANY AUTO				OTHER THAN AUTO CNLY: EACH ACCIDENT		
-				+	AGGREGATE		
	EXCESS LIABILITY				EACH OCCURRENCE	5	
	UMBRELLA FORM				AGGREGATE	\$	
_	OTHER THAN UNBRELLA FORM				WE STATUL OTH	8	
	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY				WC STATUL OTH. LOBY LIMITS PR	human and a second	
					EL EACH ACCIDENT	8	
	THE PROPRIETOR/ PARTNERS/EXECUTIVE				EL DISCASE - POLICY LIMIT	5	
-	OFFICERS ARE: EXCL				EL DISEASE - EA EMPLOYEE	\$	
4	OTHER	C8P9280705	11/06/98	11/06/99	EACH COMMON CAUSE AGGREGATE LIMIT	1,000,00 2,000,00	
R	RPTION OF OPERATIONSLOCATIONS/VEHICLE SIGN LOCATED AT 29 EXCHANGE IFICATE HOLDER IS NAMED AS AC # 772-4555 CITENDATE HOLDER OITY OF PORTLAND 389 CONGRESS STREET PORTLAND ME	STREET, PORTLAND, ME DDITIONAL INSURED	SHOULD ANY C EXPIRATION DAT 10 DAYS BUT FAILURE TO	TE THEREOF, THE ISSUIN WRITTEN NOTICE TO TH MAIL SUCH NOTICE SI	O POLICIES BE CANCELLED BER IG COMPANY WILL ENDEAVOR T E CERTIFICATE HOLDER NAMED HALL IMPOSE NO OBLIGATION C	O MAIL TO THE LEFT, IR LIABILITY	
FVALLARY ME UTUI				OF ANY KIND UPON THE COMPANY. IT'S AGENTS OR REPRESENTATIVES. AUTHORIZED REPRESENTATIVE Michael S. Reali Michael S. Reali			
			Michael S	Reali (YM	inhall S	Reali	

August 10, 1999

Fuji Restaurant 31 Exchange Street Portland, ME 04101


Dear Sir or Madam,

Please consider this our written approval for you to have a free standing sign located in front of your restaurant located at 31 Exchange Street in Portland, Maine. You will be required to ensure that the sign meets all of the sign standards required by the City of Portland.

Best of luck.

Sincerely, 100 1

B & C Limited Property Owner

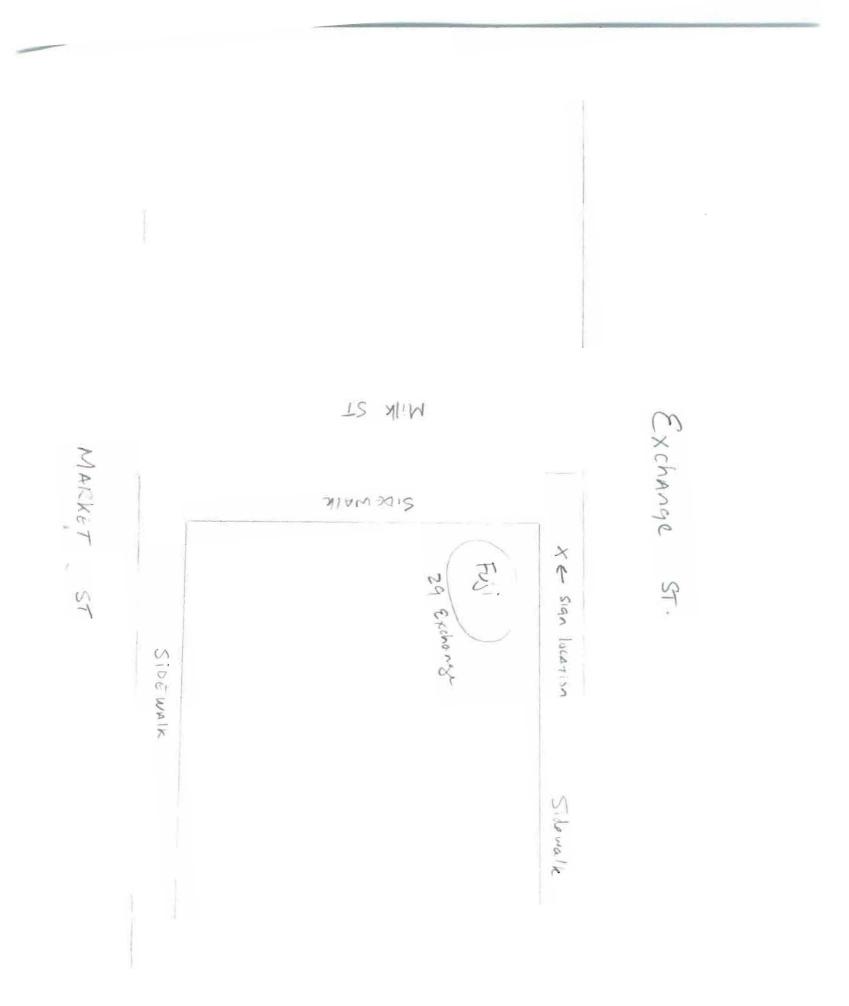

	BUILDING PERMIT REPORT
DA.	re: 13Aug.99 · ADDRESS: 29 Ex Change ST. CBL: Ø 32-E-ØØ9
DA	Contraction of the state of the
REA	ASON FOR PERMIT: SIde walk Sign
BUI	LDING OWNER: BGC Limited
	AMIT APPLICANT:/Contractor
USE	GROUP <u>SIgnage</u> CONSTRUCTION TYPE
The	City's Adopted Building Code (The BOCA National Building Code/1996 with City Amendments) City's Adopted Mechanical Code (The BOCA National Mechanical Code/1993)
	CONDITION(S) OF APPROVAL
This	permit is being issued with the understanding that the following conditions are met: <u>*1</u> , <u>*34</u> , <u>*35</u>
4.00	roved with the following conditions:
App	Toved with the following conditions.
X1.	This permit does not excuse the applicant from meeting applicable State and Federal rules and laws.
2.	Before concrete for foundation is placed, approvals from the Development Review Coordinator and Inspection Services must be obtained.
3.	(A 24 hour notice is required prior to inspection) Foundation drain shall be placed around the perimeter of a foundation that consists of gravel or crushed stone containing not more than
э.	10 percent material that passes through a No. 4 sieve. The drain shall extend a minimum of 12 inches beyond the outside edge of the
	footing. The thickness shall be such that the bottom of the drain is not higher than the bottom of the base under the floor, and that the
	top of the drain is not less than 6 inches above the top of the footing. The top of the drain shall be covered with an approved filter
	membrane material. Where a drain tile or perforated pipe is used, the invert of the pipe or tile shall not be higher than the floor
	elevation. The top of joints or top of perforations shall be protected with an approved filter membrane material. The pipe or tile shall be
28	placed on not less than 2" of gravel or crushed stone, and shall be covered with not less than 6" of the same material. Section 1813.5.2
4.	Foundations anchors shall be a minimum of 1/2" in diameter, 7" into the foundation wall, minimum of 12" from corners of foundation and
5	a maximum 6' o.c. between bolts. (Section 2305.17) Waterproofing and dampproofing shall be done in accordance with Section 1813.0 of the building code.
5. 6.	Precaution must be taken to protect concrete from freezing. Section 1908.0
7.	It is strongly recommended that a registered land surveyor check all foundation forms before concrete is placed. This is done to verify
7.	that the proper setbacks are maintained.
8.	Private garages located beneath habitable rooms in occupancies in Use Group R-1, R-2, R-3 or I-1 shall be separated from adjacent
	interior spaces by fire partitions and floor/ceiling assembly which are constructed with not less than 1-hour fire resisting rating. Private
	garages attached side-by-side to rooms in the above occupancies shall be completely separated from the interior spaces and the attic area
	by means of 1/2 inch gypsum board or the equivalent applied to the garage means of 1/2 inch gypsum board or the equivalent applied to the
	garage side. (Chapter 4, Section 407.0 of the BOCA/1996)
9.	All chimneys and vents shall be installed and maintained as per Chapter 12 of the City's Mechanical Code. (The BOCA National
10 Mar	Mechanical Code/1993). Chapter 12 & NFPA 211
10.	Sound transmission control in residential building shall be done in accordance with Chapter 12, Section 1214.0 of the City's Building
	Code. Guardrails & Handrails: A guardrail system is a system of building components located near the open sides of elevated walking surfaces
11.	for the purpose of minimizing the possibility of an accidental fall from the walking surface to the lower level. Minimum height all Use
	Groups 42", except Use Group R which is 36". In occupancies in Use Group A, B, H-4, I-1, I-2, M and R and public garages and open
	parking structures, open guards shall have balusters or be of solid material such that a sphere with a diameter of 4" cannot pass through
	any opening. Guards shall not have an ornamental pattern that would provide a ladder effect. (Handrails shall be a minimum of 3e4" but
	not more than 38". Use Group R-3 shall not be less than 30", but not more than 38".) Handrail grip size shall have a circular cross section
	with an outside diameter of at least 1 1/4" and not greater than 2". (Sections 1021 & 1022.0) - Handrails shall be on both sides of
	stairway. (Section 1014.7)
12.	Headroom in habitable space is a minimum of 76° (Section 1204.0)
13.	Stair construction in Use Group R-3 & R-4is a minimum of 10" tread and 7 %" maximum rise. All other Use Group minimum 11"
	tread, 7" maximum rise. (Section 1014.0)
14.	The minimum headroom in all parts of a stairway shall not be less than 80 inches. (6'8") 1014.4
15.	Every sleeping room below the fourth story in buildings of Use Groups R and 1-1 shall have at least one operable window or exterior door
	and the amore and a second the units must be operable from the inside without the use of special knowledge of per
	tools. Where windows are provided as means of egress or rescue they shall have a sill height not more than 44 menes (1110mm) even
	the floor. All egress or rescue windows from sleeping rooms shall have a minimum net clear opening height dimension of 24 inches (610mm). The minimum net clear opening width dimension shall be 20 inches (508mm), and a minimum net clear opening of 5.7 sq. ft.

- •
- (610mm). The minimum net clear opening width dimension shall be 20 inches (508mm), and a minimum net clear opening of 5.7 sq. (Section 1018.6) Each apartment shall have access to two (2) separate, remote and approved means of egress. A single exit is acceptable when it exits directly from the apartment to the building exterior with no communications to other apartment units. (Section 1010.1) 16.

- 17. All vertical openings shall be enclosed with construction having a fire rating of at least one (1) hour, including fire doors with self closer's. (Over 3 stories in height requirements for fire rating is two (2) hours.) (Section 710.0)
- 18. The boiler shall be protected by enclosing with (1)hour fire rated construction including fire doors and ceiling, or by providing automatic extinguishment. (Table 302.1.1)
- 19. All single and multiple station smoke detectors shall be of an approved type and shall be installed in accordance with the provisions of the City's Building Code Chapter 9, Section 920.3.2 (BOCA National Building Code/1996), and NFPA 101 Chapter 18 & 19. (Smoke detectors shall be installed and maintained at the following locations):
 - In the immediate vicinity of bedrooms
 - In all bedrooms
 - In each story within a dwelling unit, including basements

In addition to the required AC primary power source, required smoke detectors in occupancies in Use Groups R-2, R-3 and I-1 shall receive power from a battery when the AC primary power source is interrupted. (Interconnection is required) Section 920.3.2.

- 20. A portable fire extinguisher shall be located as per NFPA #10. They shall bear the label of an approved agency and be of an approved type. (Section 921.0)
- 21. The Fire Alarm System shall maintained to NFPA #72 Standard.
- 22. The Sprinkler System shall maintained to NFPA #13 Standard.
- 23. All exit signs, lights and means of egress lighting shall be done in accordance with Chapter 10 Section & Subsections 1023.0 & 1024.0 of the City's Building Code. (The BOCA National Building Code/1996)
- 24. Section 25-135 of the Municipal Code for the City of Portland states, "No person or utility shall be granted a permit to excavate or open any street or sidewalk from the time of November 15 of each year to April 15 of the following year".
- 25. The builder of a facility to which Section 4594-C of the Maine State Human Rights Act Title 5 MRSA refers, shall obtain a certification from a design professional that the plans commencing construction of the facility, the builder shall submit the certification the Division of Inspection Services.
- 26. Ventilation shall meet the requirements of Chapter 12 Sections 1210.0 of the City's Building Code. (Crawl spaces & attics).
- 27. All electrical, plumbing and HVAC permits must be obtained by a Master Licensed holders of their trade. No closing in of walls until all electrical (min.72 hours notice) and plumbing inspections have been done.
- 28. All requirements must be met before a final Certificate of Occupancy is issued.
- 29. All building elements shall meet the fastening schedule as per Table 2305.2 of the City's Building Code (the BOCA National Building Code/1996).
- 30. Ventilation of spaces within a building shall be done in accordance with the City's Mechanical Code (The BOCA National Mechanical Code/1993). (Chapter M-16)
- 31. Please read and implement the attached Land Use Zoning report requirements.
- 32. Boring. cutting and notching shall be done in accordance with Sections 2305.4.4, 2305.5.1 and 2305.5.3 of the City's Building Code.
- 33. Glass and glazing shall meet the requirements of Chapter 24 of the building code.
- X 34. All signage, shall be done in accordance with Section 3102.0 signs of the City's Building Code, (The BOCA National Building Code 1996).

¥35.	All Signwalk sign Shall meet The Gity's requirements
36.	
37.	
38.	
P. sandi cc:	Artotices, Britding Inspector Lt. McDobgell, PFD Marge Schmuckal, Zoning Administrator

PSH 7/21,99

**On the basis of plans submitted and conditions placed on these plans any deviations shall require a separate approval.

Foundation: Framing: Plumbing: Final: Other:			2/1/00 Checked sign - OK &B
Type Date			