



KEY PLAN
SCALE: N.T.S.

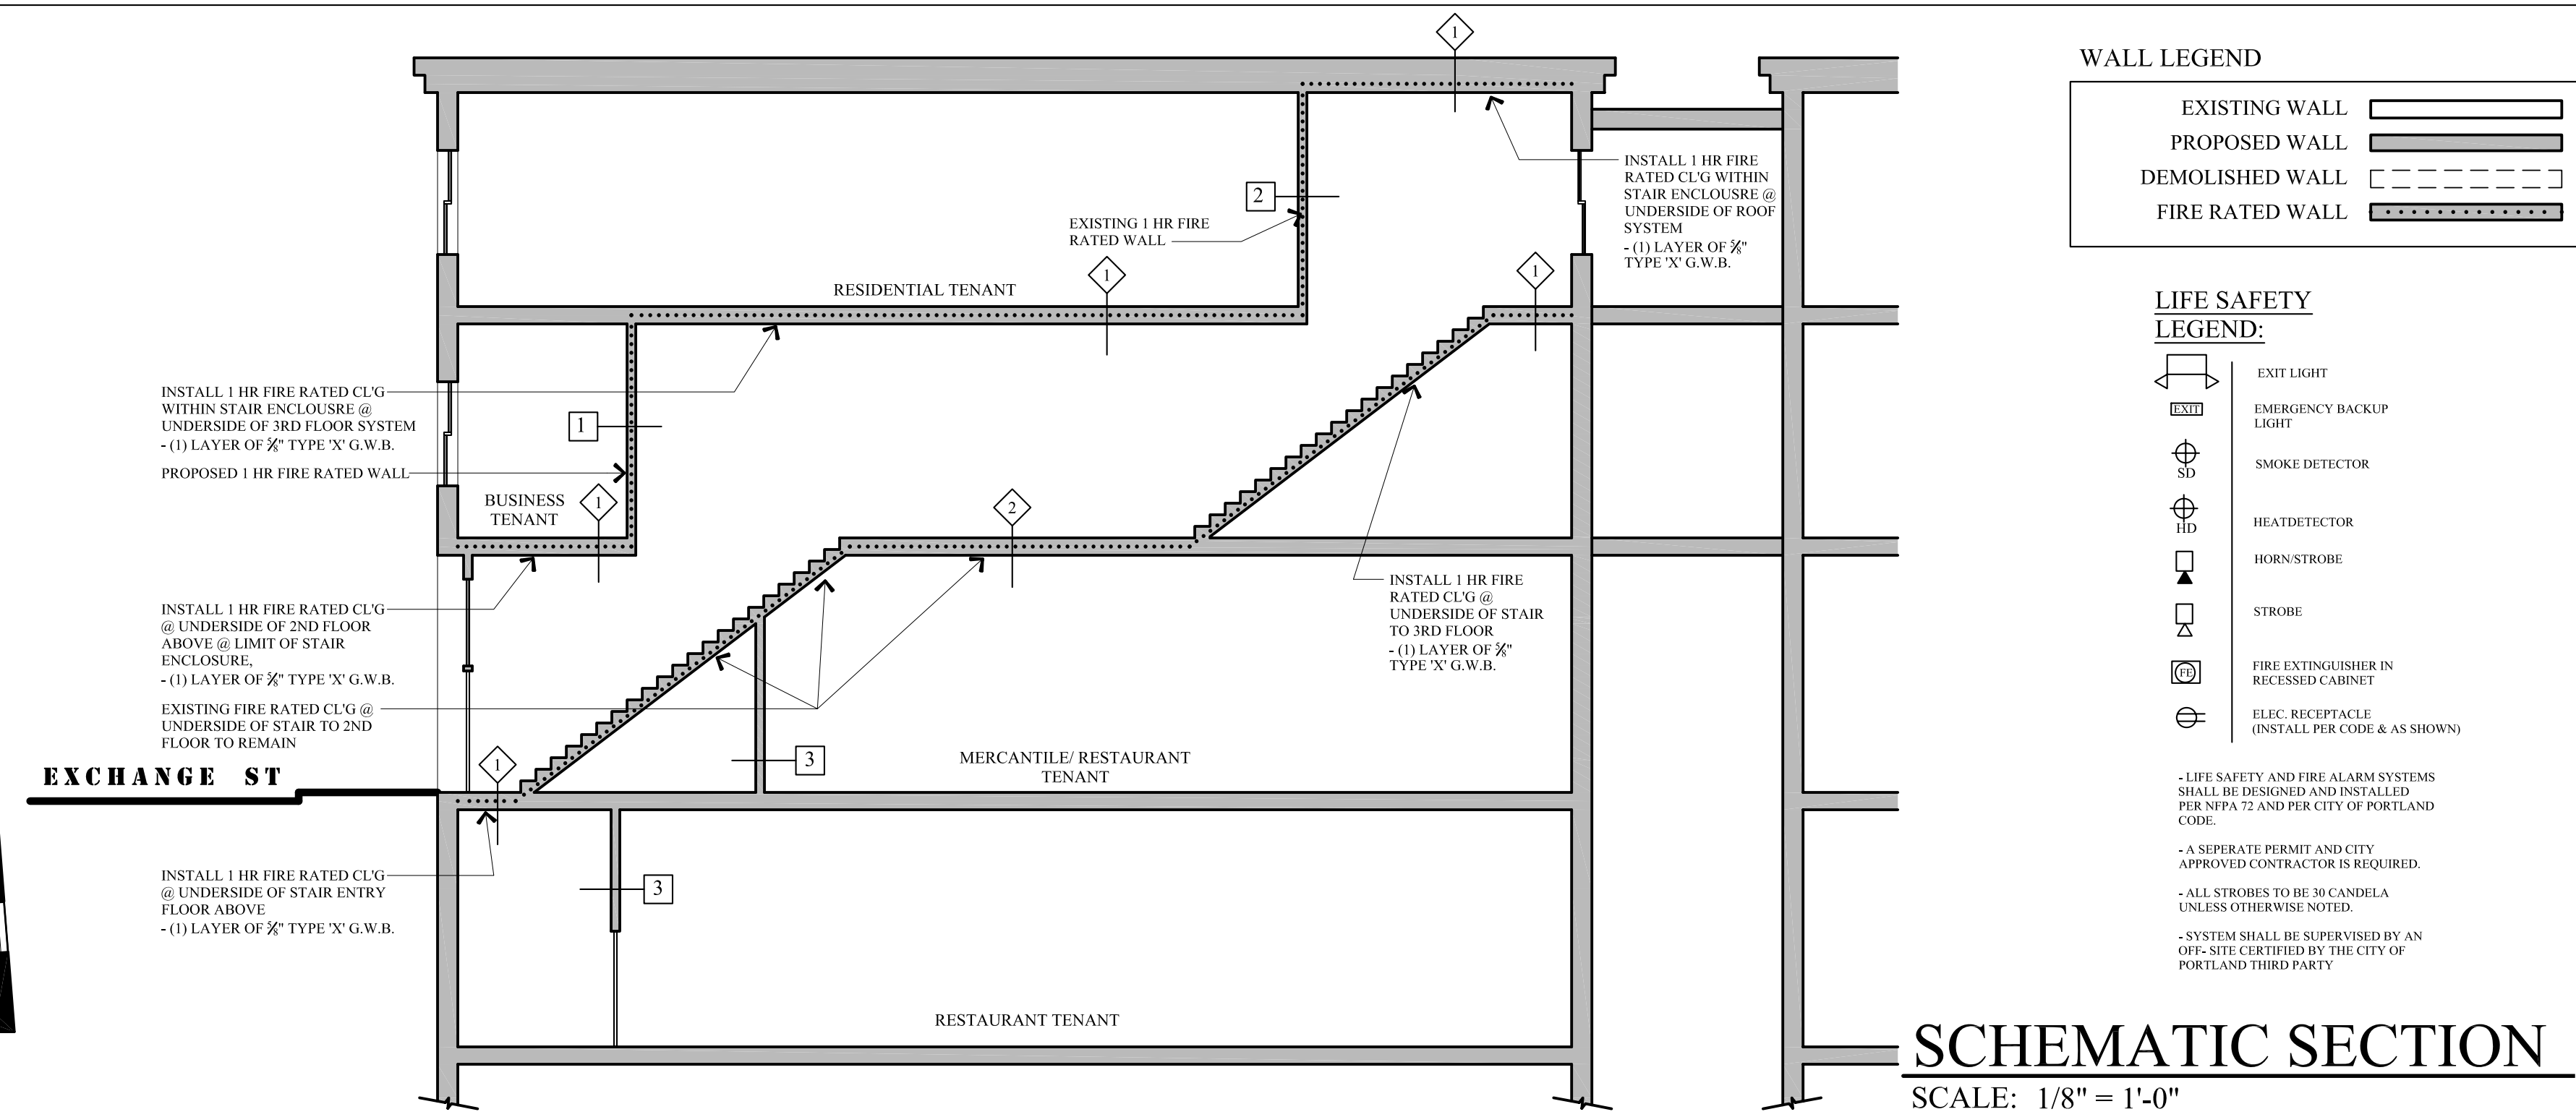


- WALL LEGEND**
- EXISTING WALL
 - PROPOSED WALL
 - DEMOLISHED WALL
 - FIRE RATED WALL
- LIFE SAFETY LEGEND:**
- EXIT LIGHT
 - EMERGENCY BACKUP LIGHT
 - SMOKE DETECTOR
 - HEAT DETECTOR
 - HORN/STROBE
 - STROBE
 - FIRE EXTINGUISHER IN RECESSED CABINET
 - ELEC. RECEPTACLE (INSTALL PER CODE & AS SHOWN)
- LIFE SAFETY AND FIRE ALARM SYSTEMS SHALL BE DESIGNED AND INSTALLED PER NFPA 72 AND PER CITY OF PORTLAND CODE.
- A SEPARATE PERMIT AND CITY APPROVED CONTRACTOR IS REQUIRED.
- ALL STROBES TO BE 30 CANDELA UNLESS OTHERWISE NOTED.
- SYSTEM SHALL BE SUPERVISED BY AN OFF-SITE CERTIFIED BY THE CITY OF PORTLAND THIRD PARTY.

SCHEMATIC SECTION
SCALE: 1/8" = 1'-0"

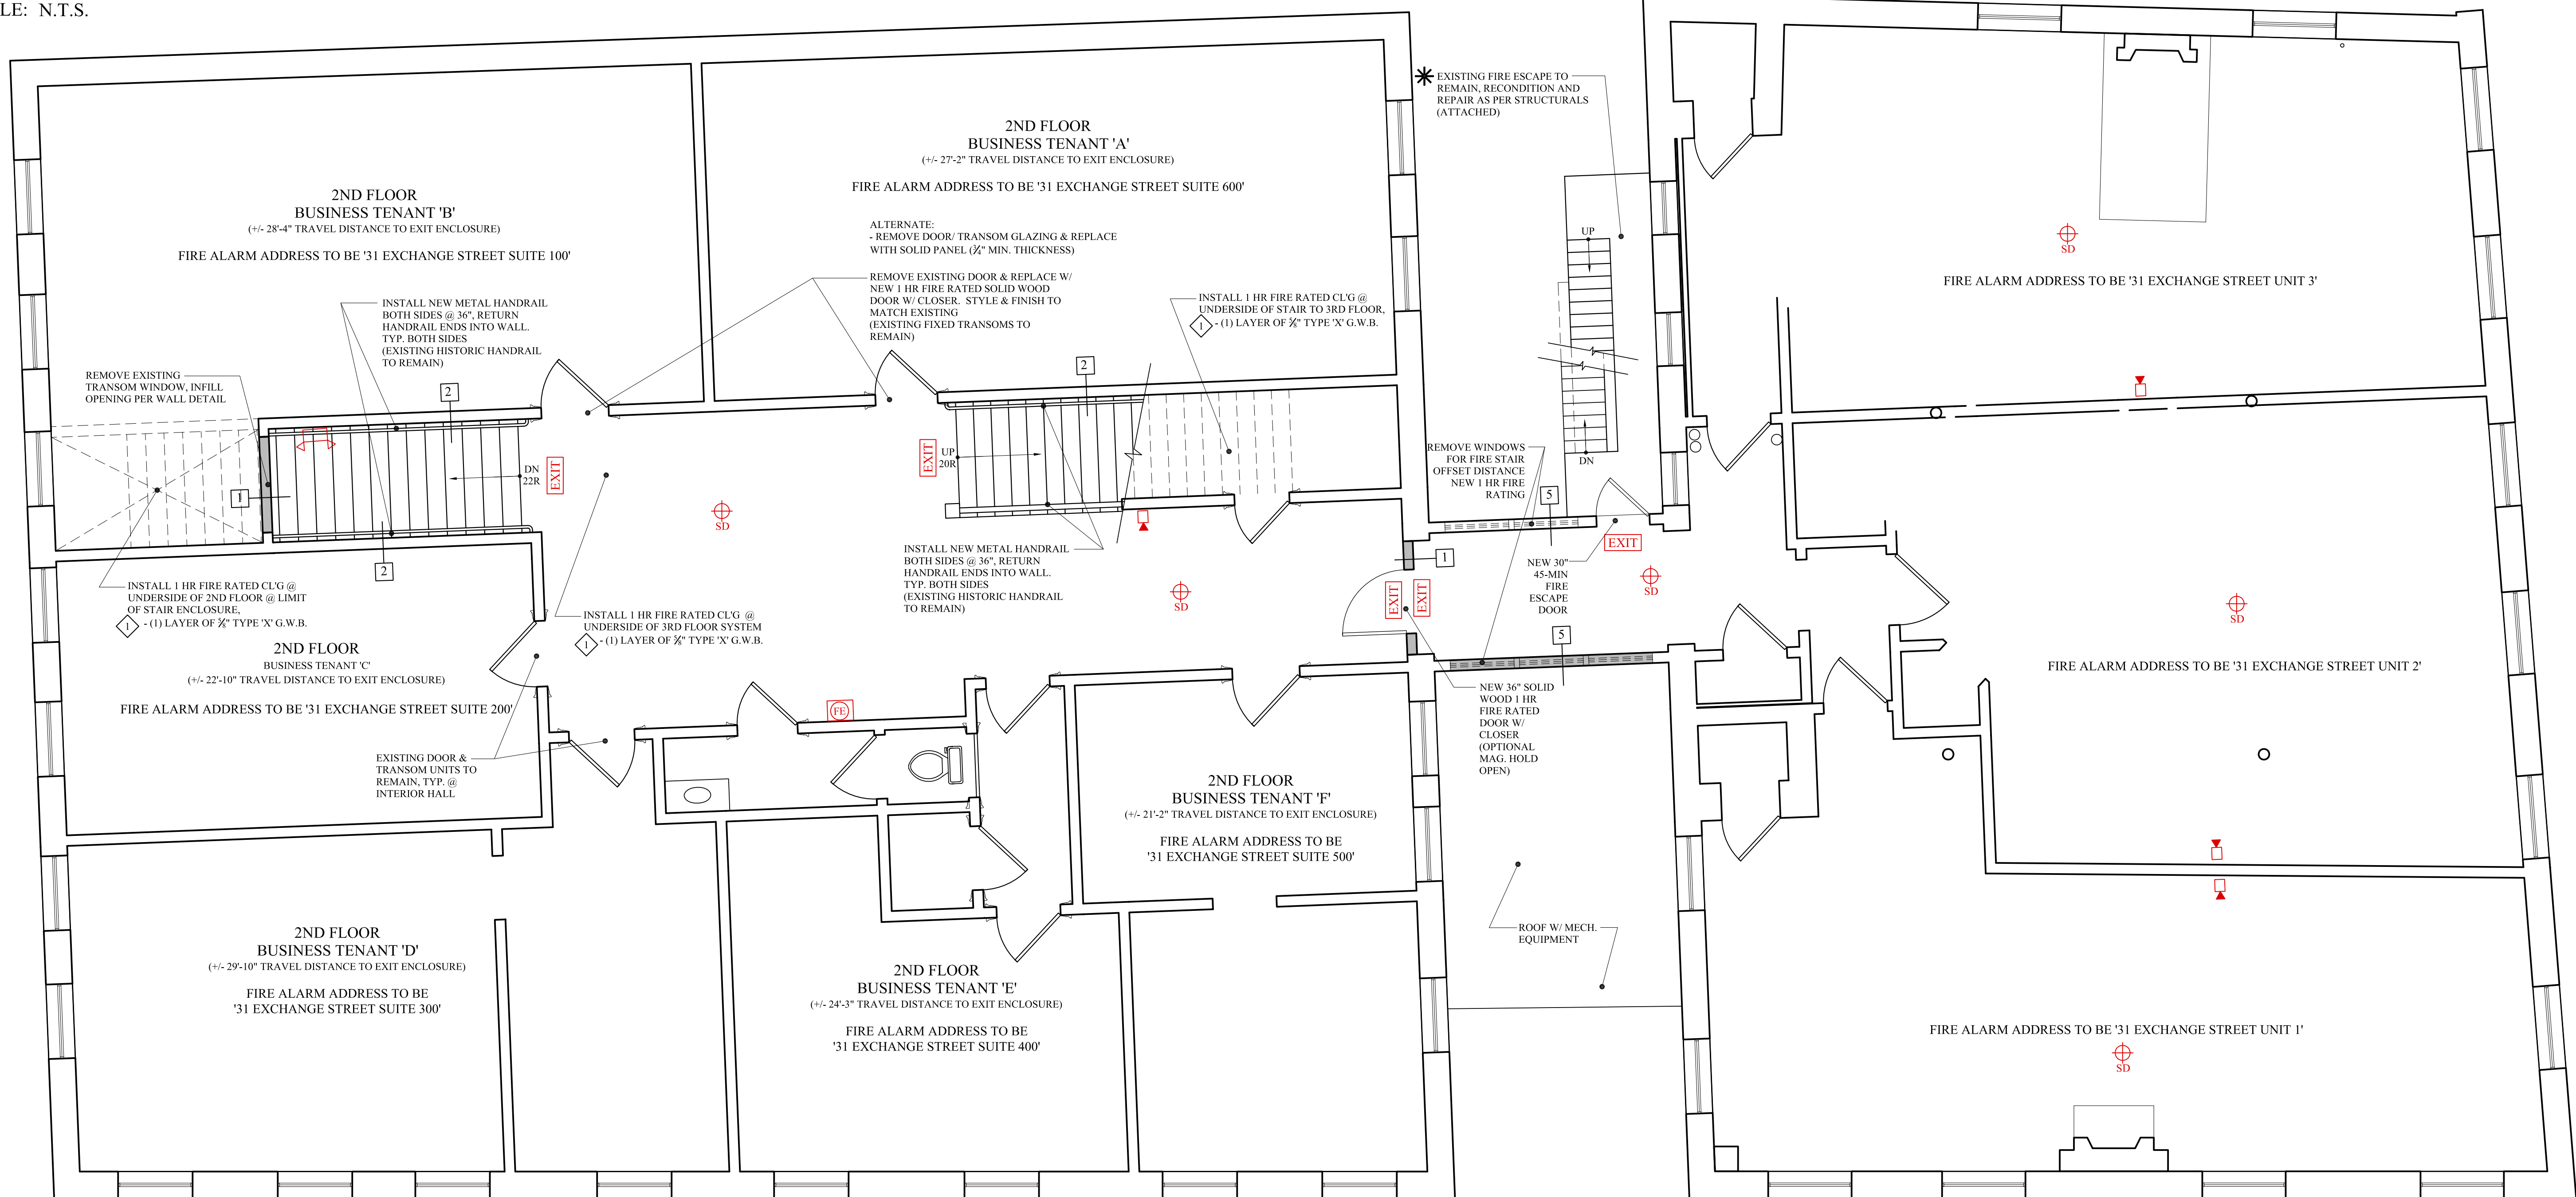

SECOND FLOOR PLAN
SCALE: 1/4" = 1'-0"

BUILDING PERMIT SET: JANUARY 15, 2015

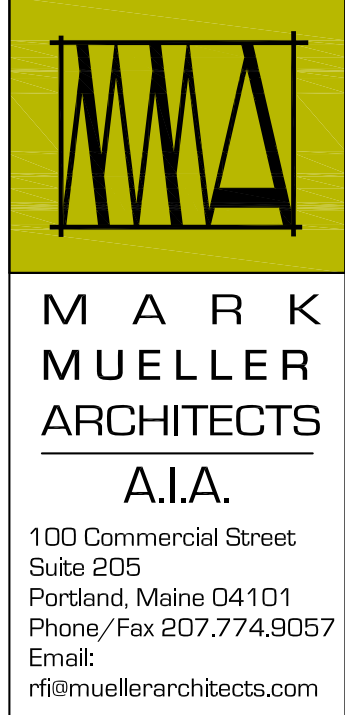

© COPYRIGHT 2013
MARK MUELLER ARCHITECTS

LIFE SAFETY REMEDIATION AT:
31 EXCHANGE STREET
31 EXCHANGE STREET
PORTLAND, MAINE

PROPOSED 2ND FLOOR PLAN

REVISIONS:
DATE: MAY 2013
PROJECT: 31 EXCHANGE
DRAWN BY: MRP
CHECK BY: MLM

A-1.2