EMERGENCY LIGHT
FIRE ALARM CONTROL PANEL

STROBE ONLY NOTIFICATION

HORN/STROBE NOTIFICATION

FIRE ALARM PULL STATION

CHILLED BEAM DIFFUSER


SMOKE DETECTOR

DEVICE

DEVICE

EXIT SIGN



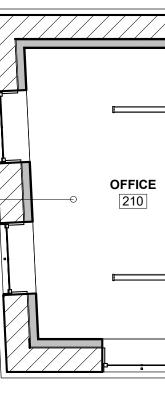

## **GENERAL CEILING NOTES:**

1. EXISTING SPRINKLER PIPES TO BE RELOCATED AS REQUIRED TO FIT ABOVE CEILING HEIGHTS SHOWN ON DRAWINGS. PROVIDE NEW DROPS TO CONCEALED HEADS IN NEW OPEN OFFICE AREAS, TYP. PROVIDE NEW DROPS TO PENDANT HEADS IN TOILET ROOMS AND STORAGE ROOMS. MODIFICATIONS TO SPRINKLER SYSTEM TO BE DESIGN-BUILD BY SPRINKLER SUB-CONTRACTOR TO MEET REQUIREMENTS OF NFPA 13.

ELECTRICAL/LIGHTING SYMBOL LEGEND

⇒⊂**N** 

Ň

SD

EXIT

 $\bigotimes$ 

 $\square$ +

FACP

SURFACE MOUNTED LIGHT

RECESSED LIGHT FIXTURE

4' SURFACE MOUNTED LIGHT

WALL MOUNTED LIGHT

EXHAUST FAN/LIGHT

UNDER-CABINET LIGHT

PENDANT LIGHT FIXTURE

2X2 LED TROFFER

WALL MOUNTED STRIP LIGHT

FIXTURE

FIXTURE

FIXTURE

FIXTURE

LED PENDANT STRIP LIGHT

 $-\bigcirc-$ 

 $\bigcirc$ 

 $\oplus$ 

0

0

X

 $| \bigcirc |$ 

- 2. COORDINATE ALL CEILING HEIGHTS IN THE FIELD WITH STRUCTURAL CONDITIONS, MECHANICAL, ELECTRICAL AND PLUMBING TRADES.
- 3. SEAL ALL PENETRATIONS IN RATED WALLS AND IN FLOOR AND CEILING ASSEMBLIES WITH FIRE-STOPPING TO REDUCE THE RISK OF THE SPREAD OF FIRE AND SMOKE.
- 4. PROVIDE FIRE ALARM SYSTEM WITH SMOKE DETECTORS, PULL STATIONS AND NOTIFICATION DEVICES IN COMPLIANCE WITH NFPA 101 AND NFPA 72. 5. CONTRACTOR OR ELECTRICAL ENGINEER SHALL EVALUATE POWER SUPPLY TO BUILDING TO
- DETERMINE IF UPGRADES OR MODIFICATIONS ARE REQUIRED TO ACCOMMODATE NEW ELECTRICAL EQUIPMENT LOADS. 6. RELOCATED AND NEW DEVICES TO BE INSTALLED PER REQUIREMENTS OF APPLICABLE CODES
- AND REGULATIONS. VERIFY COMPLIANCE OF EXISTING DEVICES TO REMAIN PER SAID CODES AND REGULATIONS. 7. MECHANICAL, PLUMBING, AND ELECTRICAL INSTALLATIONS TO BE PROVIDED PER APPLICABLE
- CODES. CONTRACTOR IS TO SEEK APPLICABLE PLUMBING AND ELECTRICAL PERMITS AS REQUIRED BY AUTHORITIES HAVING JURISDICTION. OWNER TO PROVIDE, GC TO COORDINATE. 8. LIGHT FIXTURES TO BE LED LUMINAIRES AT 3500 KELVIN.

## **CEILING TYPES:**

- GYPSUM WALL BOARD GWB
- GWB 1-HR TYPE-X GYPSUM WALL BOARD, 1-HOUR FIRE-RATED ASSEMBLY
- EX-GWB EXISTING GYPSUM WALL BOARD ACT-1 ARMSTRONG ULTIMA SHIPLAP ACOUSTICAL CEILING TILE ACT-2 ARMSTRONG METALWORKS LINEAR SUSPENDED CEILING

## LIGHT FIXTURE TYPES:

- A FLUXWERX, INBOX, 2X2 TROFFER • B FLUXWERX, VIEW, LINEAR PENDANT
- C FLUXWERX, PROFILE, LINEAR PENDANT
- D FLUXWERX, NOTCH 2, LINEAR RECESSED
- E WALL SCONCE, TBD • F WALL SCONCE, TBD
- G SURFACE MOUNTED, TBD
- H PENDANT, TBD
- J EXTERIOR LED WALL PACK
- K 4' LINEAR SURFACE MOUNT • L 4" LED RECESSED DOWNLIGHT
- M LUCE & LIGHT, SMOOTHY 2, LED RECESSED DOWNLIGHT
- N LUCE & LIGHT, SPOT 1, EXTERIOR LED SIGN LIGHT



