


CLIENT/OWNER/TENANT
FAT FACE LTD
1-3 RIDGWAY HAVANT, PO9 1QJ
UNITED KINGDOM
CONTACT: DAVID LILLEY
TEL: 0044.2392.441100
E: DAVID.LILLEY@FATFACE.COM

DESIGNER
BOX OF FROGS LTD
2 WILLOW PARK STROKE POGES BUCKS SL2 4ES
CONTACT: SARAH MALCOM-RICHARDS
TEL: 007748606997
E: SARAH@BOXOFFROGS.WEB.COM

MEP ENGINEER
FISKAA
589 8TH AVENUE
NEW YORK, NY, 10018
CONTACT: ERIC MARTINSEN
TEL: 212.736.9500
E: EMARTINSEN@FISKAA.COM

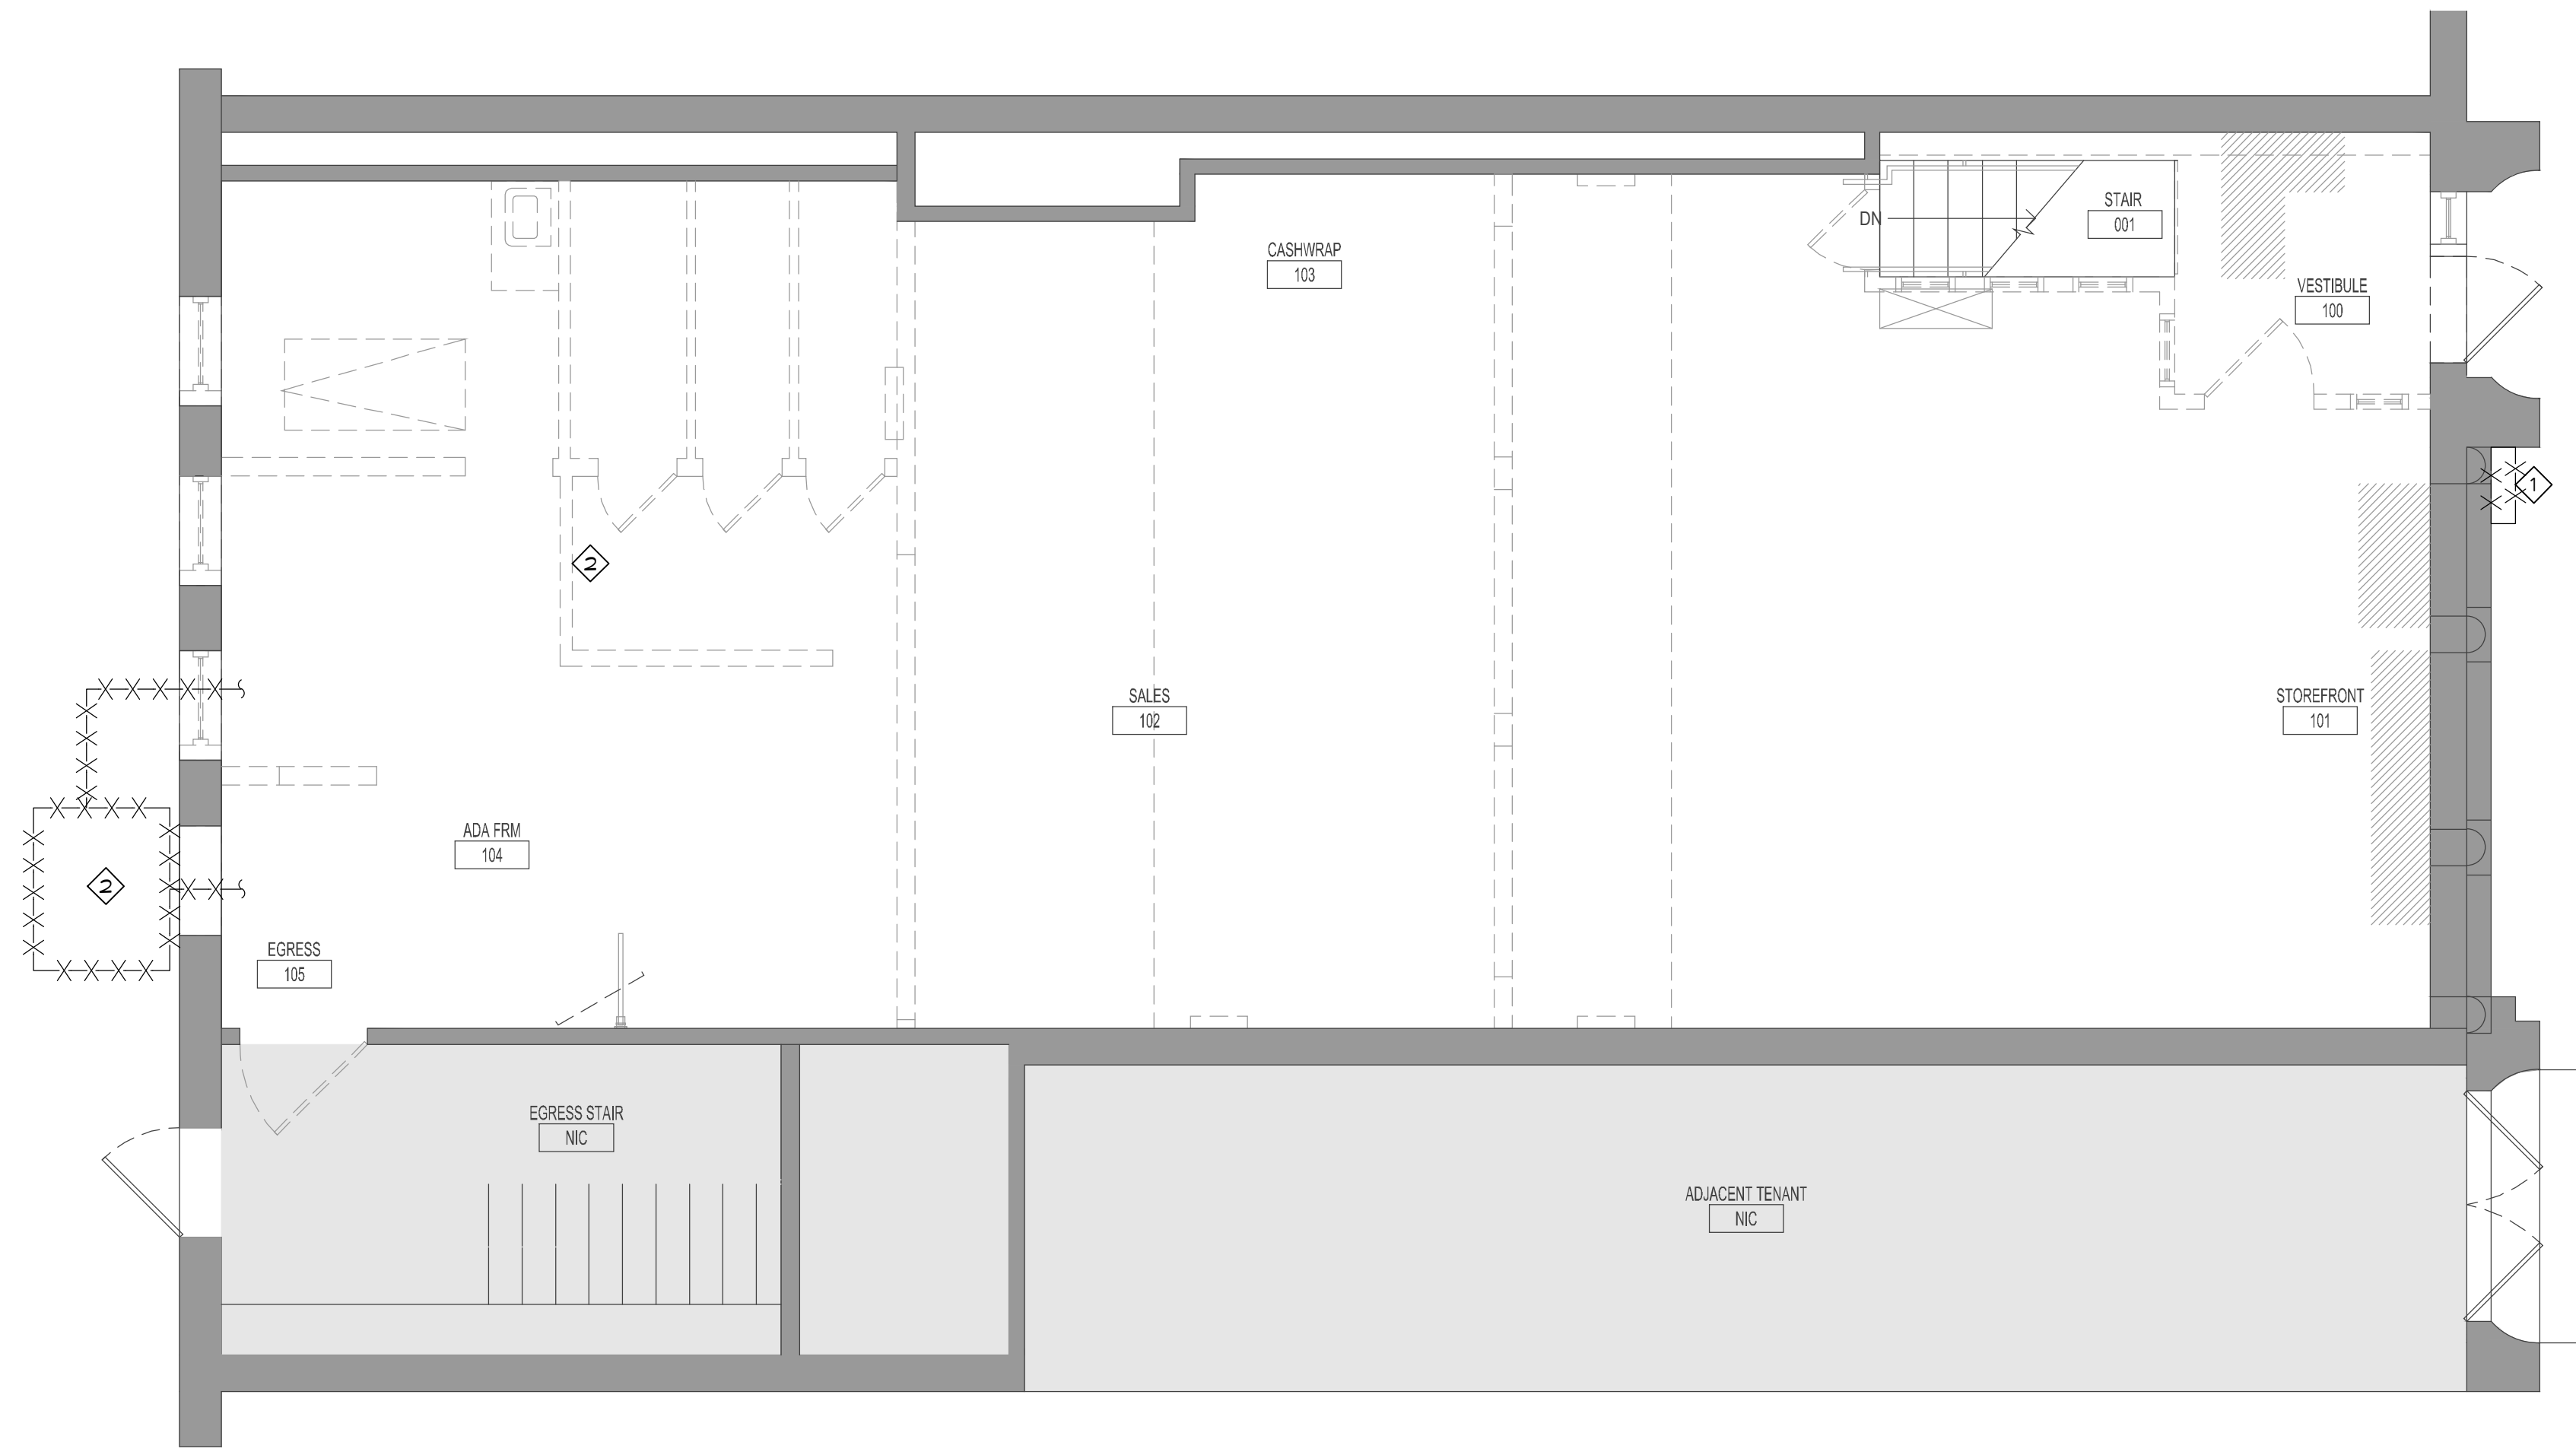

H. V. A. C. G R O U N D F L O O R D E M O L I T I O N P L A N

SCALE: 1/4" = 1'-0"

PLAN NOTES:

1. REMOVE EXISTING SUPPLY AIR DUCTWORK WITH ALL ASSOCIATED BRANCHES, DIFFUSERS, COLLARS, STRAPS, AND DAMPERS AS INDICATED ON THE DEMOLITION PLAN.
2. ALL EXISTING SUPPLY DIFFUSERS AND RETURN REGISTERS TO REMAIN OR TO BE RELOCATED ARE INDICATED ON THE M-300 SHEET.
3. REMOVE ALL MECHANICAL ITEMS NOT BEING REUSED.
4. CONTRACTOR SHALL PROTECT ANY EXISTING DIFFUSER/GRILLE, VAV BOX, TEMPERATURE CONTROLS, ETC. TO REMAIN THROUGHOUT CONSTRUCTION.
5. PROVIDE TRAVERSE READING AT EACH EXISTING EVAPORATOR UNIT TO REMAIN INDICATING TOTAL CFM AND STATIC PRESSURE. PROVIDE REPORT TO ENGINEER.

REFERENCE NOTES:

1. EXISTING PENTHOUSE LOUVER AND ALL ASSOCIATED DUCTWORK SHALL BE REMOVED. CONTRACTOR SHALL PATCH AND SEAL ALL OPENINGS AND MAINTAIN FIRE RATINGS.
2. EXISTING AIR COOLED PACKAGED UNIT, ASSOCIATED DUCTWORK AND DIFFUSERS SHALL BE REMOVED COORDINATE WALL INFILL WITH ARCHITECT.


Issue	Date	Issue	Date
A. ISSUE FOR LL REVIEW & HISTORIC REVIEW	07/10/2015		
B. ISSUE FOR DEMO PERMIT	07/20/2015		

Project:
FAT FACE PORTLAND
34 EXCHANGE STREET
PORTLAND, ME 04104

Drawing Title
GROUND FLOOR
DEMOLITION PLAN

Project No.	Drawn By	Date	Scale
15.102.00			---

Seal	XX	Floor(s)	Drawing No.
			M-201

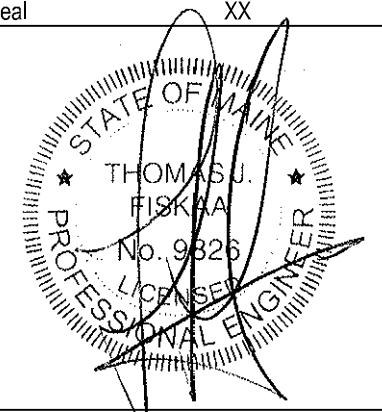

THESE PLANS ARE APPROVED ONLY FOR THE WORK INDICATED ON THE APPLICATION SPECIFICATION SHEET. ALL OTHER MATTERS SHOWN ARE NOT TO BE RELIED UPON OR TO BE CONSIDERED AS EITHER BEING APPROVED OR IN ACCORDANCE WITH APPLICABLE CODES.