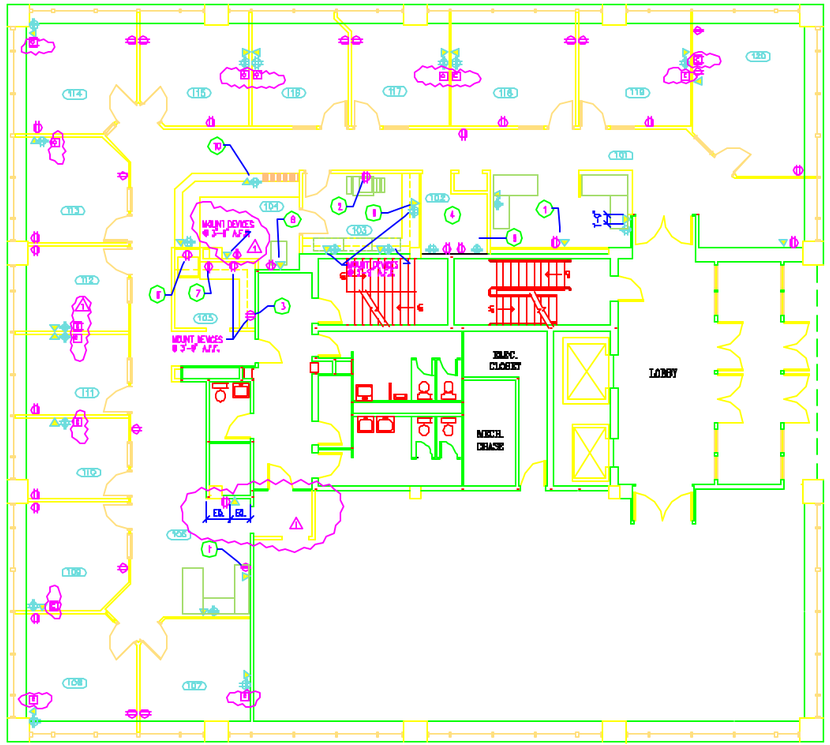

SYMBOL LEGEND

- NEW DUPLEX ELECTRICAL OUTLET.
- NEW DOUBLE DUPLEX ELECTRICAL OUTLET.
- NEW TELEPHONE / DATA OUTLET: PROVIDE SINGLE GANG BOX AND 1" EMPTY CONDUIT STUB WITH PULL WIRE TO PLENUM.
- NEW CABLE TV. OUTLET: PROVIDE SINGLE GANG BOX AND 1" EMPTY CONDUIT STUB WITH PULL WIRE TO PLENUM.
- G.F.I. DENOTES GROUND FAULT DEVICE
- A.F.F. ABOVE FINISHED FLOOR.
- KEYNOTE SYMBOL

KEYNOTES

1. PROVIDE 120 V. OUTLET FOR TENANT PRINTER.
2. PROVIDE 120 V., 30 AMP S.E. OUTLET FOR TENANT COPIER HEAT OUTPUT: APPROX. 4500 BTU / HR.
3. PROVIDE 120 V. OUTLET FOR TENANT COFFEE MAKER. MOUNT AT 3'-4" A.F.F.
4. PROVIDE AND INSTALL TWO (2) 120 V., 20 AMP. DEDICATED, ISOLATED GROUND DOUBLE DUPLEX OUTLETS / ONE (1) 120 V., 20 AMP. DEDICATED ISOLATED GROUND DUPLEX OUTLET @ ONE AS SHOWN FOR TENANT DATAZON EQUIPMENT. TOTAL COMBINED HEAT OUTPUT = 7908 BTU / HR. ALL 20 AMP. DEVICES SHALL BE NEMA TYPE 5-20 R / 20 AMP DEVICE TO BE LH-3CR
5. PROVIDE 1" EMPTY CONDUIT EXTENDING FROM THIS LOCATION TO THE BASE BUILDING TELEPHONE SERVICE ENTRANCE FOR FUTURE VENDOR USE.
6. PROVIDE & INSTALL 120V OUTLET FOR T.E. REFRIGERATOR MODEL # TEX 1171 II COLOR ALMOND OUTLET TO BE 4'-0" A.F.F.
7. PROVIDE & INSTALL 120V 20AMP. OUTLET FOR T.E. MICROWAVE SPACEMAKER II # JEM 31 WTB @ JB-AB19 UNDER CVB. MOUNTING KIT. OUTLET TO BE 5'-0" A.F.F.
8. PROVIDE 120 V. OUTLET FOR WAX WARMER.
9. PROVIDE 120V OUTLET FOR FAX MACHINE.
10. MOUNT DEVICES IN CASEWORK. PROVIDE ELECT. & DATA-COM SERVICE ENTRANCE BOLTED-ON @ ADJACENT FULL HEIGHT PARTITION. CO-ORDINATE W/ MILLWORK SUB.

GENERAL NOTES

1. ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH ALL APPLICABLE CODES HAVING JURISDICTION OVER THE PROJECT.
2. ALL TELEPHONE & DATA WIRING, DEVICES & COVER PLATES SHALL BE BY TENANT SUBCONTRACTOR. ALL WIRING SHALL BE TEFLON-COATED AS APPROVED FOR PLENUM USE.
3. ALL DATA OUTLETS SHALL BE ASSUMED AS SERVING ONE (1) TERMINAL. HEAT OUTPUT: 400 BTU/HOUR.
4. ALL OUTLETS DESIGNATED FOR MOUNTING @ NON-STANDARD HEIGHTS SHALL BE INSTALLED HORIZONTALLY. THIS DOES NOT APPLY TO WALL TELEPHONES OR LIGHT SWITCHES.
5. CONTRACTOR SHALL COORDINATE ELECTRICAL WORK & OUTLETS WITH MILLWORK SUB WHERE APPLICABLE.
6. ALL NEW MULTIPLE SWITCH LOCATIONS SHALL BE INSTALLED IN DIVIDED MULTIPLE GANG BOXES WITH COMMON COVER PLATES.
7. LIFE SAFETY SYSTEM IMPROVEMENTS ARE TO BE DESIGN-BUILD IN ACCORDANCE WITH CONC. PURPOSE SMOKE DETECTORS, ADA COMPLIANT STROBES AND OTHER HARDWARE AS MAY BE REQD. FOR A COMPLETE SYSTEM. TIE INTO OR ALTER EXISTING CIRCUITS AS NECESSARY.

McCormick
Architects+
Designers, Inc.

40 24th Street
Pittsburgh
Pennsylvania
15222

Telephone
412 . 471 . 3800
Facsimile
412 . 471 . 2642

Project Title

FIRST UNION Securities

TWO CANAL PLAZA
PLAZA LEVEL

PORTLAND
MAINE

Revisions

	By	Date
RE-ISSUED		2-9-01
⚠ REVISED AS SHOWN		2-9-01

Drawing Title

POWER, DATA & TELEPHONE PLAN

Project No. Sheet 01

Scale: 1/8" = 1'-0"

Drawn by: BW, RPM

Issue date: 12-21-00

A2