


FOURTH FLOOR FIRE ALARM PLAN  
SCALE: 1/8"=1'-0"

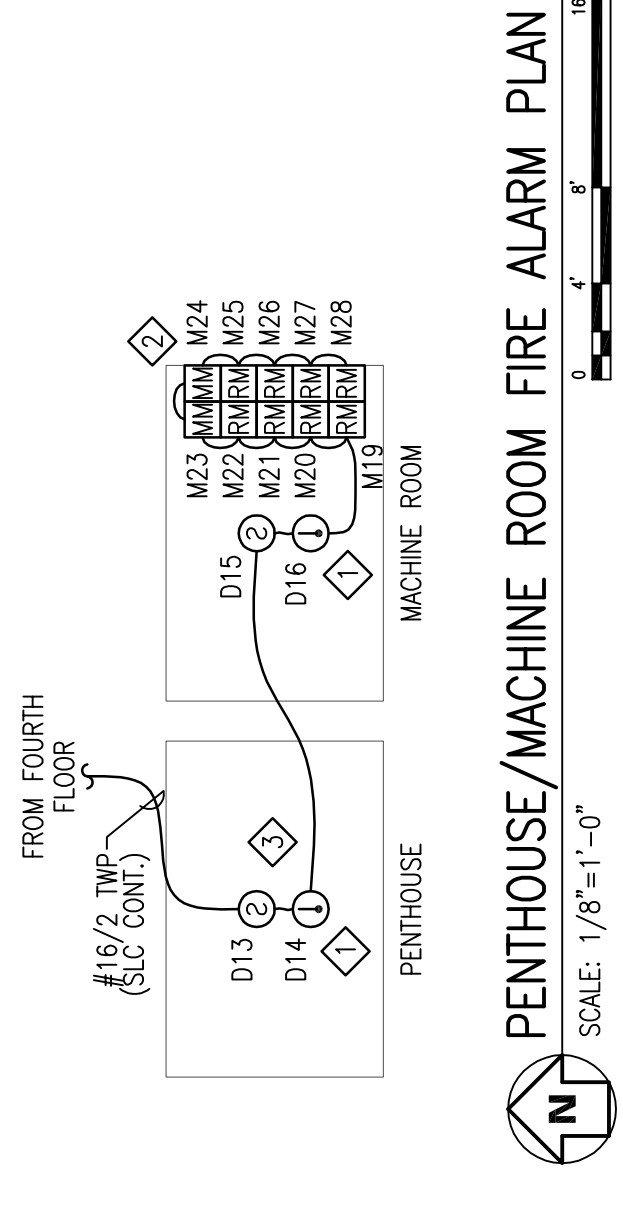

PENTHOUSE/MACHINE ROOM FIRE ALARM PLAN  
SCALE: 1/8"=1'-0"

SHEET NOTES:

- ◇ PROVIDE HEAT DETECTOR(S) WITHIN 24" OF EACH SPRINKLER HEAD IN THE ELEVATOR CONTROL ROOM AND HOISTWAY(S). HEAT DETECTORS SHALL HAVE A LOWER TEMPERATURE RATING THAN THE SPRINKLERS IN THE AREA AND BE MONITORED FOR INTEGRITY.
- ◇ ADDRESSABLE RELAY MODULES (4) PROVIDED FOR THE ELEVATOR RECALL AND SHUT DOWN TIE TO ELEVATOR EQUIPMENT ROOM DETECTOR(S), HOISTWAY DETECTOR(S) AND LOBBY DETECTOR(S) TO INITIATE RECALL AND SHUT DOWN ADDRESSABLE MONITOR MODULE PROVIDED TO MONITOR THE CONTROL CIRCUIT TO THE ELEVATOR SHUNT TRIP BREAKER FOR THE PRESENCE OF OPERATING VOLTAGE. LOSS OF VOLTAGE SHALL CAUSE A SUPERVISORY SIGNAL AT THE CONTROL PANEL. FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS.
- ◇ LOCATE DETECTORS IN PENTHOUSE.

**CUNNINGHAM**  
Security Systems  
10 Prices Point Road, Yarmouth, Maine 04096  
Office: 207.846.3350 • Fax: 207.846.6080

REVISION	DESCRIPTION	DATE
0	ISSUED FOR REVIEW & APPROVAL	5/10/2013
1	PORTLAND, ME FIRE PREV OFFICE REVIEW	5/13/2013

**NORMAN HANSON DETROY**  
2 CANAL PLAZA  
PORTLAND, MAINE 04101  
FOURTH FLOOR FIRE ALARM PLAN

DRAWN	JPB	UNICAD JOB #13226
CHECKED	WAYNE B. HAWES	NCET # 90496
DATE	5/3/2013	
REVISION	1	
SCALE	1/8"=1'-0"	

**FA-4**