NO.	LOCATION	DOOR)R			FR/	FRAME					REMARKS
					n)		n)	DET	DETAILS	_{:T}		AL = ALUMINIUM
			SS	L	ee Pla	L	ee Pla			RE SE		GL = GLASS WD = WOOD
		TYPE	THICKNES	MATERIAL	FINISH (Se	MATERIAL	FINISH (Se	HEAD	JAMB	LHARDWAF	FIRE RATI (MIN.)	CL AN = CLEAR ANODIZED ME = MATCH EXISTING (9TH FLOOR)
400	ENTRY	EX	ı	-	ı	ı	ı	-	ı	1		B, C, F
402	OFFICE	D1	ME	ME	ME	ME	ME	4,5/A1.2 6,7/A1.2	6,7/A1.2	2		A,D,E
403	OFFICE	D1	ME	ME	ME	ME	ME	4,5/A1.2	6,7/A1.2	2		A,D,E
404	CONFERENCE	D1	ЭM	ME	ME	ME	ME	4,5/A1.2	4,5/A1.2 6,7/A1.2	2		A,D,E

HARDWARE SPECIFICATIONS:

NOTE: GC TO VERIFY HARDWARE SPECIFIED TO BE RELOCATED WHEN NOT AVAILABLE GC TO MATCH EXISTING.

SET #1: CONTROLLED ACCESS UPDATE ON EXIST. DOOR
TEM DESCRIPTION MANUF.
4 HINGES EXISTING (NO WORK) EXISTING

E 73-11-8270 LNL US26D 24V/DC S/
LOCKSET IS FAIL SAFE
POWER SUPPLY BY E.C.
MOTION SENSOR ON TENANT/EXIT
SIDE TO CONNECT TO FIRE
ALARM SYSTEM
DOOR POSITION SWITCH BY
SECURITY CONTRACTOR

SET #2: PASSA ITEM 4 HINGES DESCRIPTION MATCH EXISTING MANUF. MATCH EXISTING

1 FLOOR STOP MATCH EXISTING MATCH EXISTING

REMARKS A) PRIVATE OFFICE COAT HOOKS TO BE WALL MOUNTED BEHIND DOOR TYP.


- В) DOORS REQUIRING ELECTRIC STRIKES SHALL HAVE A KEY CARD ACCESS PAD AT ENTRY SIDE AND A PUSH PAD AT EXIT SIDE. CONNECT TO BUILDING FIRE ALARM SYSTEM. COORDINATE WITH TENANT ON ANY EXISTING CONDITIONS OR MANUFACTURERS TO BE DUPLICATED.
- 0 MATCH EXISTING FRAME, HEAD AND JAMB DETAILS COORDINATE CONTROLLED ACCESS ENTRY SYSTEM WITH KEYBANK AND SECURITY CONSULTANT
- $\stackrel{\square}{=}$ SOUND SEAL AROUND FRAME


ŋ

- TOUCH UP DOOR AND FRAME FINISH AS REQUIRED.

DOOR, FRAME & GENERAL NOTES: 1. ALL HARDWARE BY DOOR SUPPLIER & TENANT'S SECURITY CONTRACTOR.

- 2. ALL WOOD DOORS TO BE FACTORY FINISHED FLUSH SOLID CORE WOOD UNITS MANUFACTURED BY "EGGERS INDUSTRIES" OR EQUIVALENT.
- 4. ALL EXIT DOOR HARDWARE ALLOWS DOOR TO BE OPENED DIRECTLY IN THE DIRECTION OF EXIT WITHOUT THE USE EFFORT (BOCA 1017.4.1) A KEY OR SPECIAL KNOWL
- 6. ALLOWABLE CLOSER PRESSURE SHALL BE 5 POUNDS FOR INTERIOR DOORS.
- 7. ALL DOOR ASSEMBLY TO HAVE "ADAAG LEVER STYLE" HANDLES.
- 8. ALL DOOR HANDLES, PUSH/PULLS, ETC. SHALL BE CENTERED AT 30" MIN. TO 44" MAX.

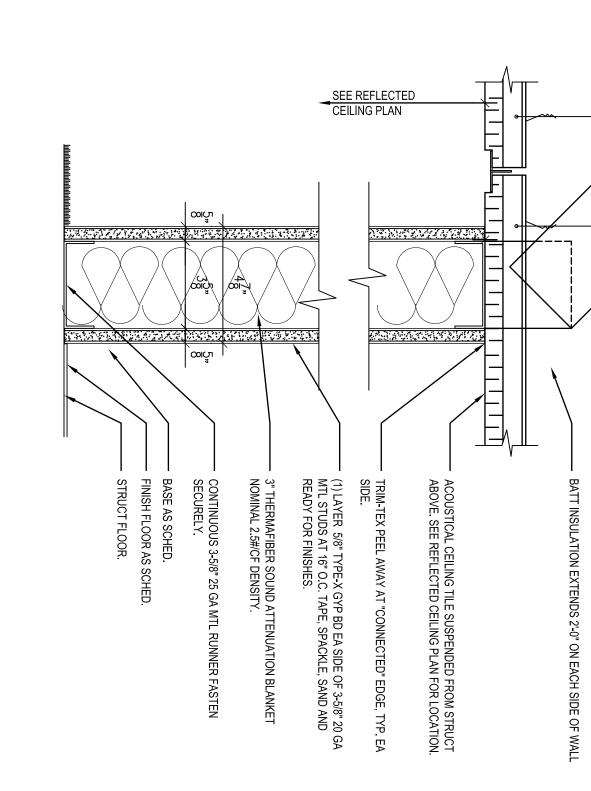

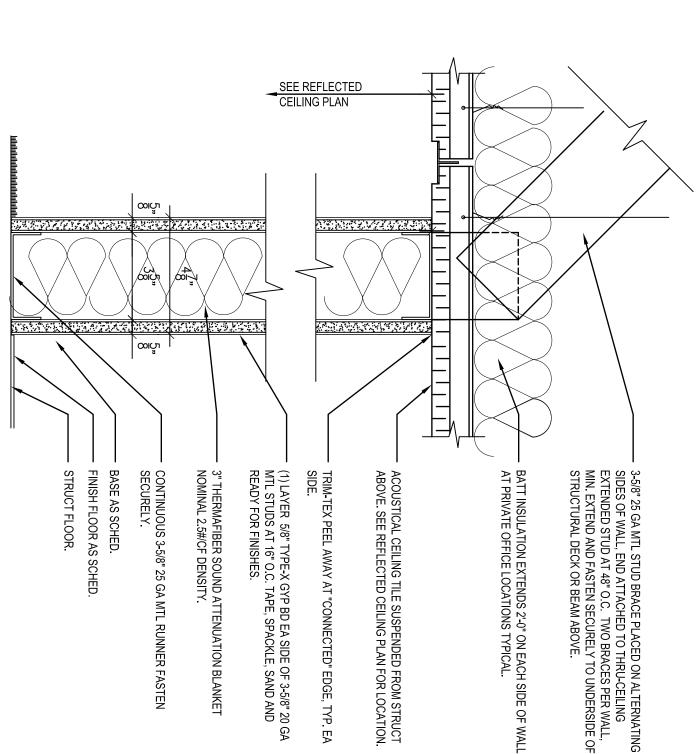

PROFESSIONAL SEAL:

I hereby certify that this drawing, Specification, plan, or report was prepared by me or under my direct supervision and that I am a duly registered Architect (or Engineer, respectively) under the laws of the State of which govern this project.

WARNING: per LAW No person may alter these documents unless person is "or under the direct supervision of "the licensed record architect (or Engineer, respectively).

[including all copyrights; JCW]

3-5/8" 25 GA MTL STUD BRACE PLACED ON ALTERNALING SIDES OF WALL, END ATTACHED TO THRU-CEILING EXTENDED STUD AT 48" O.C. TWO BRACES PER WALL, MIN. EXTEND AND FASTEN SECURELY TO UNDERSIDE OF STRUCTURAL DECK OR BEAM ABOVE.


cleveland.
3142 Prospect Ave.
Cleveland OH, 44113
216.588.0800


new york.
11 penn plaza
floor 21, suite D
v York, NY 10001
212.457.6246

partners

PARTITION TYPE 1



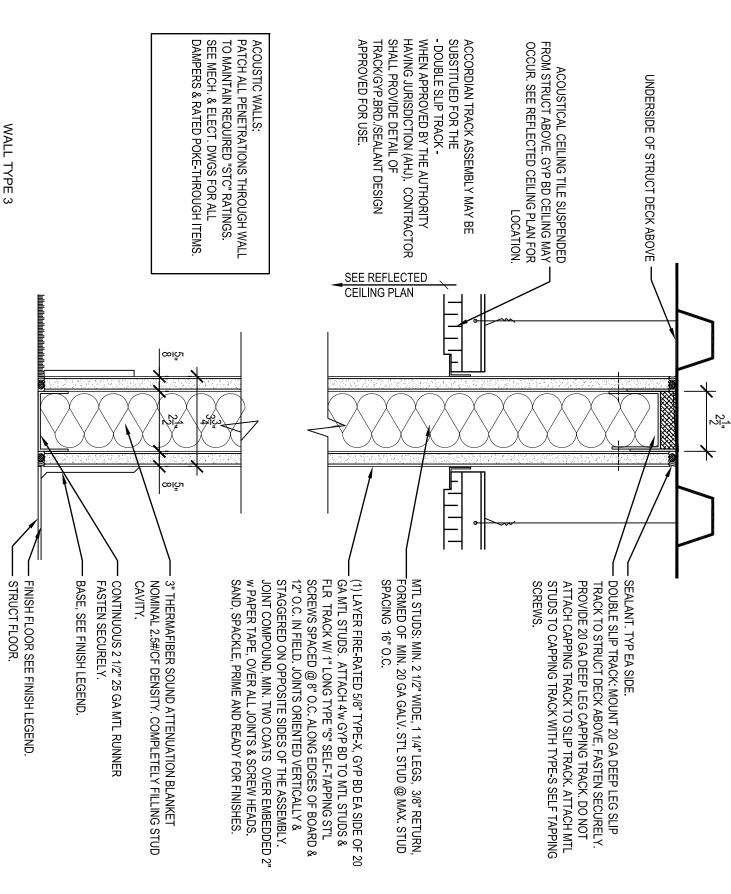

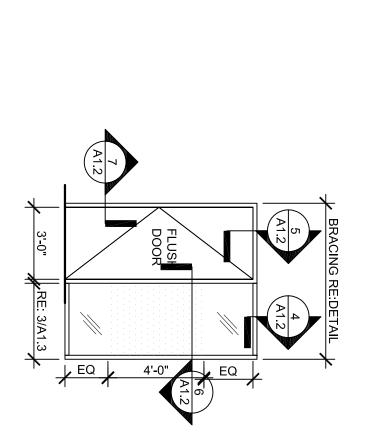

DRAWING RELEASE

05.05.12

ISSUED FOR PERMIT


KEY PLAN SCALE: N.T.S.


ONE CANAL PLAZA FLOOR 4 PORTLAND, ME 04101

KeyBank

PROPOSED TENANT IMPROVEMENTS FOR:



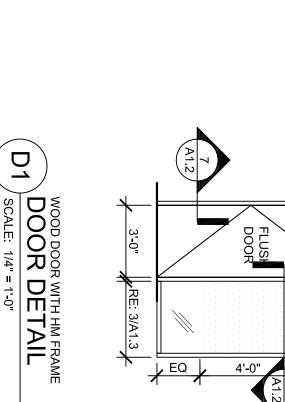


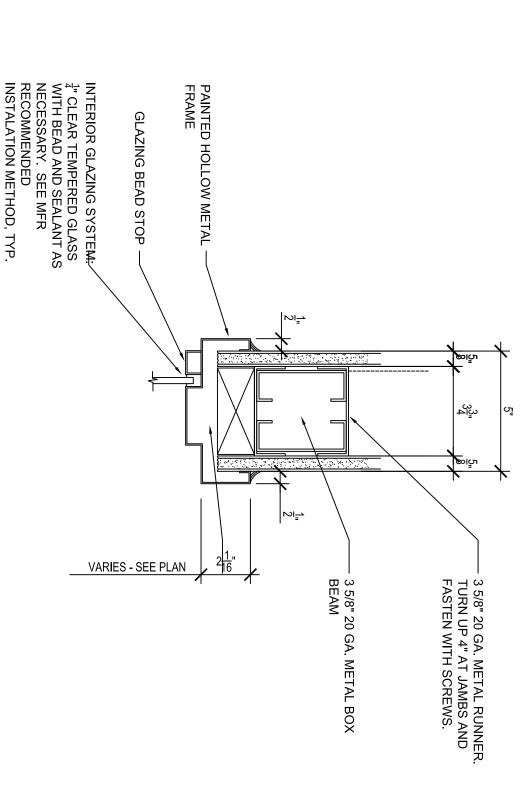



HM SIDELIGHT HEAD

5

HM DOOR HEAD

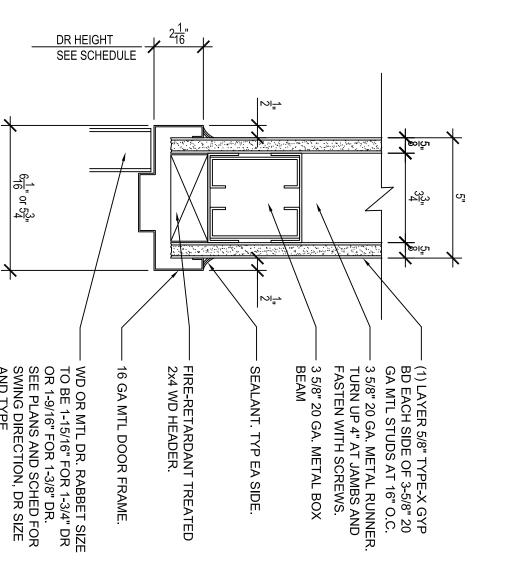

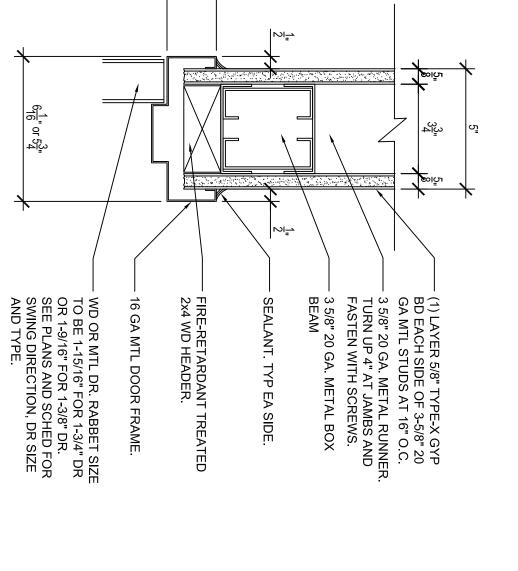

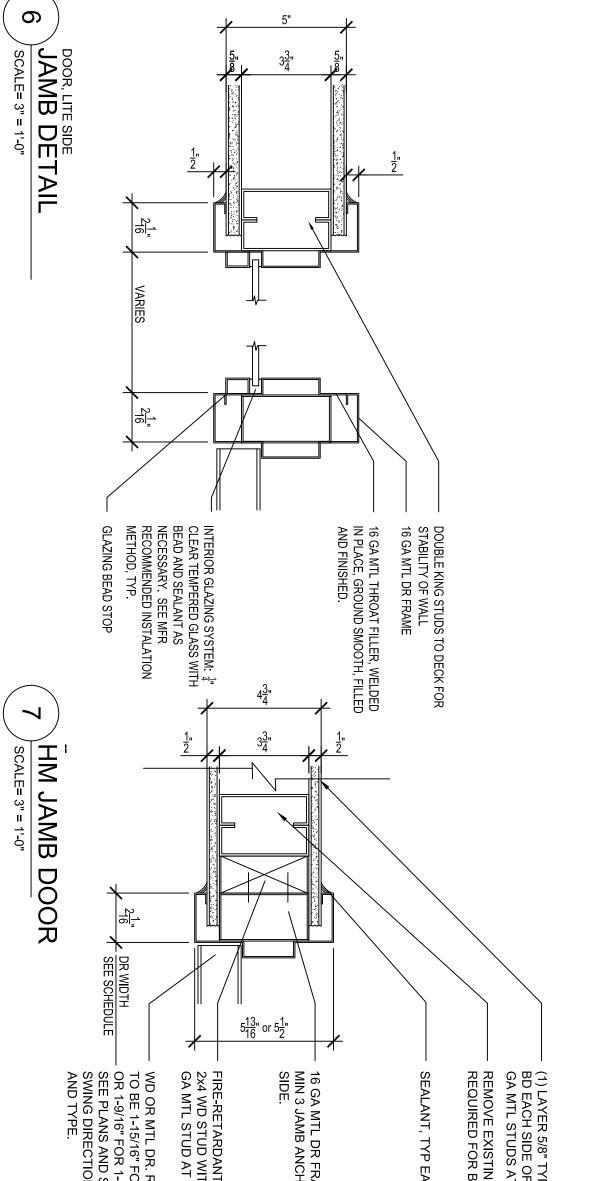

	216" VARIES	1. 2			<u>1.</u> "			
	21/16							
	NECESSARY. SEE MFR RECOMMENDED INSTALATION METHOD, TYP. GLAZING BEAD STOP	INTERIOR GLAZING SYSTEM: 1 CLEAR TEMPERED GLASS WITH BEAD AND SEALANT AS	4 ³ "	16 GA MTL THROAT FILLER, WELDED IN PLACE, GROUND SMOOTH, FILLED AND FINISHED.	DOUBLE KING STUDS TO DECK FOR STABILITY OF WALL 16 GA MTL DR FRAME			
		1, 2	33"	1."				
	21 DR WIDTH SEE SCHEDULE		5 ¹³ / ₁₆ or 5 ¹ / ₂					
AND TYPE.	WD OR MTL DR. RABBET SIZE TO BE 1-15/16" FOR 1-3/4" DR OR 1-9/16" FOR 1-3/8" DR. SEE PLANS AND SCHED FOR	FIRE-RETARDANT TREATED 2x4 WD STUD WITH 2-1/2" 25 GA MTL STUD AT JAMB.	16 GA MTL DR FRAME WITH MIN 3 JAMB ANCHORS PER SIDE.		SEALANT, TYP EA SIDE.	REMOVE EXISTING WALL AS REQUIRED FOR BRACING	(1) LAYER 5/8" TYPE-C GYP BD EACH SIDE OF 3-5/8" 25 GA MTL STUDS AT 16" O.C.	

CHECKED BY: J JOB NUMBER:

JCW

YWN BY: EM

DRAWINGS ISSUED FOR: ISSUE DATE:

ET SIZE 3/4" DR DR. ED FOR R SIZE

DOOR SCHEDULE AND DETAILS