




SANITARY STACK
N.T.S.

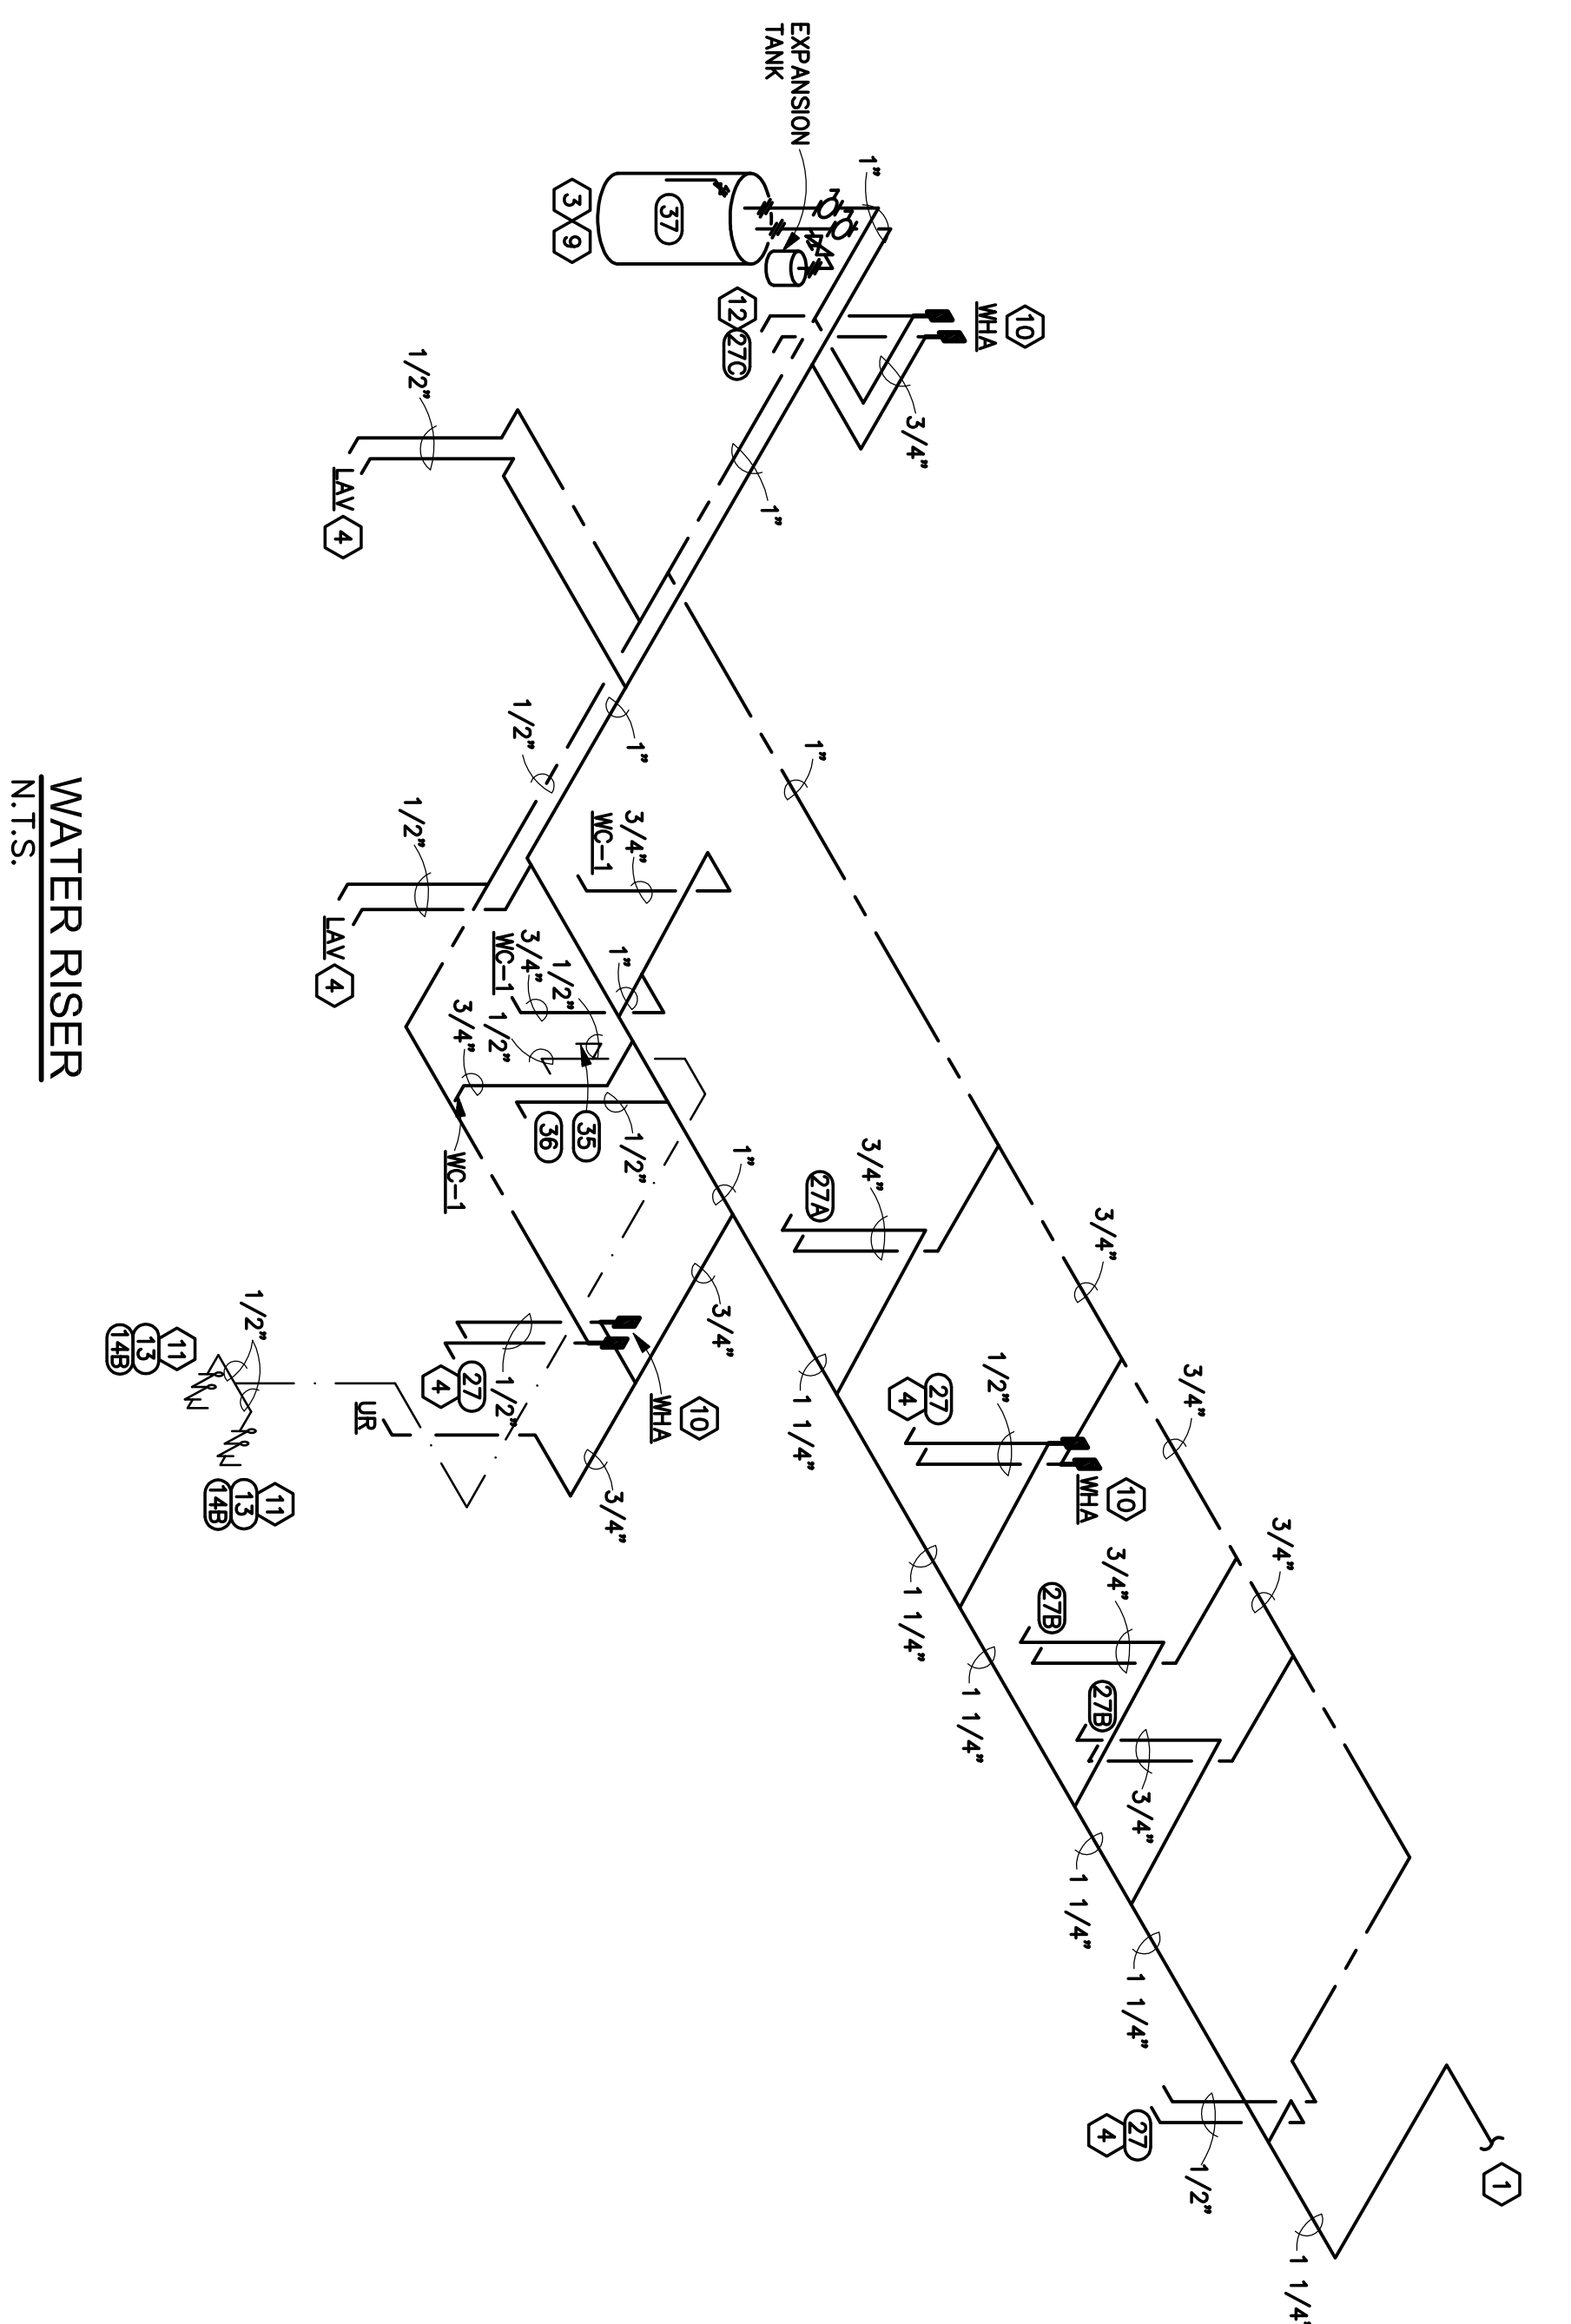

WATER RISER
N.T.S.

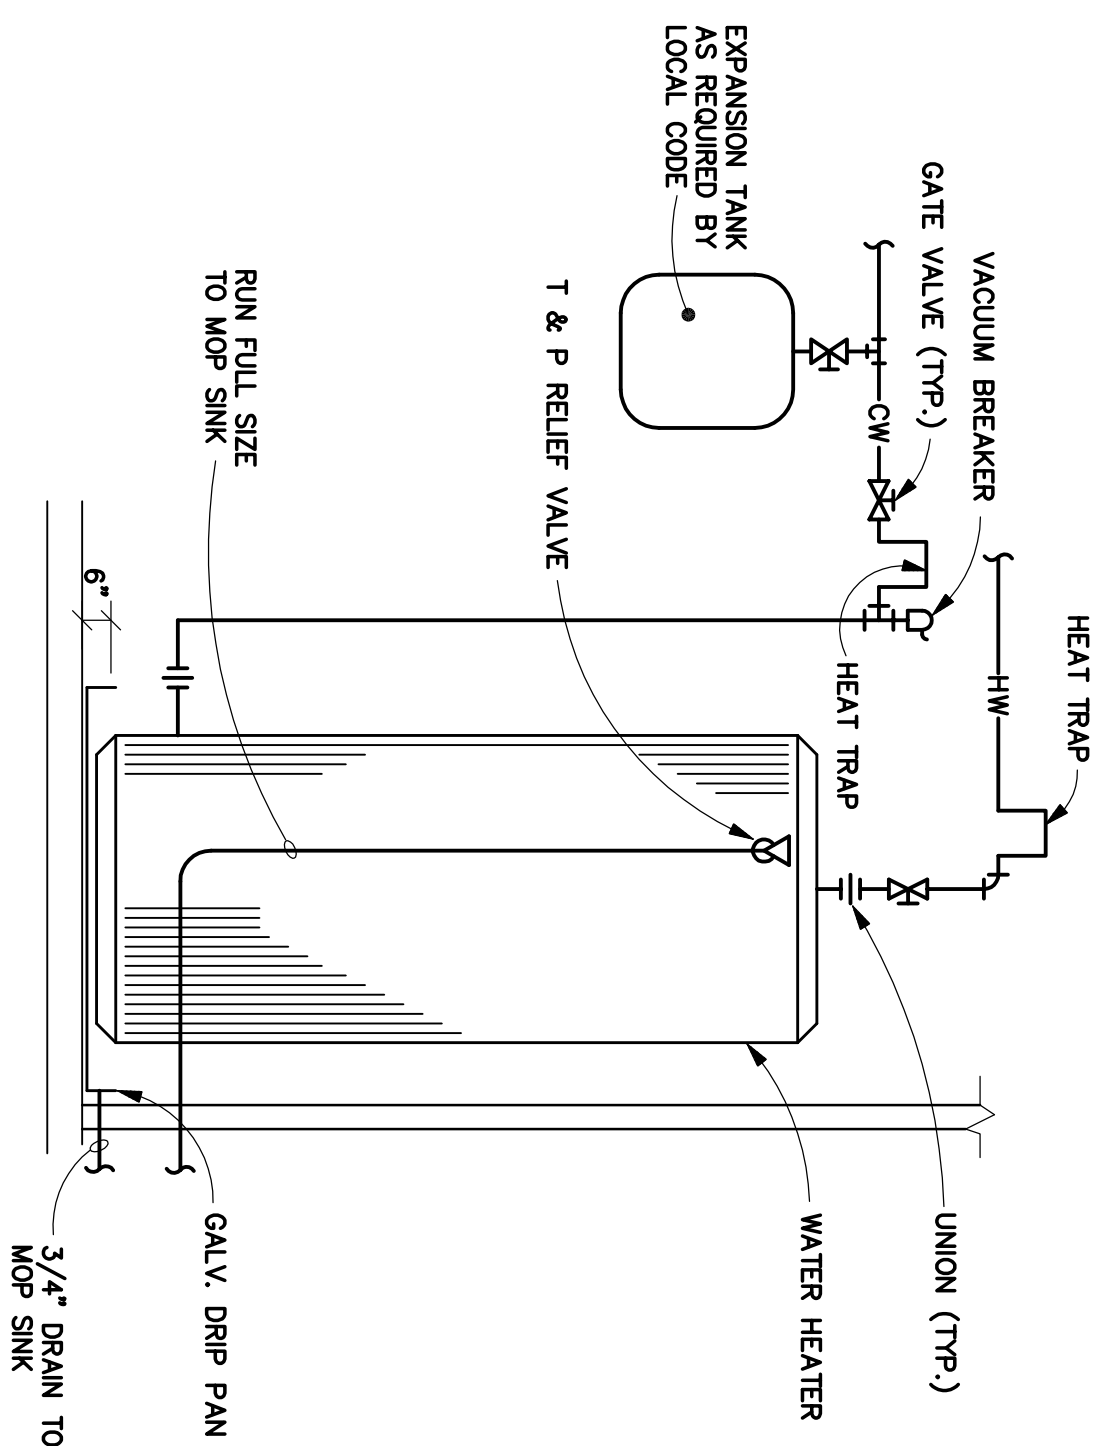

WATER HEATER
N.T.S.

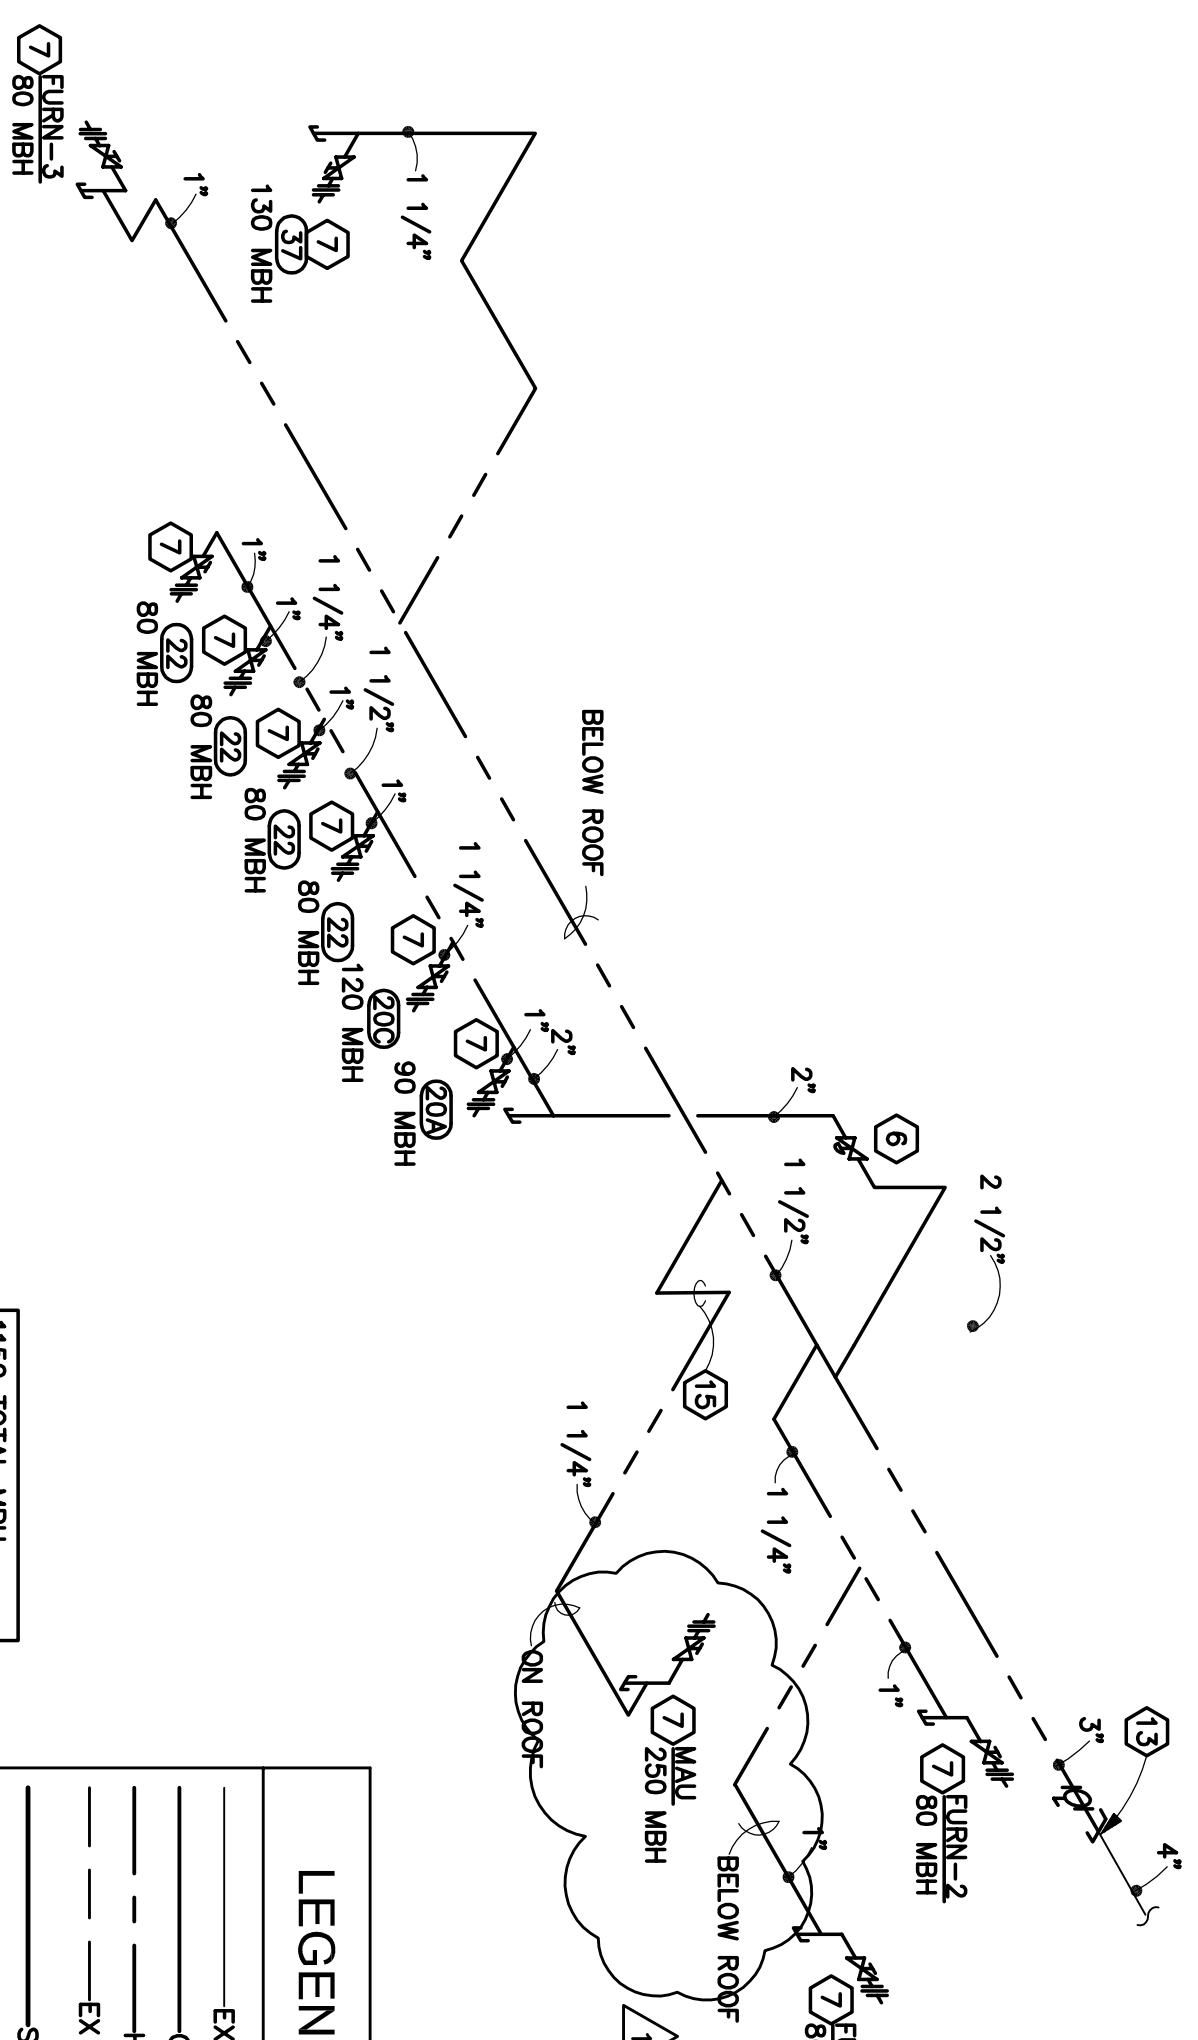

GAS RISER
N.T.S.

THIS CONTRACTOR IS TO PROVIDE AND INSTALL ALL ITEMS EXCEPT AS LABELED AS LANDLORD. ADDITIONAL WORK BY LANDLORD IS SHOWN FOR CLARITY. FIELD COORDINATE WORK WITH EXISTING CONDITIONS AND LANDLORD CONTRACTORS.

THIS CONTRACTOR IS RESPONSIBLE FOR VERIFYING ACTUAL DISTANCE FROM METER TO GAS APPLIANCES AND TO RESIZE GAS LINES AS REQUIRED.

1150 TOTAL MBH
200' TOTAL DISTANCE AT 7" WC WITH A PRESSURE DROP OF 0.5" WC
PRESSURE DROP OF 0.5" WC
NATIONAL FUEL GAS CODE HANDBOOK 2006, TABLE 6.2(10)

LEGEND AND NOTES *

— EX CW —	EXISTING COLD WATER
— CW —	COLD WATER
— HW —	140°F HOT WATER
— EX SAN —	EXISTING SANITARY
— SAN —	SANITARY
— GR SAN —	GREASE SANITARY
— FW —	FILTERED WATER
— EX G —	EXISTING GAS
— G —	GAS
— FLOOR DRAIN —	FLOOR DRAIN
— DROP —	DROP
— BALL VALVE —	BALL VALVE
— GATE VALVE —	GATE VALVE
— VENT THRU ROOF —	VENT THRU ROOF

* ALL SYMBOLS MAY NOT BE USED

FIVE GUYS
BURGERS and FRIES

425 FORE STREET
PORTLAND, MAINE 04101-4396

APPLIED ENGINEERING GROUP LTD.
MEP Building Consultants

APPLIED ENGINEERING GROUP LTD.
7402 East Broad Street
Blacklick, Ohio 43004
Phone: 614.322.7050
Fax: 614.322.7049
www.aeglt.com

LINGLEDISIGNGROUP, INC.
158 WEST MAIN STREET
LENA, IL 61048

PHONE: 815-369-9155
FAX: 815-369-4495
WWW.LINGLEDISIGN.COM

SHEET TITLE:
PLUMBING ISOMETRICS

SHEET NUMBER:
P2

REVISIONS:

#	DATE:	DESCRIPTION:
1	12/15/10	ISSUED FOR PERMIT
1	01/21/11	REVISED PER ILL. MUNICIPAL 4 CORP. COMMENTS
1	02/08/2011	ISSUED FOR CONSTRUCTION

PROJECT NUMBER: 10232
DRAWN BY: AW
CHECKED BY: BK