


FAN#1 - EXHAUST PERFORMANCE CURVES.

2437 CFM, 3 SP @ 1532 RPM and 3.237 BHP at 64 feet and 70 deg F

* Please note that these curves were adjusted for job specific temperature and altitude.

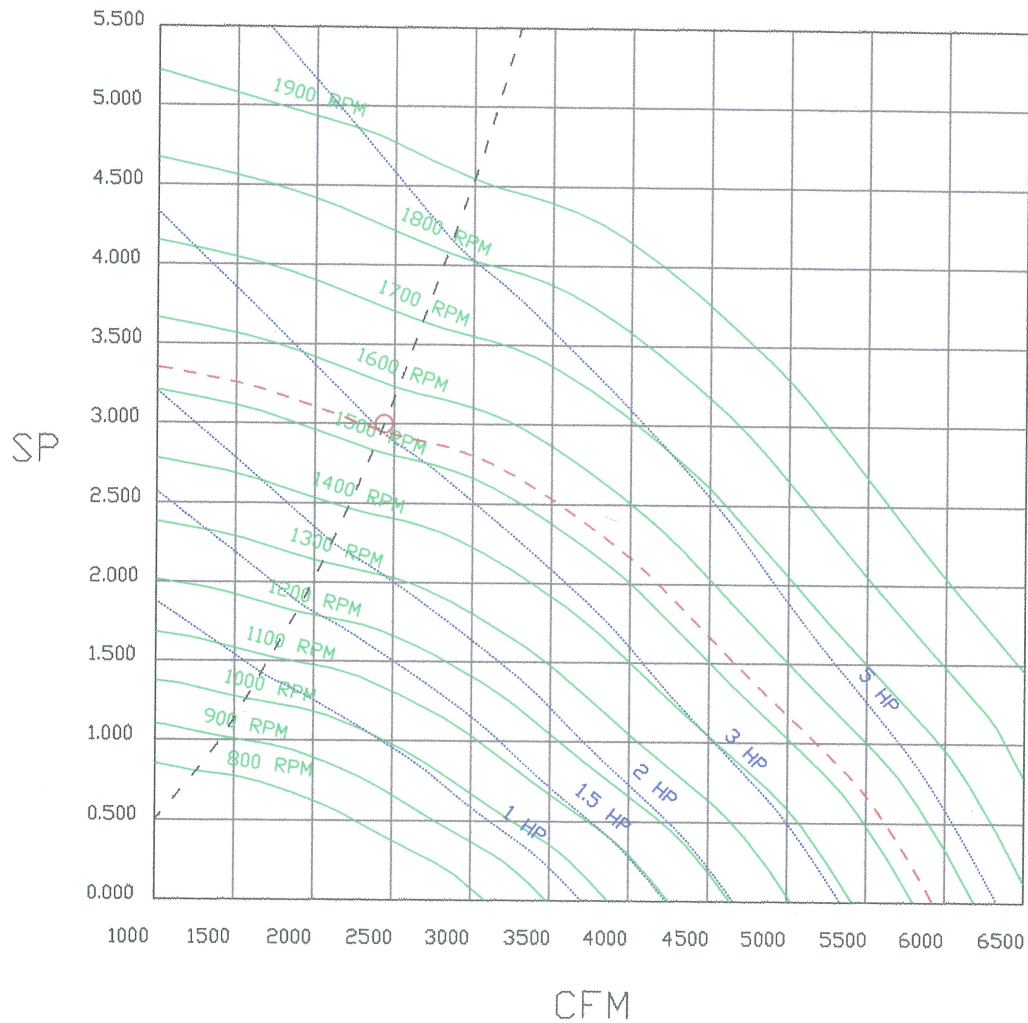

CUSTOMER APPROVAL TO MANUFACTURE:

- Approved as Noted
- Approved with NO Exception Taken
- Revise and Resubmit

SIGNATURE _____
Your Title _____ Date _____



CAPTIVEAIR

JOB Old Port Lobster Company r1	
LOCATION SCARBOROUGH, ME,	
DATE 7/11/2016	JOB # 2692009
DWG # 6	DRAWN BY BFC-21
REV.	SCALE 3/8" = 1'-0"