


Luminaire Schedule								
Symbol	Qty	Label	Arrangement	Lumens/Lamp	LLF	Total Watts	Description	Lum. Watts
	12	B4	SINGLE	11648	0.930	1032	OSQ-A-NM-4ME-B-57K-xx-xx + OSQ-DAXx	86
	21	IG-40L	SINGLE	3910	1.020	693	IG-NM-5S-A-57K-UL-WH	33

Footcandles calculated using predicted lumen values after 50K hours of operation					
Label	Avg	Max	Min	Avg/Min	Max/Min
CANOPY PARKING	5.68	19.4	2.0	2.84	9.70
PERIMETER PARKING	5.79	19.7	0.6	9.65	32.83

NOTE: CUSTOMER TO VERIFY MOUNTING

ADDITIONAL EQUIPMENT:
 (12) WM-DM (MOUNTING PLATE)
 (12) OSQ-DAXX (DIRECT ARM MOUNT)

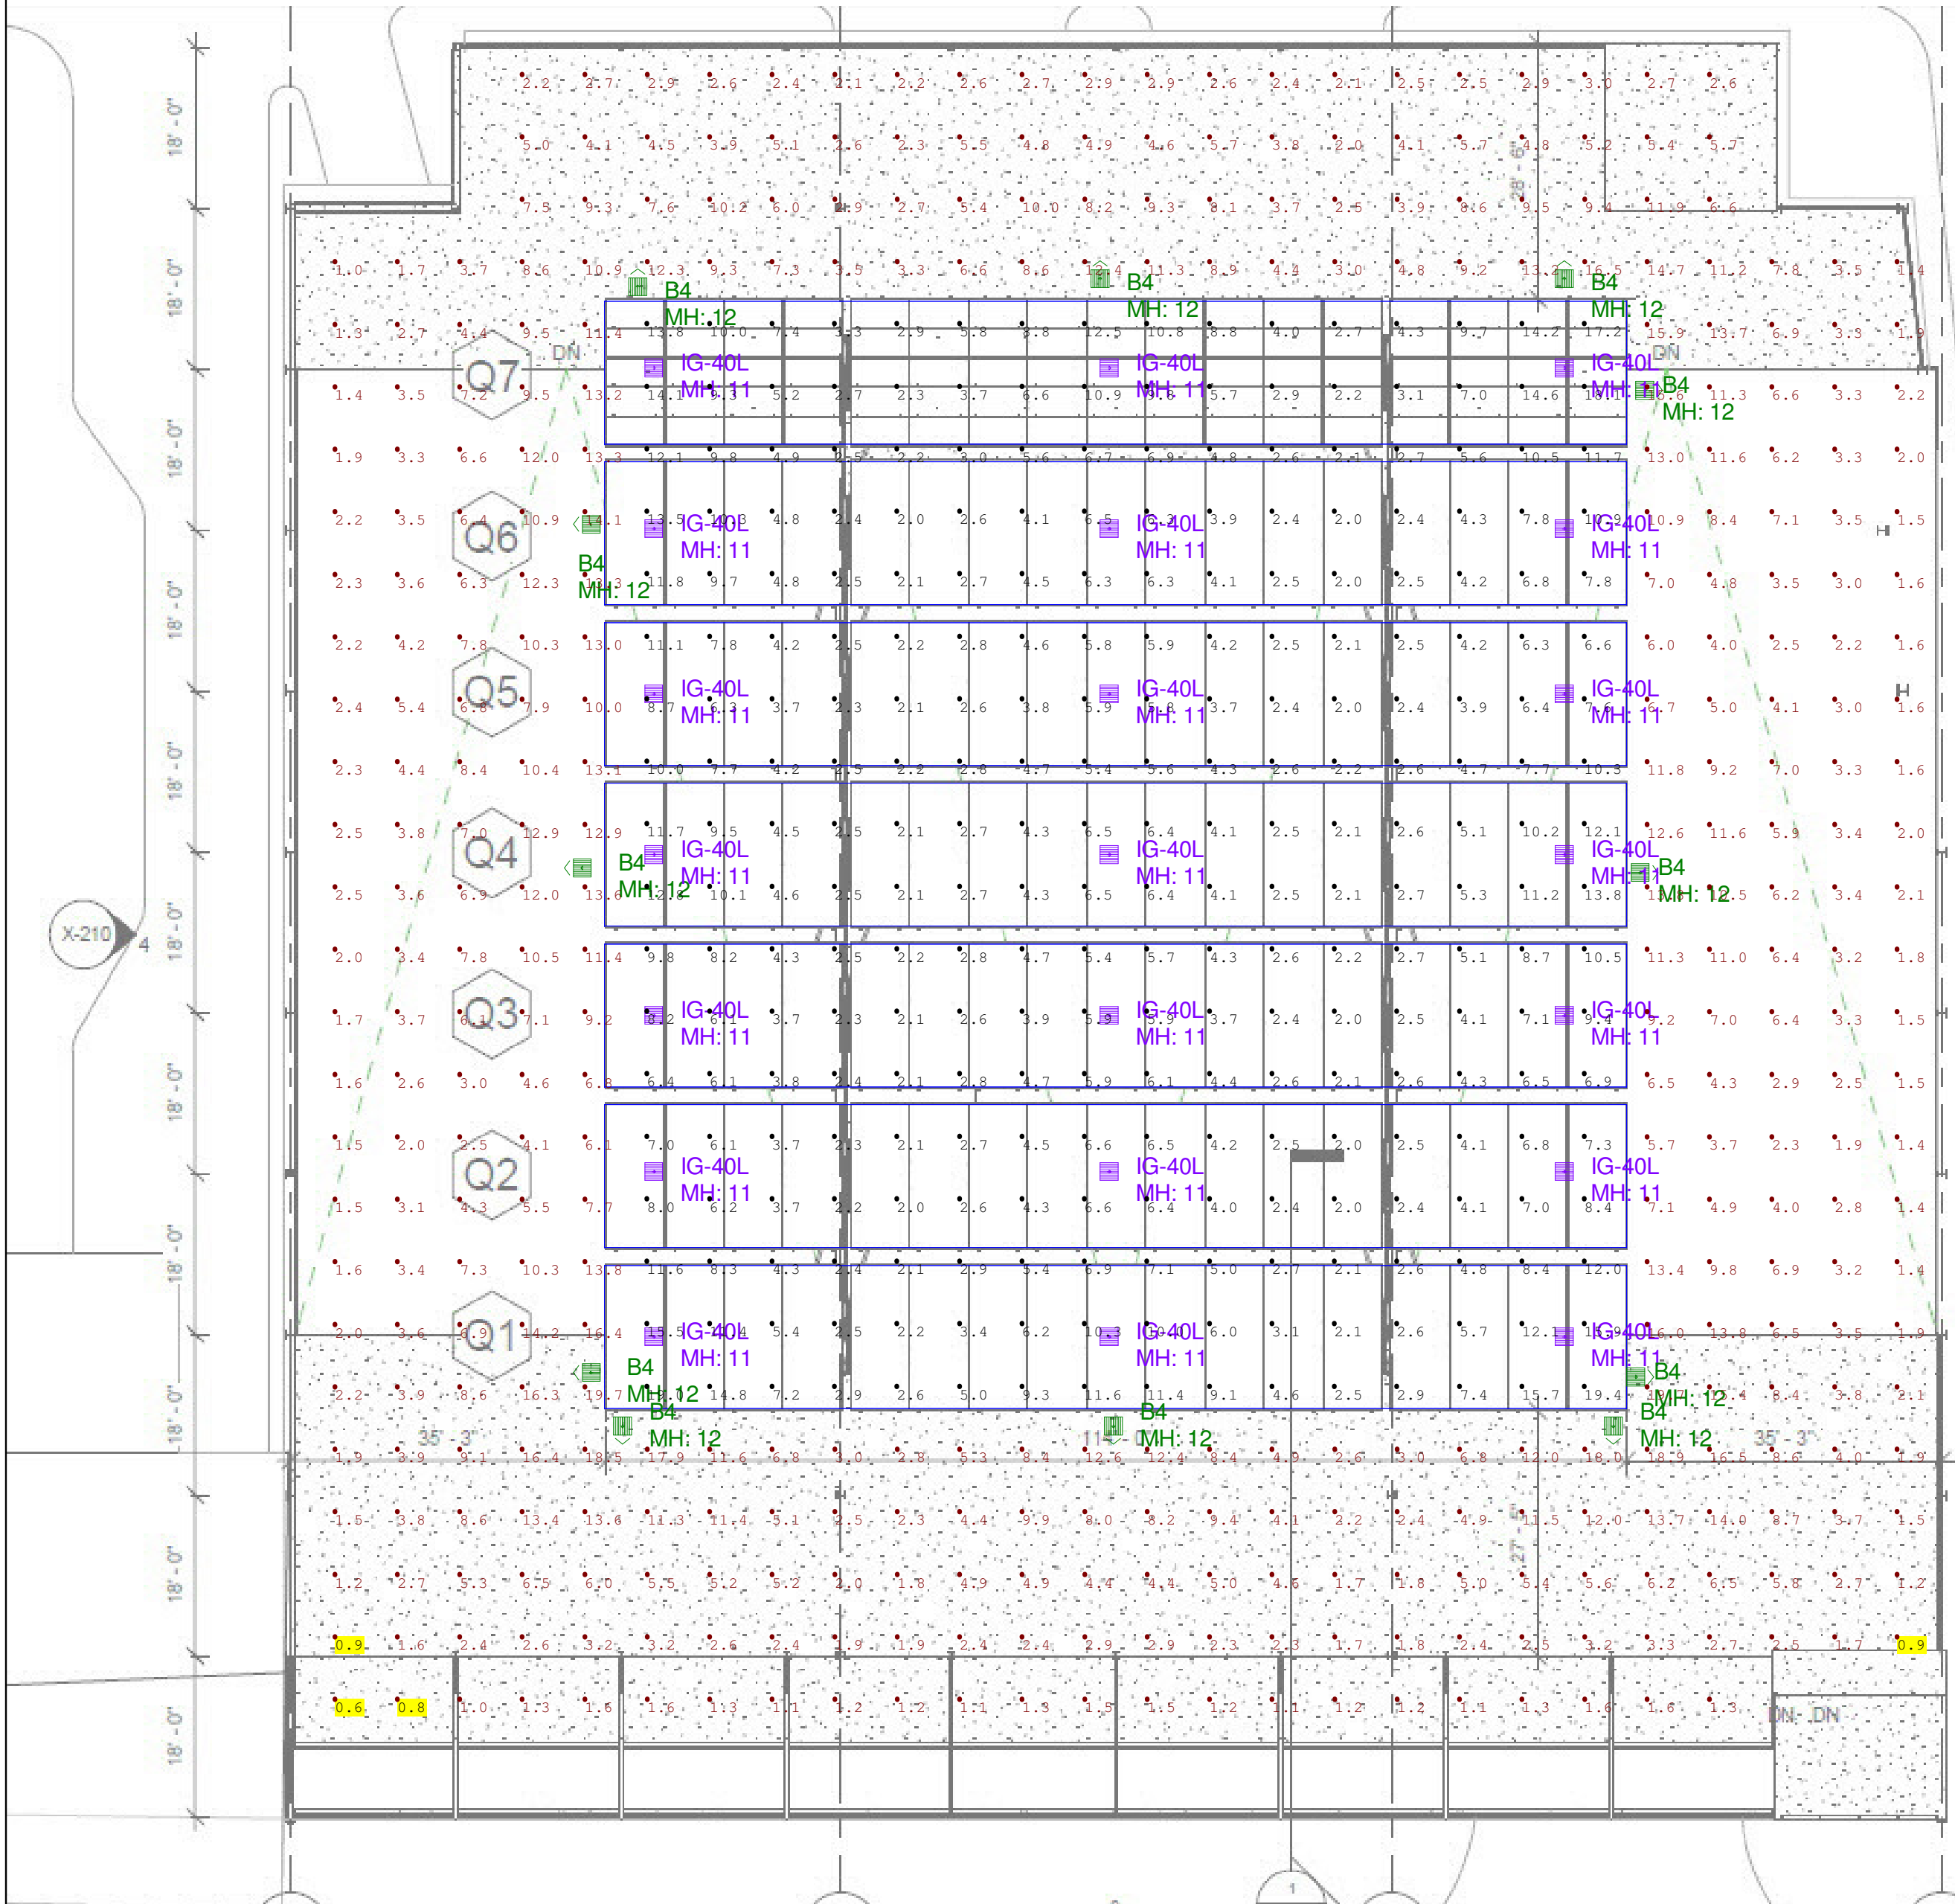

1200 92nd Street - Sturtevant, WI 53177
 www.cree.com - (800) 236-6800

Project Name: FORE STREET GARAGE SR-22321
 Date: 3/28/2017 Scale: 1"=16' Footcandles calculated at grade
 Filename: V:\Common\AppEng\OUT\170328CW1LJS.AGI Layout by: LINDA SCHALLER

DLC V4 is in effect as of April 1, 2017, which impacts the rebate eligibility of many LED products. If you require DLC-qualified fixtures, please reference <https://www.designlights.org/search/> for updated qualified product listings. Email rebates@cree.com or rebates@cree.com for assistance.

Illumination results shown on this lighting design are based on project parameters provided to Cree, Inc. used in conjunction with luminaire test procedures conducted under laboratory conditions. Actual project conditions differing from these design parameters may affect field results. The customer is responsible for verifying dimensional accuracy along with compliance with any applicable electrical, lighting, or energy code.

