

LEGEND

	CABLE TRAY FOR COMMUNICATIONS AT BAR JOIST
	BODINE EMG. BALLASTED NIGHT LIGHT FIXTURE
	2X4 LIGHT FIXTURE ( # INDICATES TYPE PER FIXTURE SCHEDULE)
	1X4 LIGHT FIXTURE ( # INDICATES TYPE PER FIXTURE SCHEDULE, DIAGONAL LINE DENOTES NIGHT LIGHT)
	DOWN LIGHT FIXTURE ( # INDICATES TYPE PER FIXTURE SCHEDULE)
	SINGLE POLE SWITCH - MOUNTED 48" AFF TO TOP
	THREE WAY SWITCH - MOUNTED 48" AFF TO TOP
	FOUR WAY SWITCH
	MOTION SENSING SWITCH
	SPECIALTY OUTLET
	GFI RECEPTACLE SUBSCRIPT IS FOR COUNTER HEIGHT OR WP FOR WEATHER PROOF
	DUPLEX CONVENIENCE OUTLET 18" AFF TO CENTER EXCEPT AS NOTED
	208 V RECEPTACLE
	DOUBLE DUPLEX CONVENIENCE OUTLET 18" AFF TO CENTER EXCEPT AS NOTED
	JUNCTION BOX - SIZED AS REQUIRED
	POWER POLE CONNECTION. PANEL AND CIRCUITING AS INDICATED
	DISCONNECT SWITCH - FUSED AS REQUIRED (DIAGONAL LINE INDICATES FUSED)
	ELECTRIC MOTOR CONTROLLER
	EXIT LIGHT ATLITE #PNLRU W/LED LAMPS BATTERY BACKUP
	EBU - EMERGENCY LIGHT BATTERY UNIT. 120V VOLT AC. BATTERIES TO BE RATED FOR 90 MINUTES FOR CONNECTED LOAD.
	TEL/DATA RECEPTACLES ( HALF SHADED DENOTES TELEPHONE AND DATA, CLEAR TELEPHONE ONLY, SOLID DENOTES DATA ONLY)
	POWER FLOOR BOX
	CEILING MOTION SENSOR
	RELAY
	FRACTIONAL HP MOTOR
	MECHANICAL EQUIPMENT
	PANELXX - PANELBOARD- SEE SCHEDULES FOR CIRCUITING
	GROUND FAULT INTERRUPTER /W SURGE SUPPRESSOR
	ELECTRIC WATER COOLER
	EXHAUST FAN
	WEATHERPROOF
	PARTIAL CIRCUIT
	FURNISHED BY OTHERS
	COUNTER HEIGHT ( SEE MILLWORK DRAWINGS FOR HEIGHT)
	HOSPITAL GRADE W/RED FACE AND PLATE. IF GFI, DEVICE TO HAVE SURGE SUPPRESSOR
	ISOLATED GROUND OUTLET /W SURGE SUPPRESSOR. ORANGE FACE AND PLATE
	MANUAL THERMAL OVERLOAD SWITCH
	BUSS DUCT
	DRY TYPE TRANSFORMER

FIRE ALARM SYSTEM



	FIRE ALARM MANUAL STATION 48" AFF
	FIRE ALARM HORN AND LIGHT UNIT - MOUNT 80" AFF EXCEPT NO CLOSER THAN 6" TO CEILING. NUMBER DENOTES CANDELA RATING
	SPRINKLER TAMPER SWITCH
	SPRINKLER WATERFLOW SWITCH
	FIRE ALARM VISUAL UNIT ( NUMBER DENOTES CANDELA RATING ) 6'8" AFF
	FIRE ALARM SMOKE DETECTOR "E" SUBSCRIPT DENOTES ELEVATOR RECALL.

DRAWINGS

E100-LEGENDS  
 E200-SITE  
 E300-LIGHTING  
 E400-POWER  
 E500-DETAILS  
 E600-SCHEDULES

GENERAL NOTES:

- 1) ALL BRANCH CIRCUITS TO BE TYPE MC CABLE.
- 2) ALL ELECTRICAL MUST MEET NEC AND LOCAL CODES.
- 3) TELEPHONE AND DATA WIRING BY OTHERS
- 4) TEMPERATURE CONTROL WIRING BY OTHERS

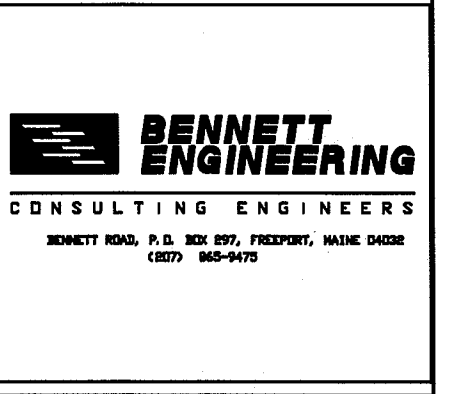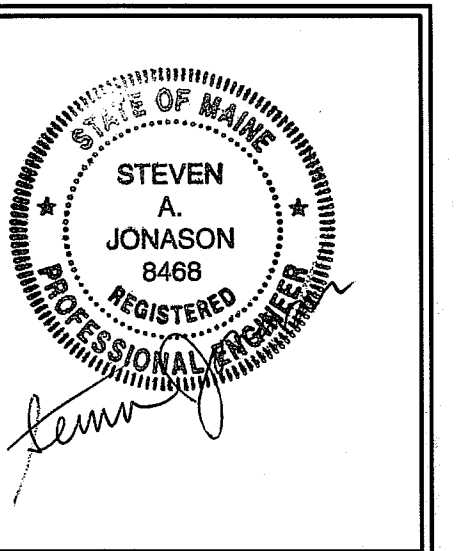

**BH Milliken**  
 ELECTRICAL CONTRACTORS  
 175 ANDERSON STREET  
 PORTLAND, MAINE 04101  
 PHONE 879-1877  
 FAX: 774-1492

443 Fore St,  
 LINE 2  
 443 FORE ST.  
 PORTLAND, ME.

TITLE
LEGENDS
SCALE: NON
DATE: 11-20-14
SHEET
E100