

Billing Name: Sprinkler Systems Inc.

**Address: P.O. Box 1285
Lewiston, ME 04243**

**Contact Person: Donna Giroux
Tel: (207) 782-0104
Email: Donna@sprinklersystemsinc.com**

**DATE: 5-11-2013
TIME: 5:55 am
TESTED BY: J.L.
SERV REQ #: 259580
WO #: 768258**


Flow Hydrant: POD-HYD00464

Static: 90 psi
Pitot: 64 psi
Flow: 1342 GPM


Test Hydrant: POD-HYD00415

Static: 101 psi
Residual: 99 psi

TWO HYDRANT FLOW TEST

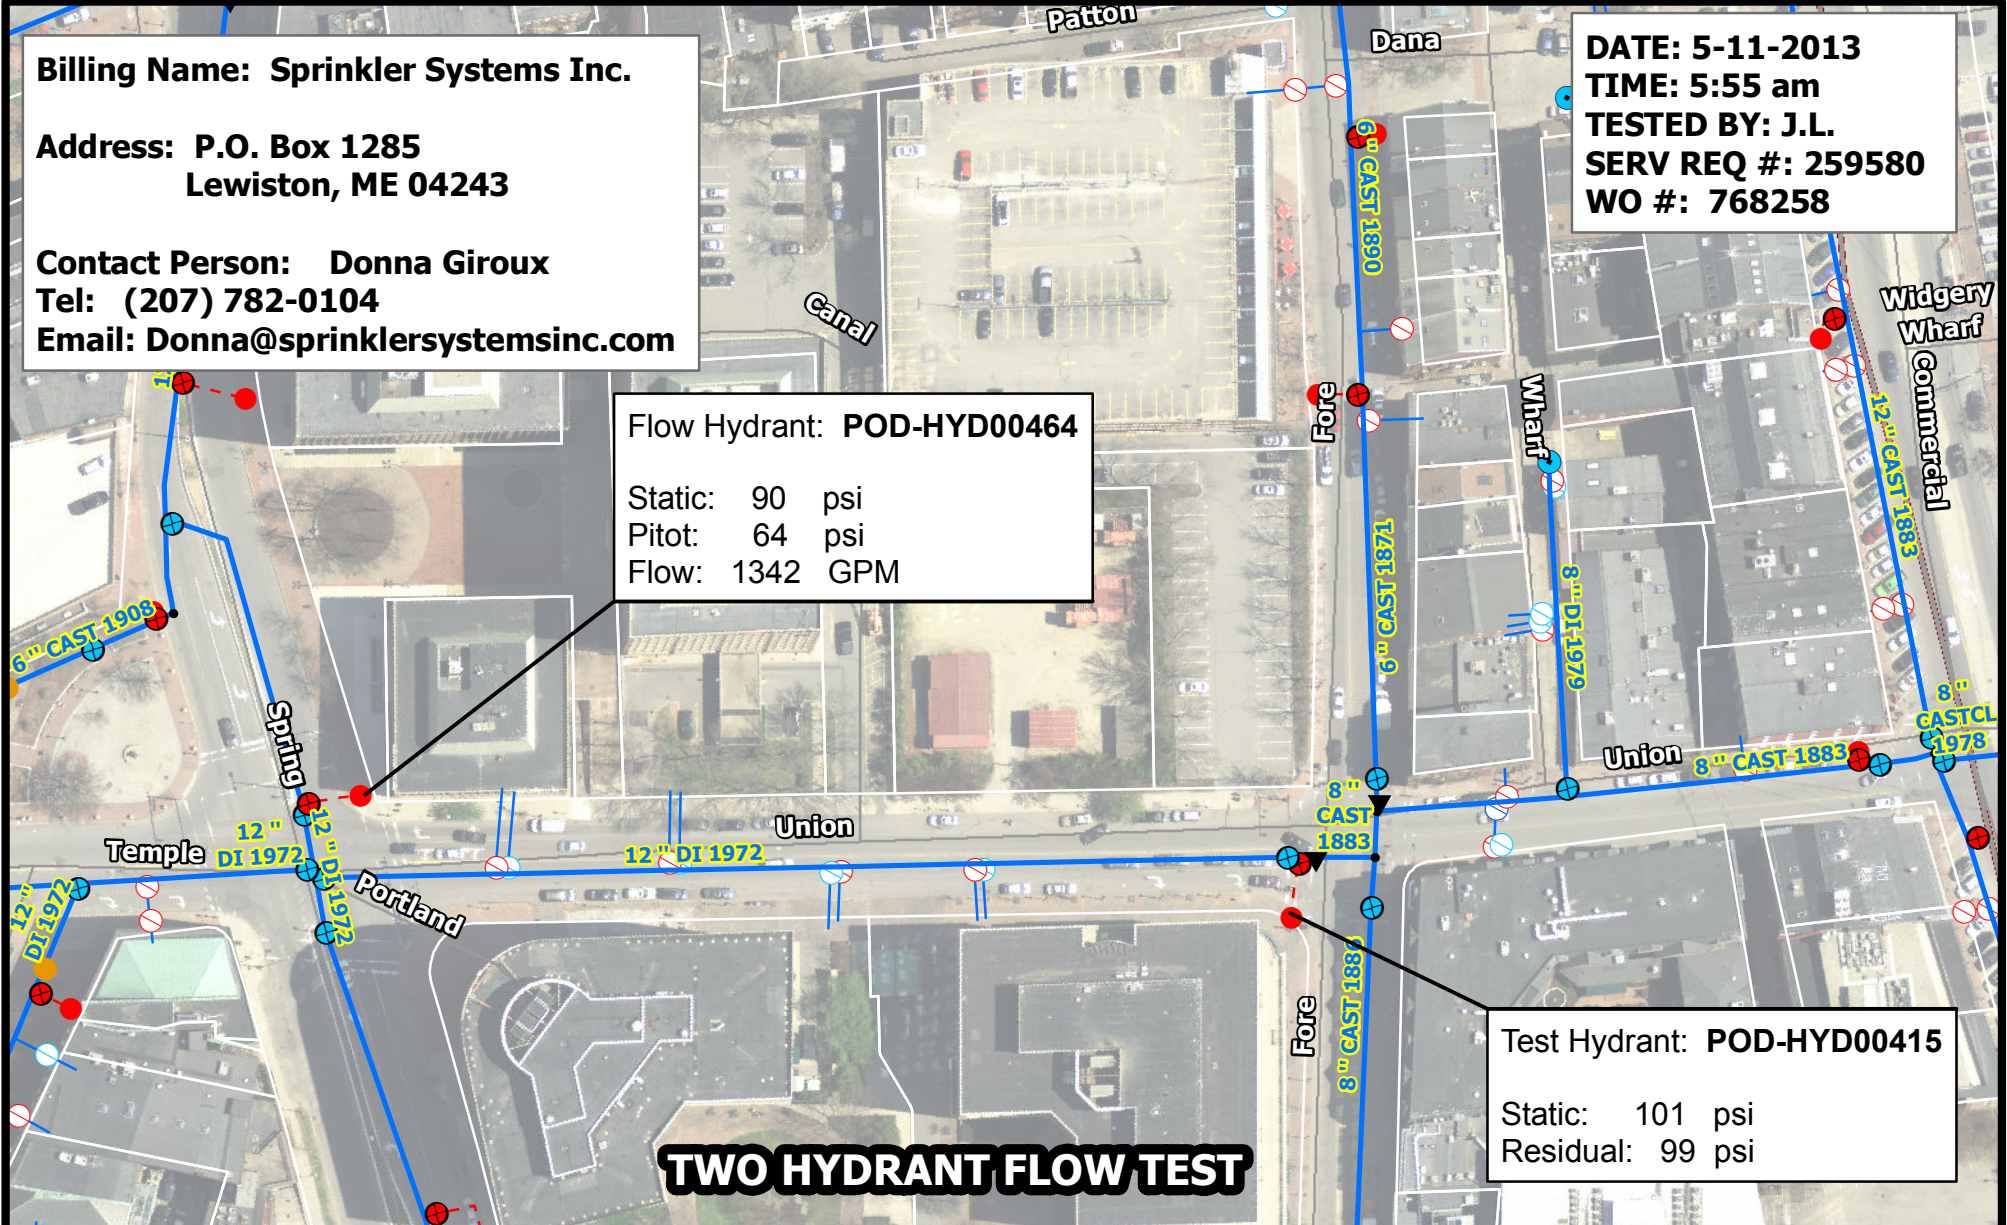

**Union Street
Portland**



Disclaimer: This map is suitable for preliminary study and analysis and is based on PWD record information. PWD is not liable for any damages whatsoever resulting from inaccurate data or from errors made in the location and marking of its infrastructure.



**PORTLAND WATER DISTRICT
225 Douglass Street
PO Box 3553
Portland, ME 04104
Telephone: (207) 774-5961
Fax: (207) 761-8307**

Legend

● Air Valve	● Connection	⊕ Combined Service	● Manhole
⊕ Blow Off	● Attribute Change	⊕ Domestic Service	● CSO
⊕ By Pass	▲ Reducer	⊕ Fire Service	→ Gravity
⊕ Distribution	● Hydrant	⊕ Private Hydrants	→ Force
⊕ Transmission	● Hydrant Control	⊕ Meter Pits	

Drawn By: BSJ

Prepared for: Alan Small
Sprinkler Systems Inc.

Test Fee: \$170.00

Date: May 11, 2013