





FIRE SUPPRESSION SYSTEM

System Type: ANSOL
 Tanks: 3 GAL
 Flow Points Used: 8 PL

When a fire occurs in a protected area, it is quickly sensed by detectors located in the duckwork or exhaust hood.

Fire Alarm and electrical by others:

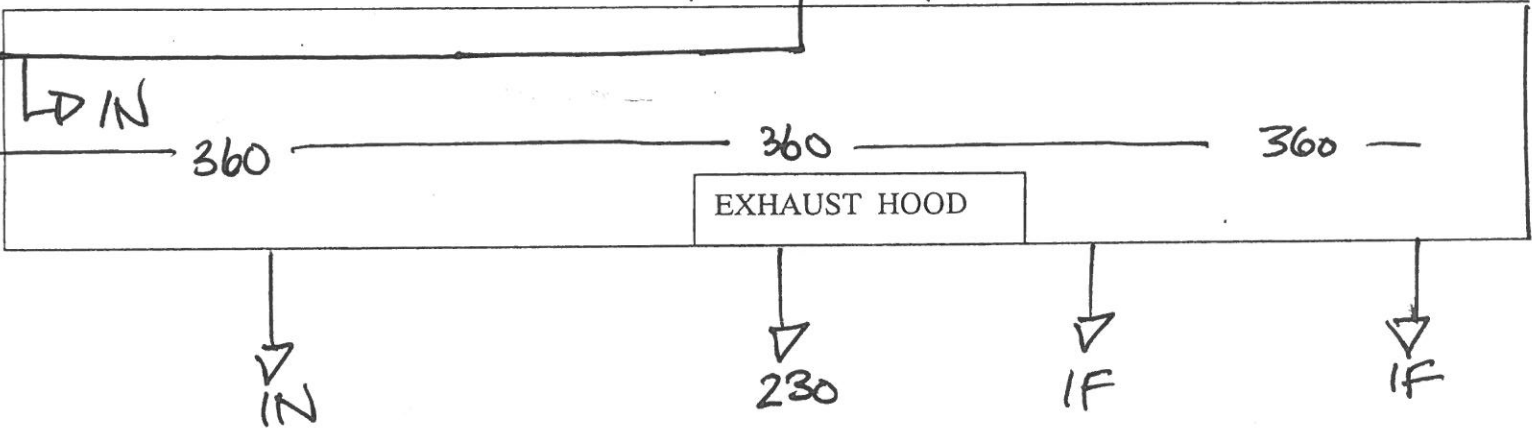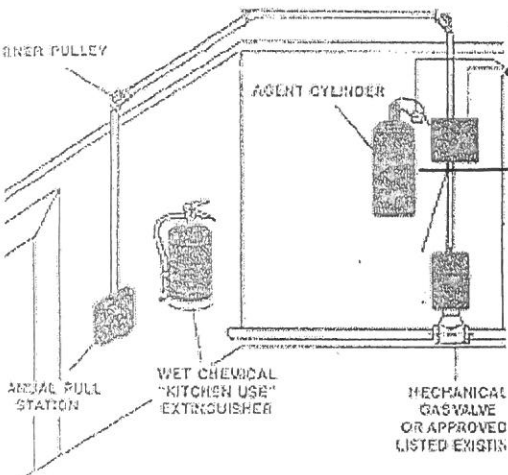

The detectors trigger the releasing mechanism which actuates the system...pressurizing the agent storage tank.

24" GRILL	16" FRY	X 24" Range X X
--------------	------------	---

Liquid suppressant flows through the distribution piping to discharge nozzles.

Chemical applied directly on the fire in specific spray patterns... suppressing the fire in seconds.

Job Name: EVO
 Address: 443 FORE STREET
PORTLAND ME.

Date: 1-26-17
 Submitted To: F/D