



PLAN VIEW - I.T. ROOM 9TH FLR.  
 SCALE: 1/4"=1'-0"


I.T. ROOM  
 308 SQ. FT.  
 308 CU. FT.  
 RAISED FLR.  
 308 SQ. FT.  
 308 CU. FT.

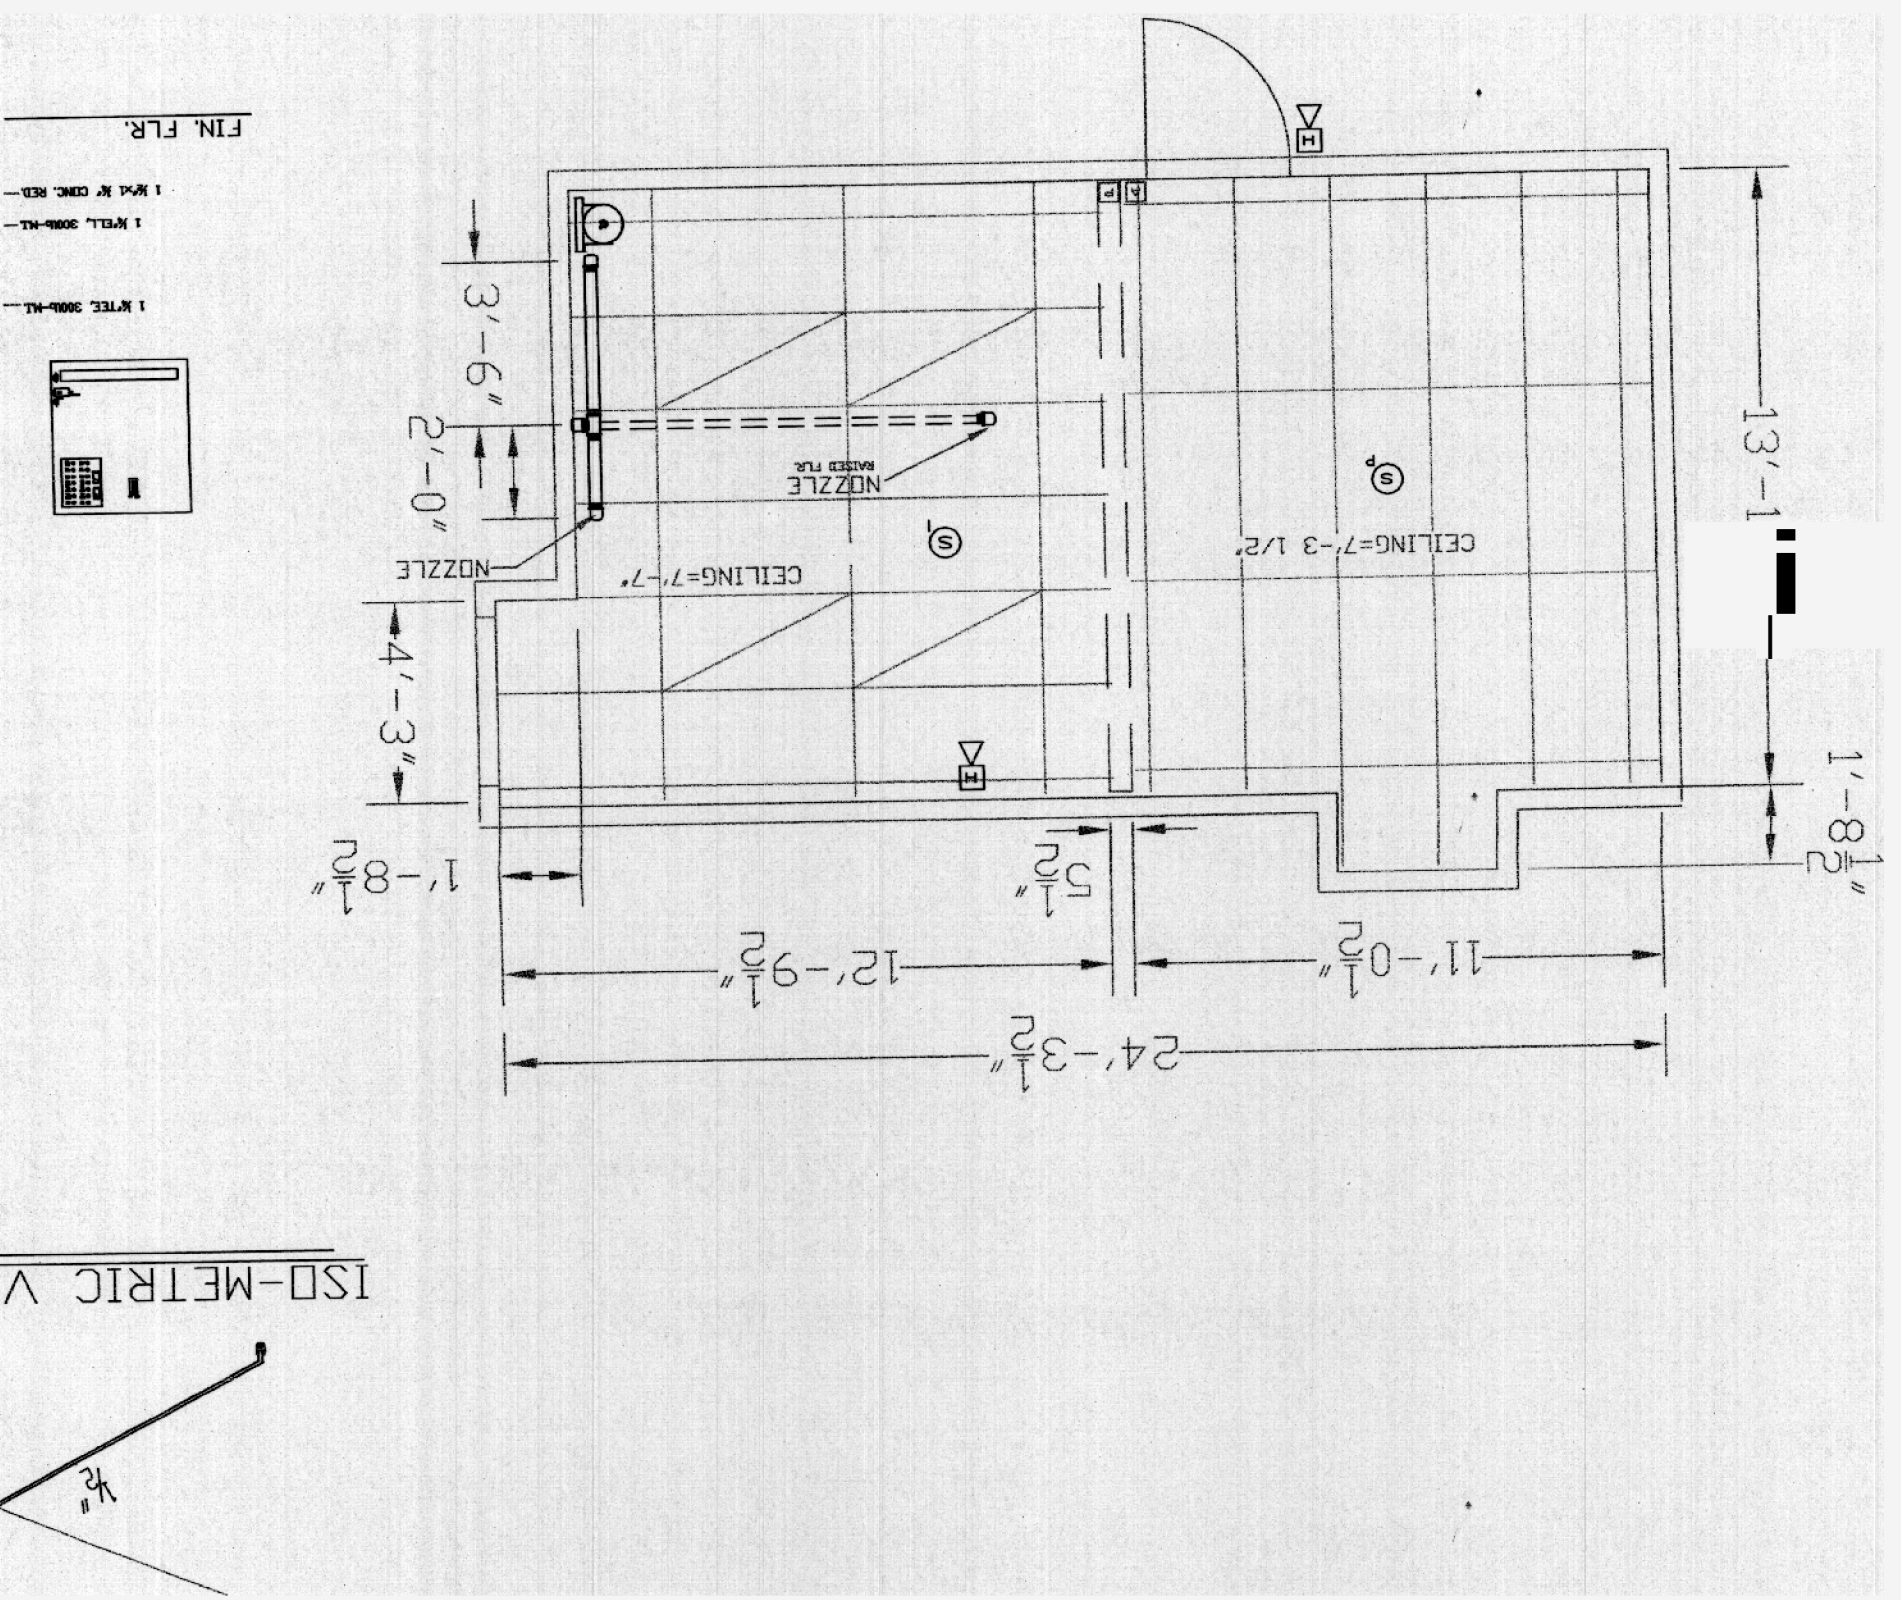

FIN. FLR.  
 1 X 1/2" CONC. RED.  
 1 X 1/2" CONC. RED.



ISD-METRIC V




1 X 1/2" CONC. RED.



1 X 1/2" CONCENTRIC REDUCER



DRAWING NO. 1 OF 1		DATE: DECEMBER 2005		CONTRACT NO. 915016401		ENGINEERING DEPARTMENT WESTBROOK, ME.		THESE PLANS PREPARED AT: WESTBROOK, ME.		CHECKED BY: B.H.		DRAWN BY: B.H.		SCALE: 1/4"=1'-0"	
PIERCE ATWOOD ONE MONUMENT SQUARE PORTLAND, MAINE 04101		CONTRACT WITH: PERCE ATWOOD		DESCRIPTION: FM-200 SYSTEM		HYDRAULIC DESIGN DATA		SYSTEM NO. 1		SYSTEM TYPE: WALK SYSTEM		SYSTEM WALK SYSTEM AREA		SYSTEM NO. 1	
PIERCE ATWOOD ONE MONUMENT SQUARE PORTLAND, MAINE 04101		CONTRACT WITH: PERCE ATWOOD		DESCRIPTION: FM-200 SYSTEM		HYDRAULIC DESIGN DATA		SYSTEM NO. 1		SYSTEM TYPE: WALK SYSTEM		SYSTEM WALK SYSTEM AREA		SYSTEM NO. 1	
PIERCE ATWOOD ONE MONUMENT SQUARE PORTLAND, MAINE 04101		CONTRACT WITH: PERCE ATWOOD		DESCRIPTION: FM-200 SYSTEM		HYDRAULIC DESIGN DATA		SYSTEM NO. 1		SYSTEM TYPE: WALK SYSTEM		SYSTEM WALK SYSTEM AREA		SYSTEM NO. 1	
PIERCE ATWOOD ONE MONUMENT SQUARE PORTLAND, MAINE 04101		CONTRACT WITH: PERCE ATWOOD		DESCRIPTION: FM-200 SYSTEM		HYDRAULIC DESIGN DATA		SYSTEM NO. 1		SYSTEM TYPE: WALK SYSTEM		SYSTEM WALK SYSTEM AREA		SYSTEM NO. 1	

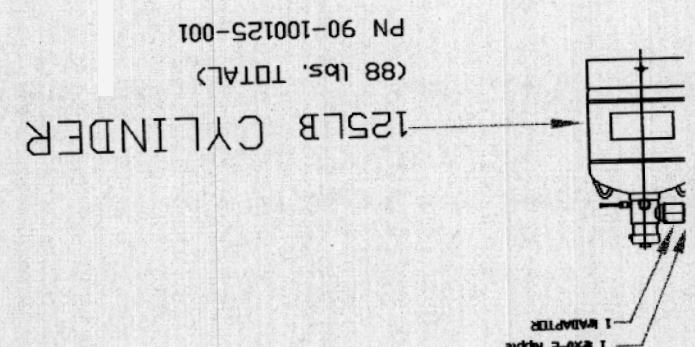

- LEGEND**
- ⊙ PHOTOELECTRIC DETECTOR
  - ⊙ IONIZATION DETECTOR
  - ⊠ STROBE WARNING LIGHT/ALARM HORN
  - ⊠ ABORT SWITCH
  - ⊠ MANUAL PULL STATION
  - SCORPIO CONTROL PANEL
  - ⤴ DISCHARGE PRESSURE SWITCH
  - ⊙ FM-200 NOZZLE

**GENERAL NOTES**

ALL PIPE WILL BE SCHD-40, A-53 SEAMLESS PIPE.

ALL PIPING @ 7'-10" FROM RAISED FLR. ALL EQUIPMENT WILL BE INSIDE THE PROTECTED SPACE.

CONNECT SYSTEM PANEL TO SHUT DOWN HVAC AND TIE 'SCORPIO' INTO MAIN BLDG FIRE ALARM.

ALL HANGERS SHALL BE SPLIT RINGS SECURED BY FM PLATES AND ALL THREAD ROD.

