

Location of Construction: 1 City Center		Owner: 1 City Center Assoc.	Phone: 775-4482/Jin	960781 <div style="border: 2px solid black; padding: 5px; text-align: center;"> PERMIT ISSUED Permit Issued: AUG - 8 1996 CITY OF PORTLAND </div>
Owner Address: SAA FCID, ME 04101	Leasee/Buyer's Name:	Phone:	Business Name: Aquarius Travel	
Contractor Name: Owner	Address:	Phone:		
Past Use: Office	Proposed Use: Same	COST OF WORK: \$ 25,000.00	PERMIT FEE: \$ 125.00	
Proposed Project Description: Make Interior renovations 1st fl		FIRE DEPT. <input checked="" type="checkbox"/> Approved <input type="checkbox"/> Denied	INSPECTION: Use Group: B Type: 1A	Zone: B3 CBL: 032-1-002
		Signature: <i>[Signature]</i>	Signature: <i>[Signature]</i>	Zoning Approval: <i>[Signature]</i>
		PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.)	Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied	Special Zone or Reviews: <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan maj <input type="checkbox"/> minor <input type="checkbox"/> mm <input type="checkbox"/>
Permit Taken By: Nary Greshk	Date Applied For: 07 August 1996			Zoning Appeal: <input type="checkbox"/> Variance <input type="checkbox"/> Miscellaneous <input type="checkbox"/> Conditional Use <input type="checkbox"/> Interpretation <input type="checkbox"/> Approved <input type="checkbox"/> Denied

1. This permit application doesn't preclude the Applicant(s) from meeting applicable State and Federal rules.
2. Building permits do not include plumbing, septic or electrical work.
3. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work..

PERMIT ISSUED WITH REQUIREMENTS
PERMIT ISSUED WITH REQUIREMENTS

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit

07 August 1996

SIGNATURE OF APPLICANT *[Signature]* **John O'Donnell** ADDRESS: _____ DATE: _____ PHONE: _____

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE _____ PHONE: _____

Historic Preservation
 Not in District or Landmark
 Does Not Require Review
 Requires Review

Action:
 Approved
 Approved with Conditions
 Denied

Date: *[Signature]*

CEO DISTRICT 2

T. H. ...

COMMENTS

8/30/96 - Work complete - need to add heat sensors & 1 exit sign.

OK AR

	Type	Inspection Record	Date
Foundation:	_____	_____	_____
Framing:	_____	_____	_____
Plumbing:	_____	_____	_____
Final:	_____	_____	_____
Other:	_____	_____	_____

BUILDING PERMIT REPORT

DATE: 8/AUG/96 ADDRESS: 1 City Center

REASON FOR PERMIT: To make Interior renovation

BUILDING OWNER: 1 City Center Assoc.

CONTRACTOR: " " " " APPROVED: *12*16

PERMIT APPLICANT: _____ ~~DENIED~~: _____


CONDITION OF APPROVAL OR DENIAL

1. Before concrete for foundation is placed, approvals from the Development Review Coordinator and Inspection Services must be obtained. (A 24 hour notice is required prior to inspection)
2. Precaution must be taken to protect concrete from freezing.
3. It is strongly recommended that a registered land surveyor check all foundation forms before concrete is placed. This is done to verify that the proper setbacks are maintained.
4. All vertical openings shall be enclosed with construction having a fire rating of at least one(1) hour, including fire doors with selfclosers.
5. Each apartment shall have access to two(2) separate, remote and approved means of egress. A single exit is acceptable when it exits directly from the apartment to the building exterior with no communications to other apartment units.
6. The boiler shall be protected by enclosing with one(1) hour fire-rated construction including fire doors and ceiling, or by providing automatic extinguishment. Sprinkler piping serving not more than six sprinklers may be connected to a domestic water supply having a capacity sufficient to provide 0.15 gallons per minute, per square foot of floor throughout the entire area. An INDICATING shut-off valve shall be installed in an accessible location between the sprinkler and the connection to the domestic water supply. Minimum pipe size shall be 3/4 inch copper or 1 inch steel. Maximum coverage area of a residential sprinkler is 144 sq. feet per sprinkler.
7. Every sleeping room below the fourth story in buildings of Use Groups R and I-1 shall have at least one operable window or exterior door approved for emergency egress or rescue. The units must be operable from the inside without the use of special knowledge or separate tools. Where windows are provided as means of egress or rescue, they shall have a sill height not more than 44 inches (1118mm) above the floor. All egress or rescue windows from sleeping rooms shall have a minimum net clear opening height dimension of 24 inches (610mm). The minimum net clear opening width dimension shall be 20 inches (508 mm), and a minimum net clear opening of 5.7 sq. feet.
8. A portable fire extinguisher shall be located as per NFPA #10. They shall bear the label of an approved agency and be of an approved type.
9. All single and multiple station smoke detectors shall be of an approved type and shall be installed in accordance with the provisions of the City's building code Chapter 9, section 19, 919.3.2(BOCA National Building Code/1993), and NFPA 101 Chapter 18 & 19. (Smoke detectors shall be installed and maintained at the following locations):

1. In the immediate vicinity of bedrooms
2. In all bedrooms
3. In each story within a dwelling unit, including basements

In addition to the required AC primary power source, required smoke detectors in occupancies in Use Groups R-2, R-3 and I-1 shall receive power from a battery when the AC primary power source is interrupted.

10. Private garages located beneath habitable rooms in occupancies in Use Group R-1, R-2, R-3 or I-1 shall be separated from adjacent interior spaces by fire partitions and floor/ceiling assembly which are constructed with not less than 1-hour fire resisting rating. Private garages attached side-by-side to rooms in the above occupancies shall be completely separated from the interior spaces and the attic area by means of 1/2 inch gypsum board or the equivalent applied to the garage side. (Chapter 4 section 407.0 of the BOCA/1993)
11. Guardrail & Handrails-A guardrail system is a system of building components located near the open sides of elevated walking surfaces for the purpose of minimizing the possibility of an accidental fall from the walking surface to the lower level. Minimum height all Use Groups 42", except Use Group R which is 36". In occupancies in Use Group A, B, H-4, I-1, I-2 M and R and public garages and open parking structures, open guards shall have balusters or be of solid material such that a sphere with a diameter of 4" cannot pass through any opening. Guards shall not have an ornamental pattern that would provide a ladder effect.
- X 12. All exit signs, lights, and means of egress lighting shall be done in accordance with Chapter 10, section & subsections 1023. & 1024. of the City's building code. (The BOCA National Building Code/1993)
13. Stair construction in Use Group R-3 & R-4 is a minimum of 9" tread and 8-1/4" maximum rise. ~~All other Use Group minimum 11" tread, 7" maximum rise.~~
14. Headroom in habitable space is a minimum of 7'6".
15. The minimum headroom in all parts of a stairway shall not be less than 80 inches.
- X 16. All construction and demolition debris must be disposed at the City's authorized reclamation site. The fee rate is attached. Proof of such disposal must be furnished to the office of Inspection Services before final Certificate of Occupancy is issued or demolition permit is granted.
17. Section 25-135 of the Municipal Code for the City of Portland states, "No person or utility shall be granted a permit to excavate or open any street or sidewalk from the time of November 15 of each year to April 15 of the following year".
18. The builder of a facility to which Section 4594-C of the Maine State Human Rights Act, Title 5 MRSA refers, shall obtain a certification from a design professional that the plans of the facility meet the standards of construction required by this section. Prior to commencing construction of the facility, the builder shall submit the certification to the Division of Inspection Services.
19. This permit does not excuse the applicant from obtaining any license which may be needed from the City Clerk's Office.



P. Samuel Hoffis, Chief of Inspection Services

/el 3/16/95

PREPARED BY:
 RICHARD J. DOUGHLIN, P.E.

PROJECT:
 One City Center
 Landis & Gyr

DATE: 8/1/92
 SCALE: NONE
 DRAWING NO: M1

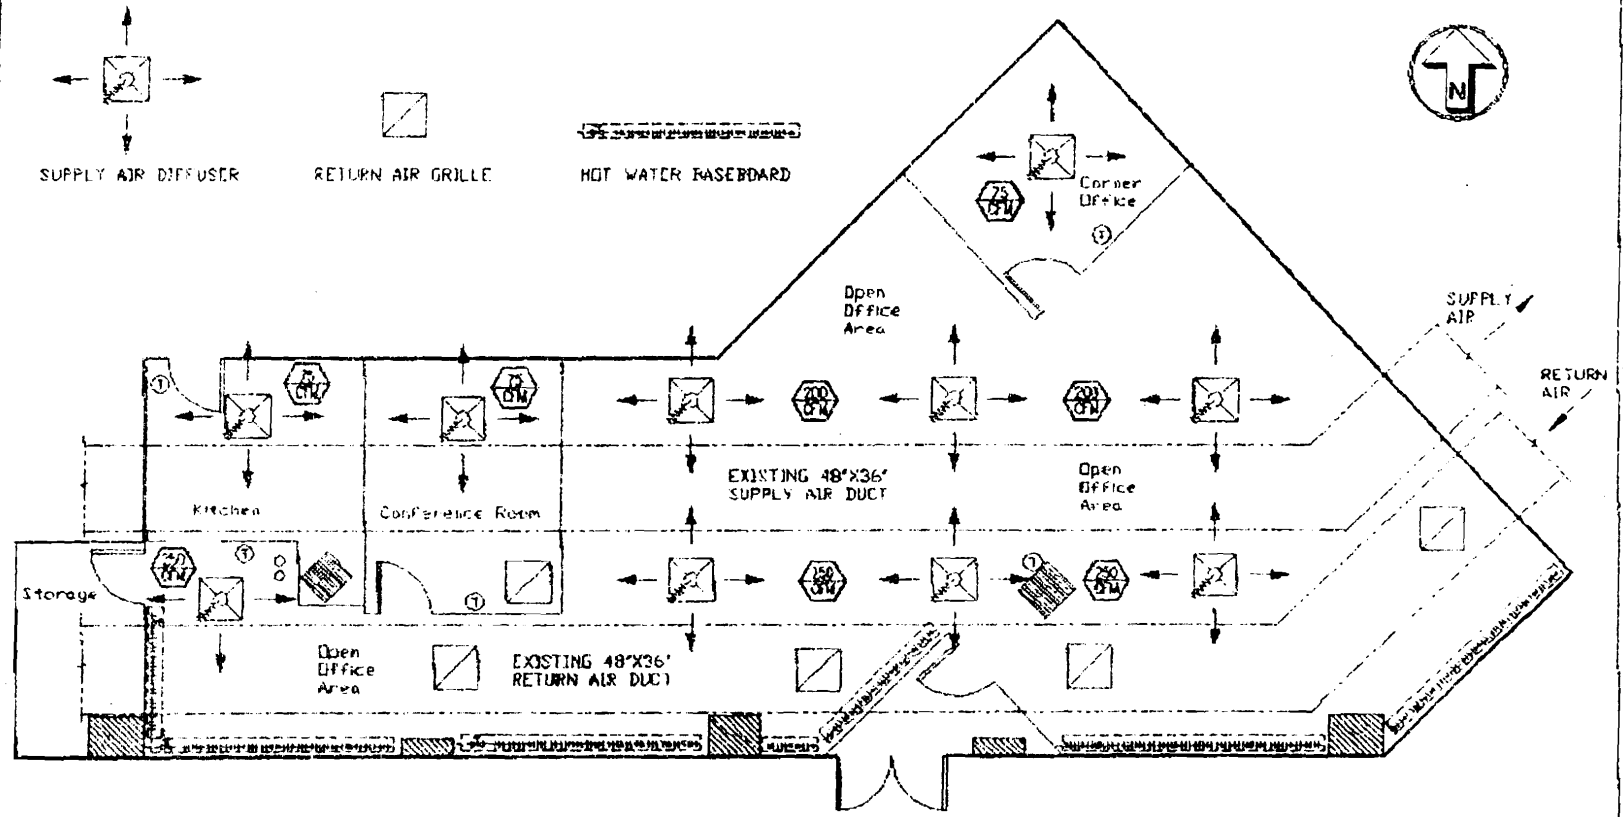

GROUND LEVEL MECHANICAL PLAN
 SCALE: NONE


HVAC NOTES:

1. SENSIBLE COOLING LOADS:
 - A) Kitchen - 1700 BTUH @ 77 CFM
 - B) Conference Room - 1600 BTUH @ 73 CFM
 - C) Corner Office - 1420 BTUH @ 65 CFM
 - D) Open Office Area - 35,600 BTUH @ 1600 CFM
2. HEATING LOADS:
 - A) Kitchen - 780 BTUH
 - B) Conference Room - 660 BTUH
 - C) Corner Office - 780 BTUH
 - D) Open Office Area - 32,000 BTUH
3. The 48"x36" main supply/return air ducts in this space shall provide the HVAC air.
4. VAV boxes are not shown due to space limitations, but shall be ducted from the 48"x36" supply duct and thence to the supply air diffusers. The VAV boxes are to be provided by the owner.
5. Supply air diffusers are shown in approximate locations. supply air volumes per diffuser are in the hexagon boxes.
6. Space above the suspended ceiling is tight due to the existing ductwork, electrical conduit, various piping, etc. Contractor to verify locations of these items.
7. Return air grilles shall be designed for 400 CFM each and shall be located directly under the existing return air duct, except for the Conference Room grille which shall be designed for 75 CFM and ducted to the return duct.
8. VAV boxes shall feed the supply air diffusers and shall be installed at the following locations:
 - A) Kitchen
 - B) Conference Room *
 - C) Corner Office *
 - D) Open Office area (3 VAV boxes required):
 1. To serve the 200 CFM diffusers.
 2. To serve the 250 CFM diffusers.
 3. To serve the 250 CFM diffuser located near the kitchen.
- * With Hot Water reheat coil. Size according to heating loads.
9. Control system per Landis & Gyr specifications.
10. Hot water piping to the reheat coils and baseboard units not shown on plan. Contractor to tie into existing 2" hot water pipes at ceiling.
11. Supply air shall be balanced for diffusers in open office area.
12. See Day M2 for the hot water baseboard heating system.


PREPARED BY:
 RICHARD J. COUGHLIN, P.E.

PROJECT:
 One City Center
 Landis & Gyr

DATE: 8/1/96
 SCALE: NONE
 DRAWING NO: M2

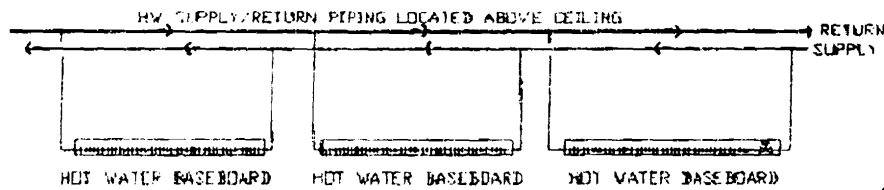

Hot Water Baseboard Piping Schematic

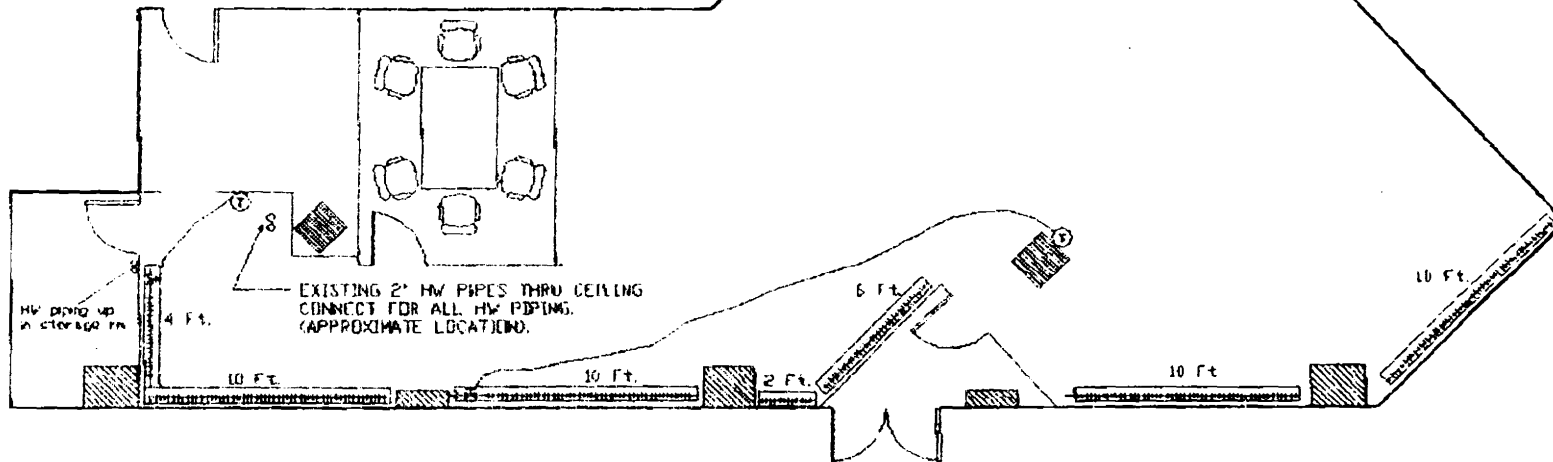


GROUND LEVEL BASEBOARD HEAT PLAN

SCALE: NONE

BASEBOARD HEATING NOTES:


1. Baseboard panels shall be Runtal Model R2F-1, radiant and convective panels, rated @ 690 BTUH/lin. ft. (180 F HW temp and 65 F EAT).
2. Approximate locations to be as shown on plan. Contractor to determine exact radiator lengths, approximate length shown on drawing.
3. Existing concrete columns to be framed and used to run HW piping to radiators.
4. Radiators to be pedestal mounted 3" above floor. Provide Runtal KR20 pedestal brackets as required per manufacturer.
5. Radiator and pedestal color to be selected by the owner.
6. Provide two independent thermostatically controlled zones as shown on this plan. Mount thermostats on interior wall 48" AIT.
7. Radiator against entry foyer may require end fed connections, others may use opposite end connections.
8. See Dwg. RI for VAV box and diffuser locations.



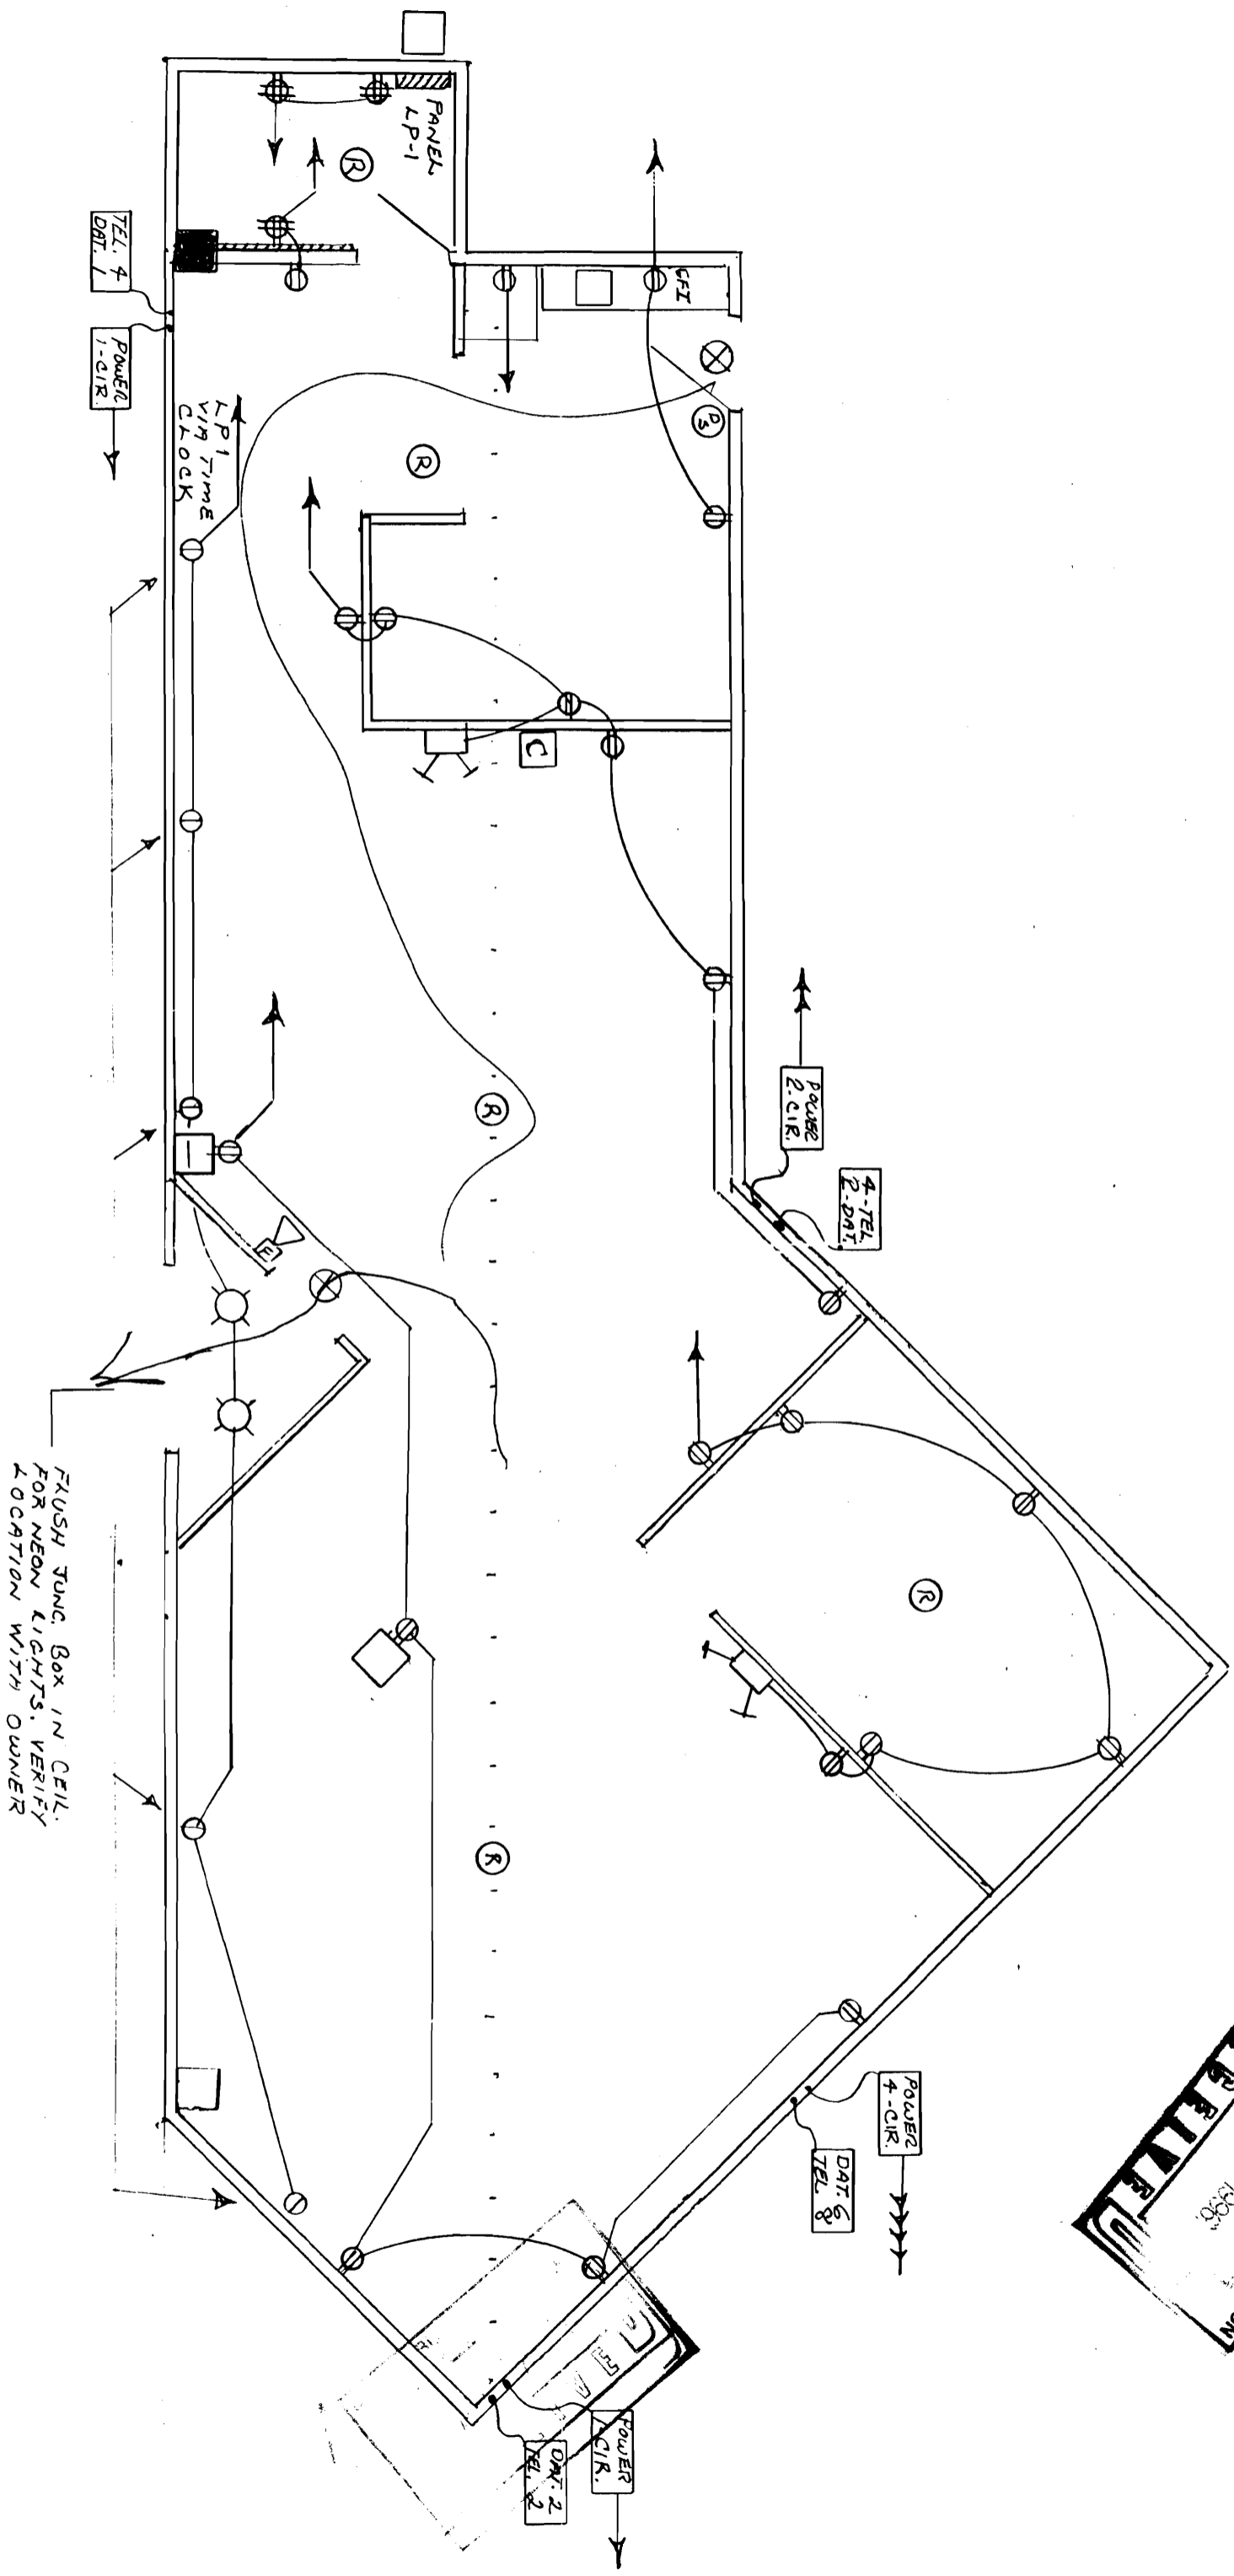

DEPT. OF BUILDING INSPECTION
 CITY OF HOUSTON
 AUG - 7 1987
 REGISTERED

FUSH TUNG. BOX IN CEIL.
 FOR NEON LIGHTS. VERIFY
 LOCATION WITH OWNER

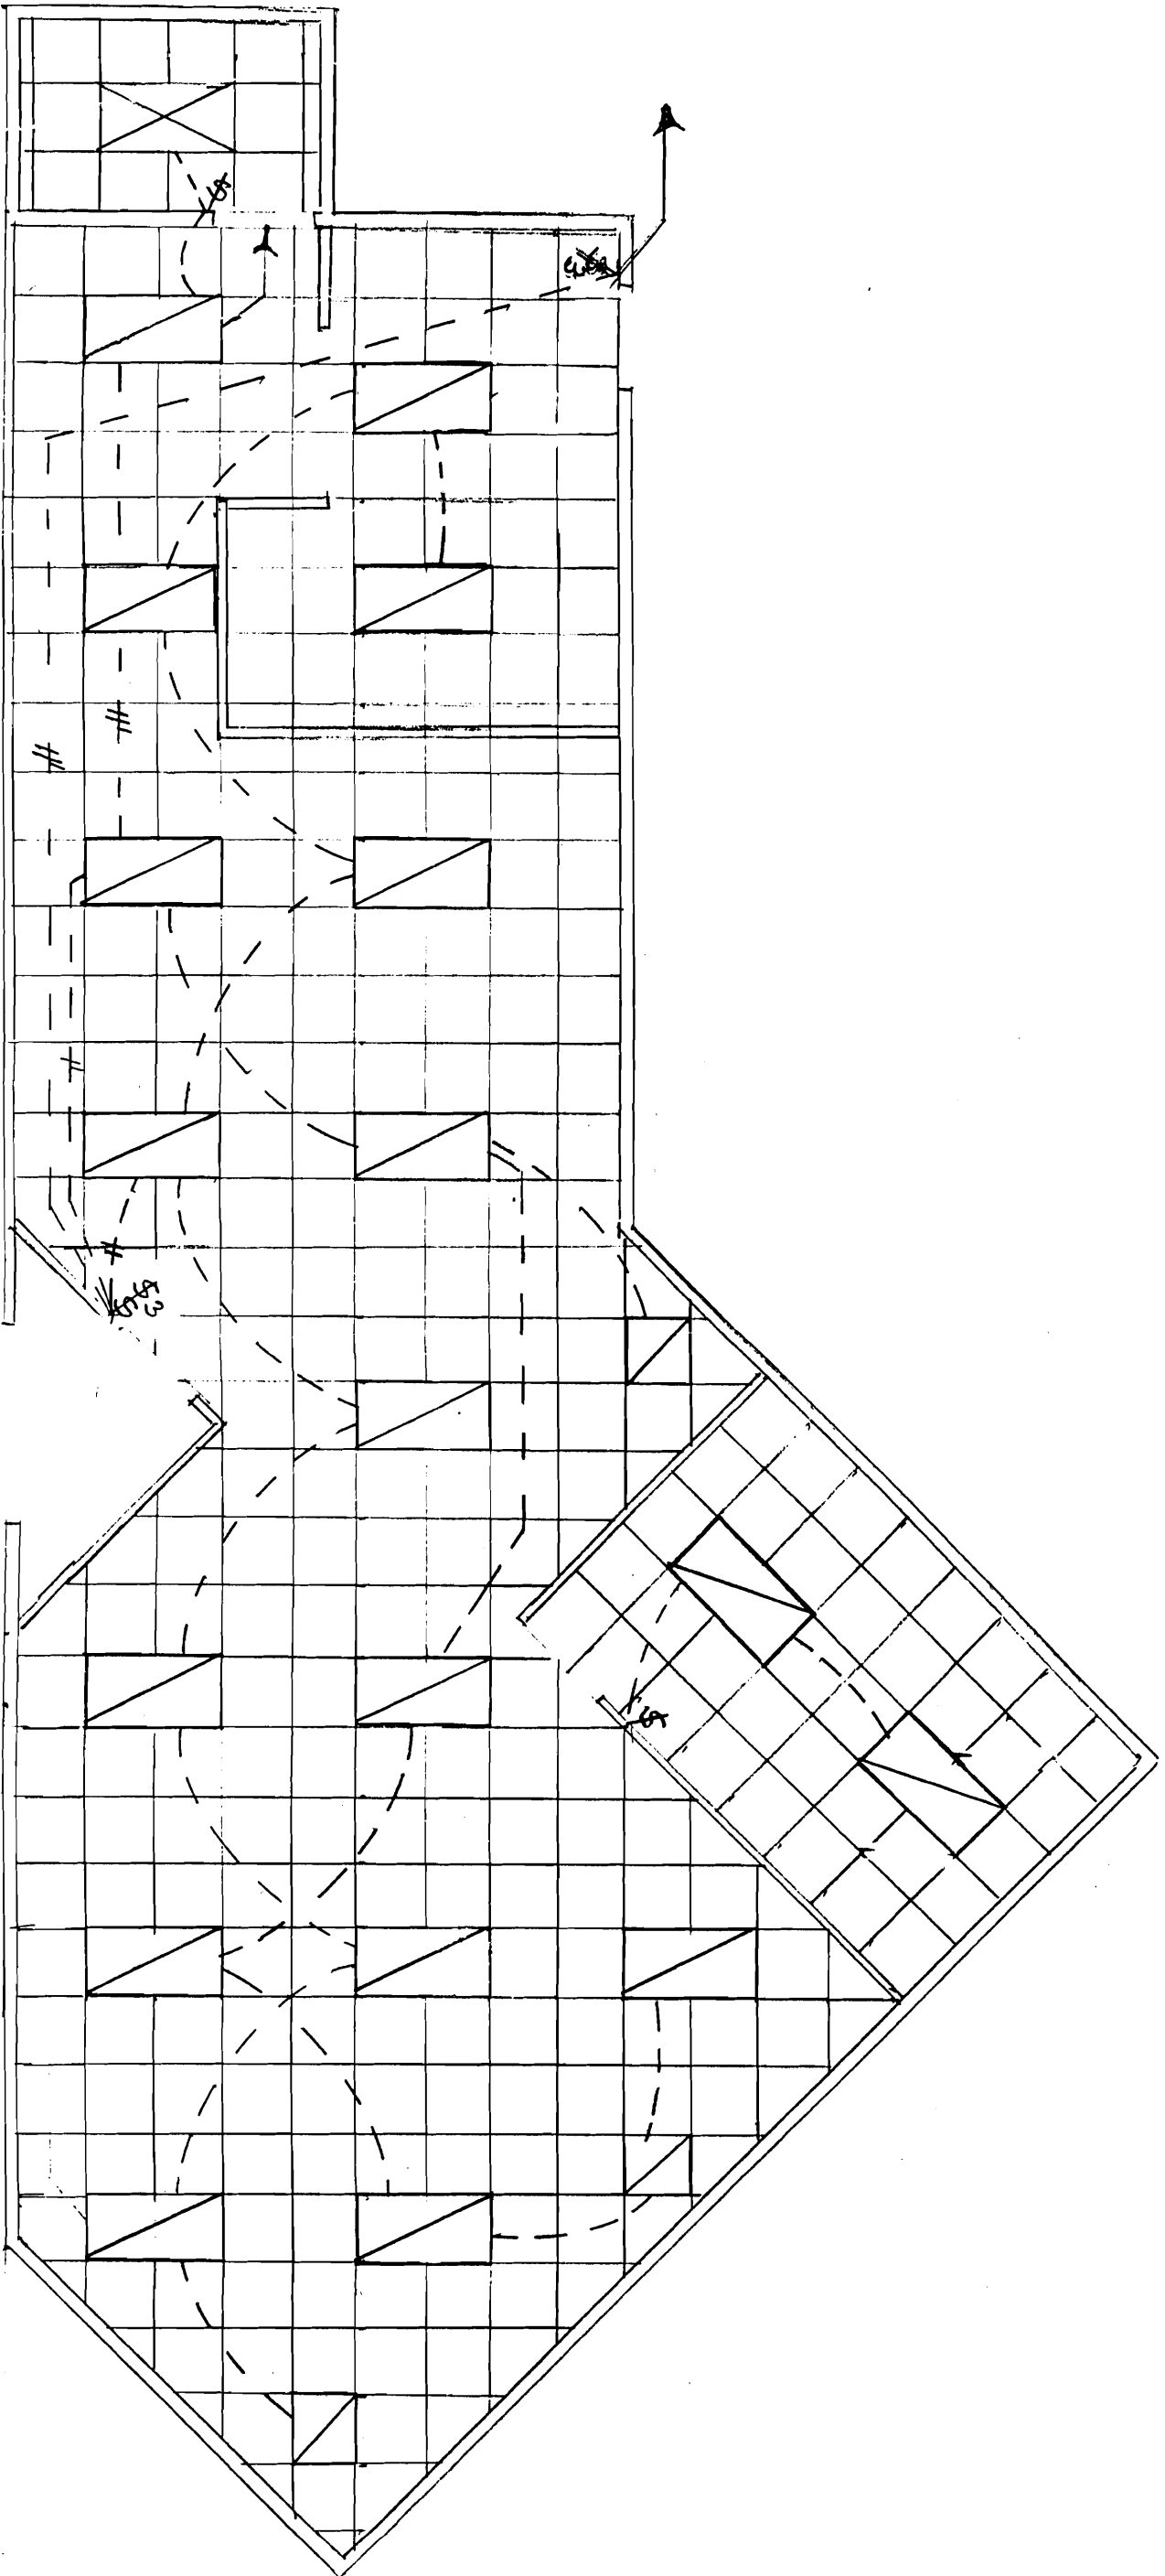

O.C.C. 1ST. FLOOR

3/16" = 1'0"

