


NOTE: USE THICKNESSES SHOWN OR MATCH EXISTING, WHICH EVER IS GREATER.


PAVEMENT DETAILS **C1**

NOT TO SCALE

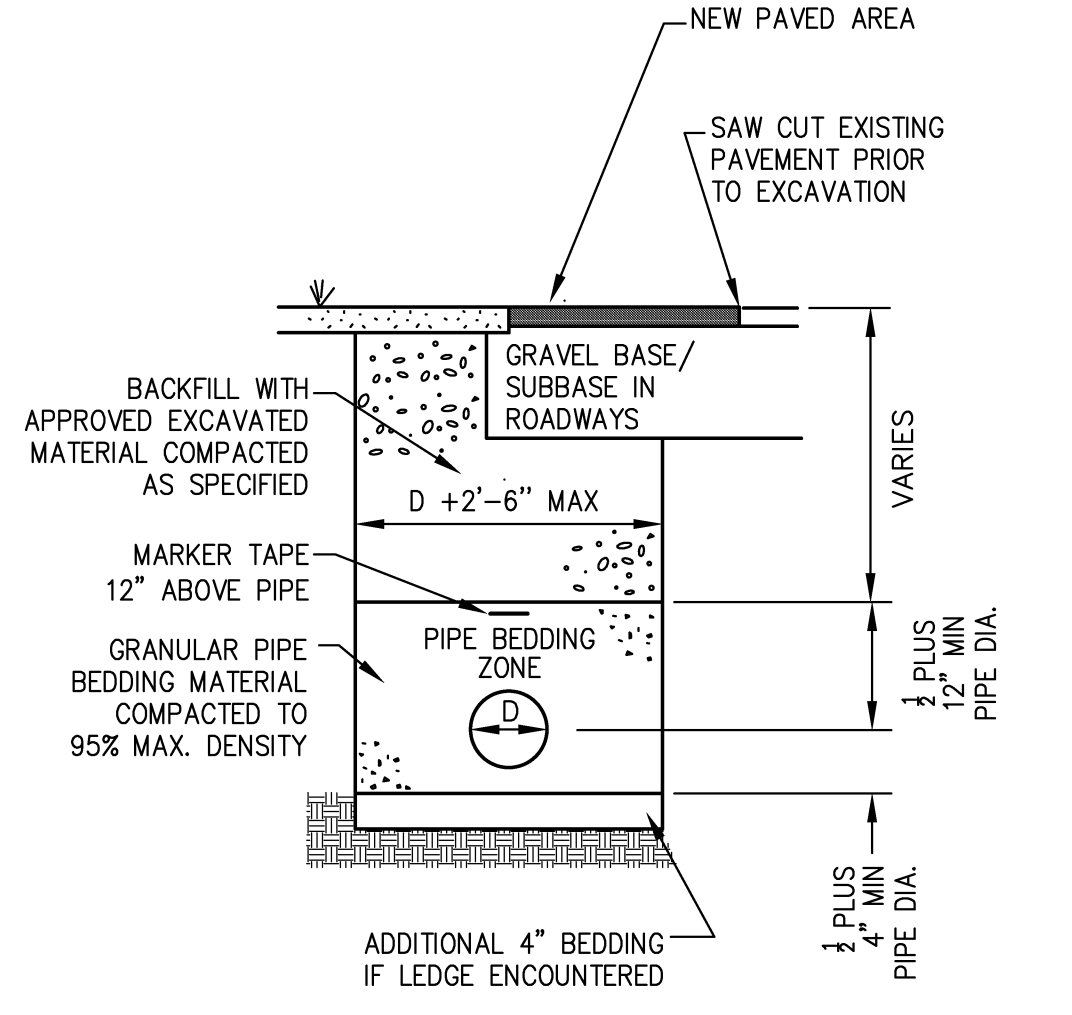


PIPE TRENCH **B1**

NOT TO SCALE

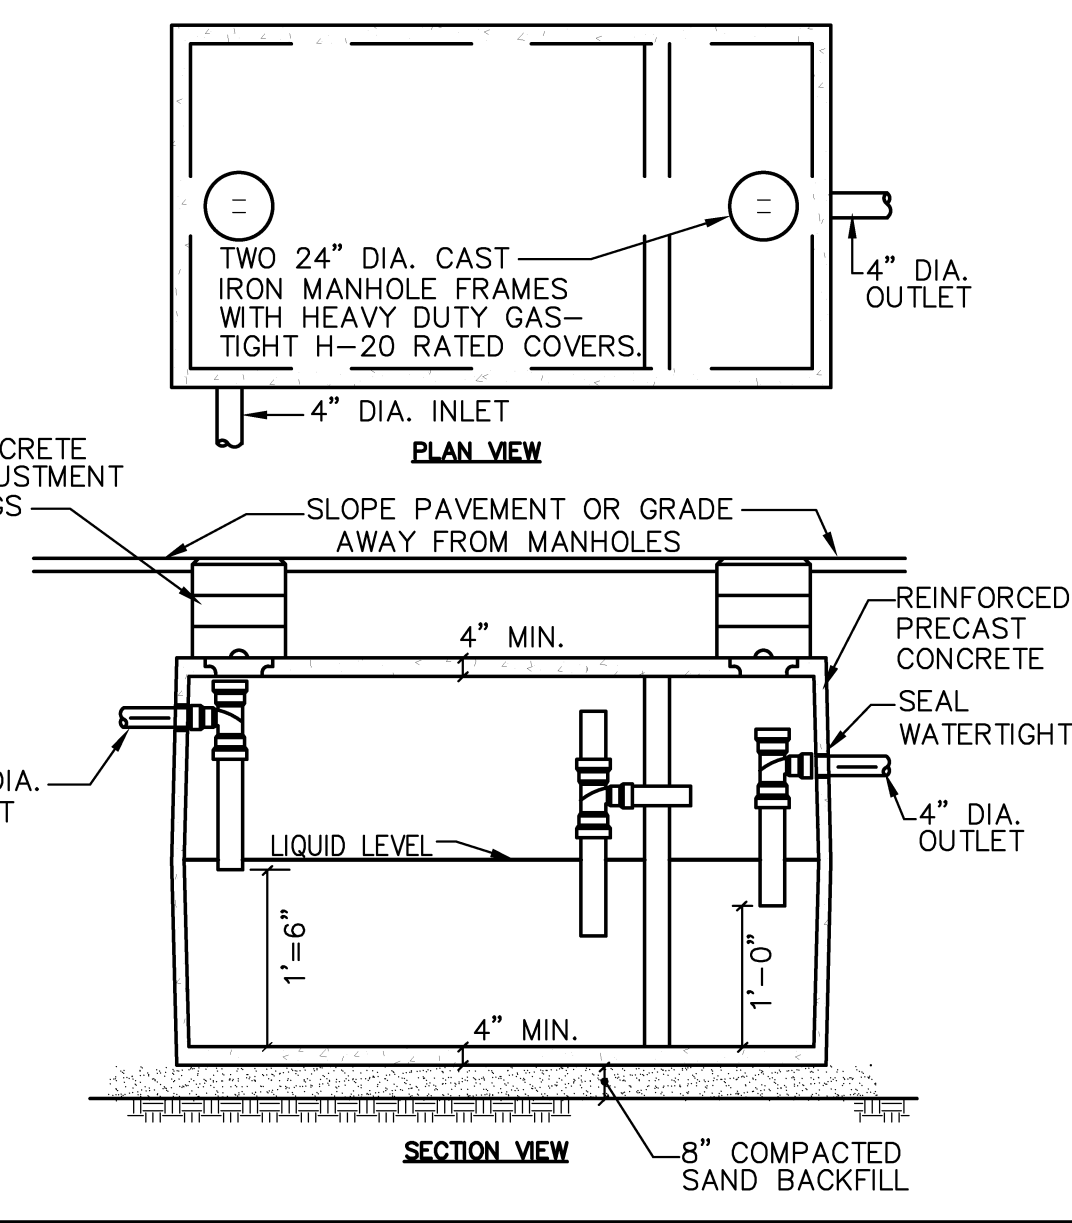


1000 GALLON P.C. CONCRETE GREASE TRAP **A1**

NOT TO SCALE

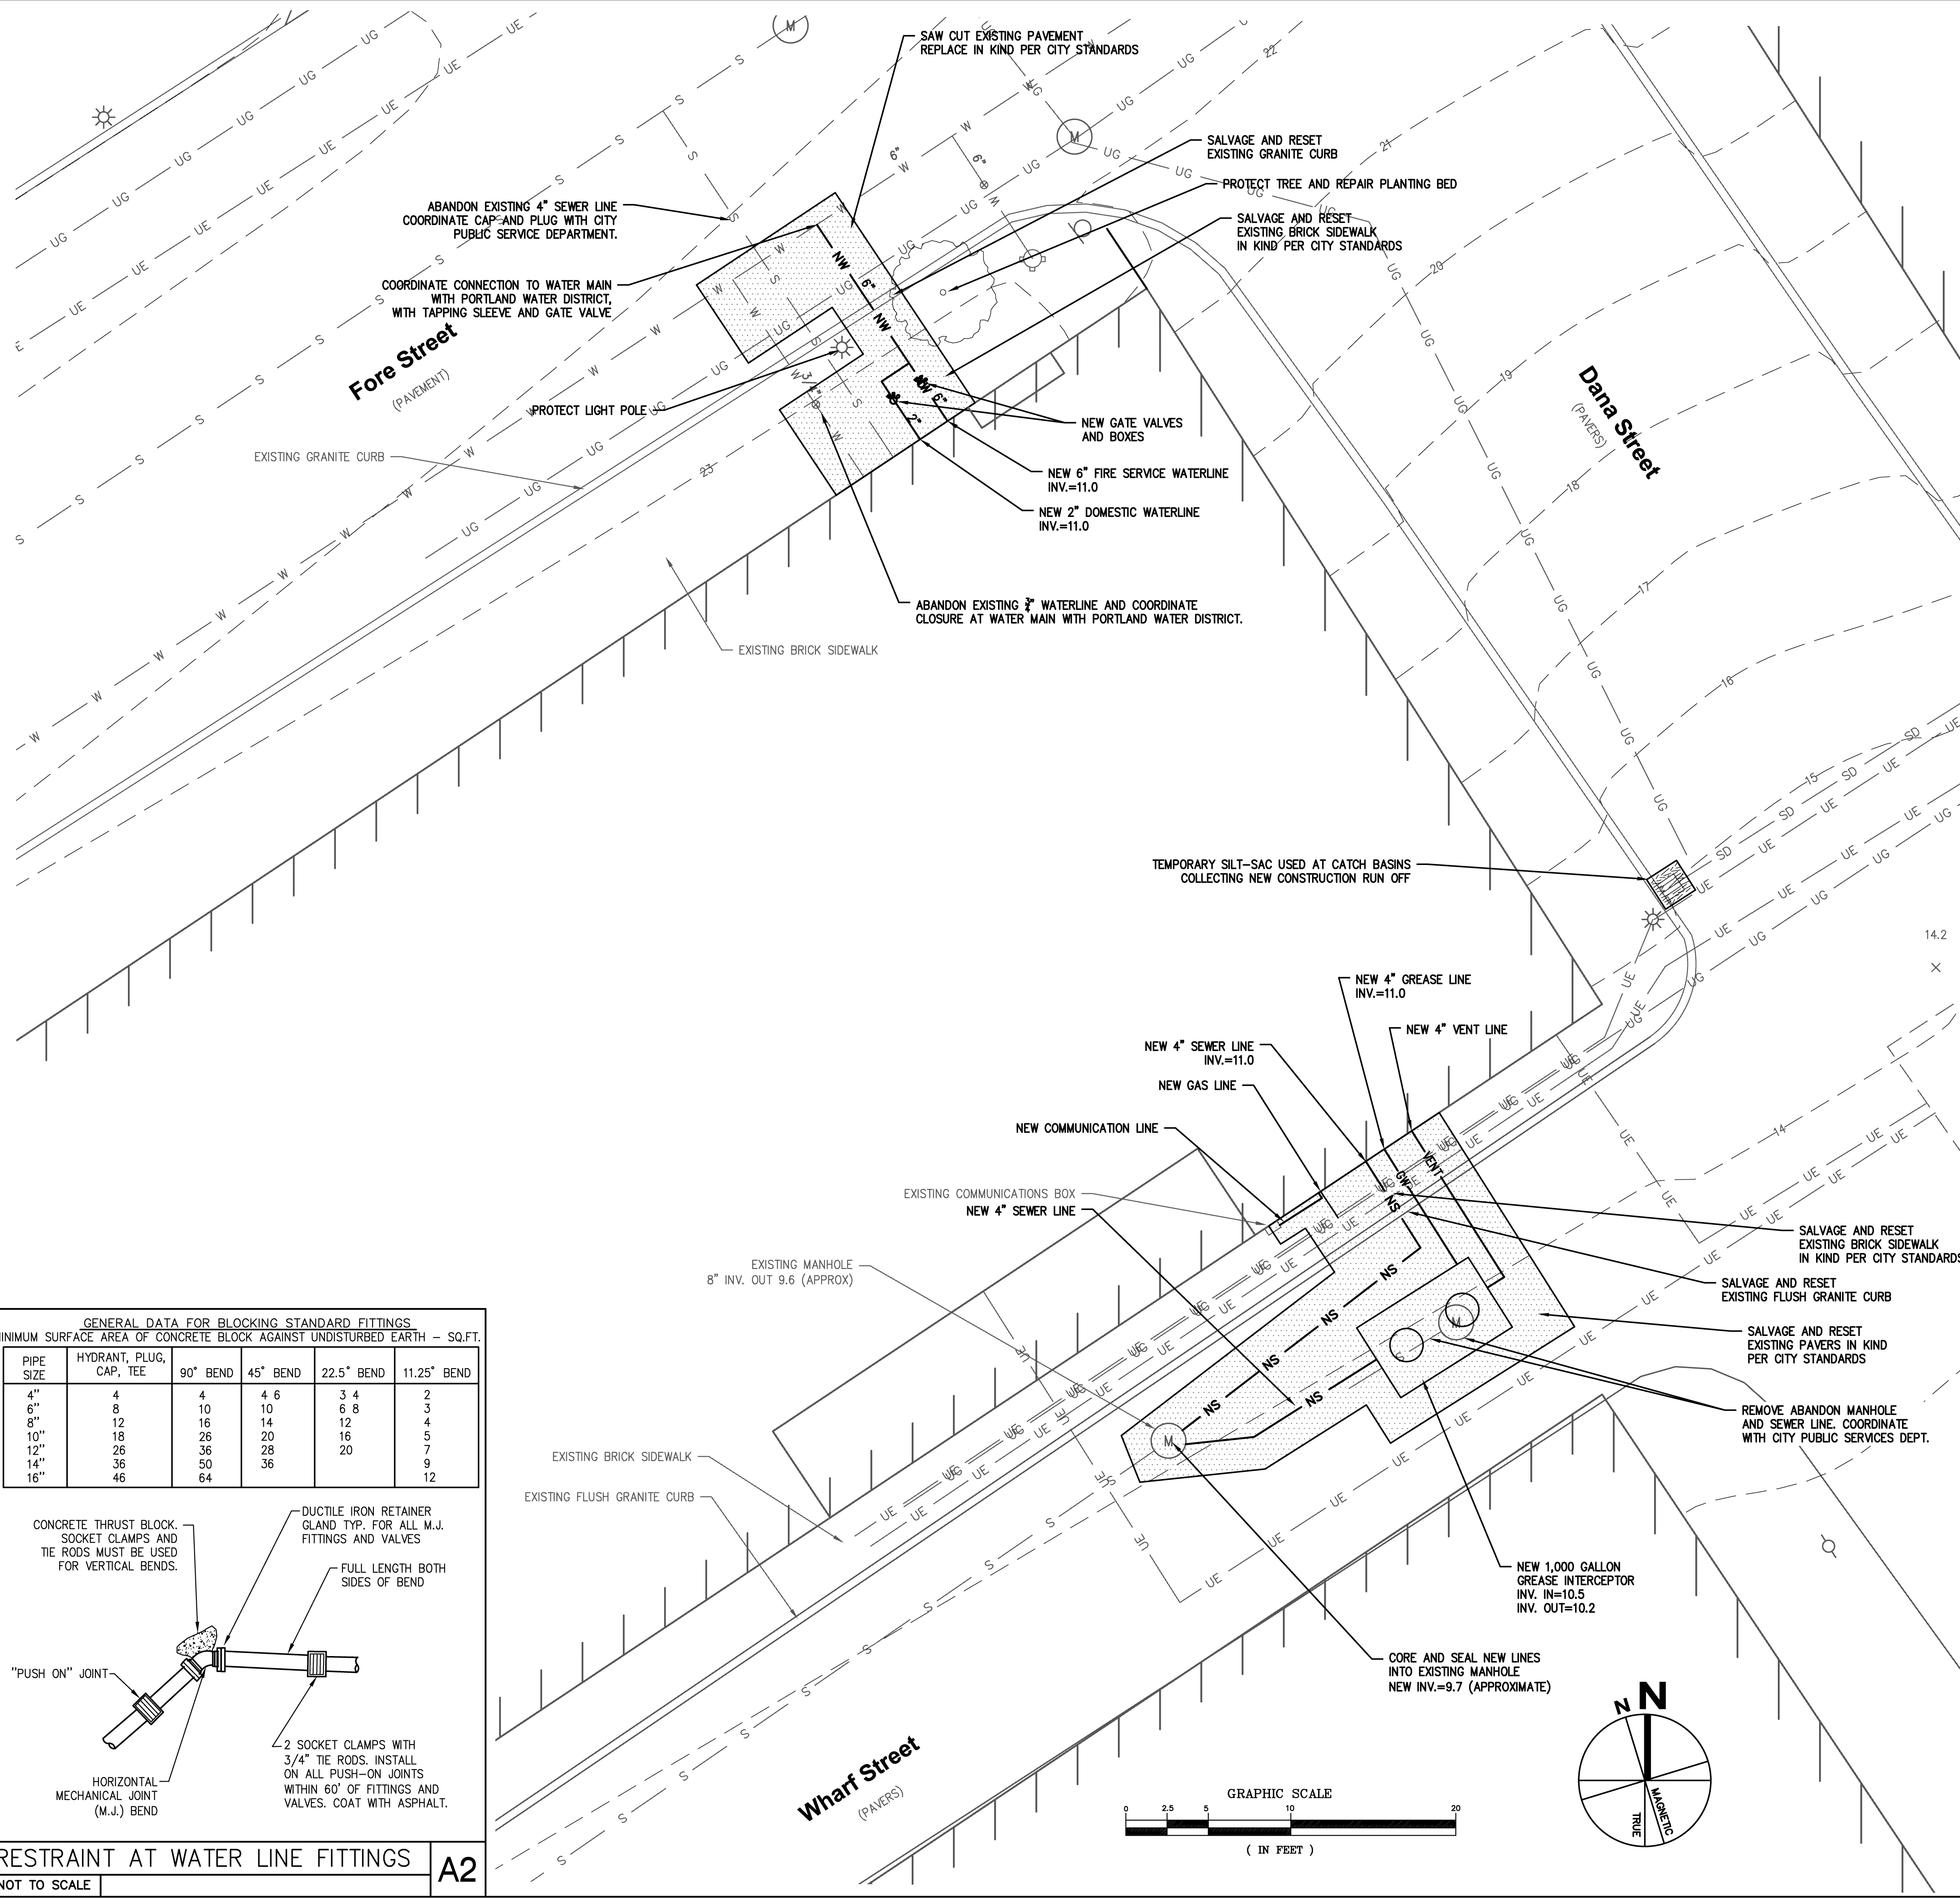

GENERAL DATA FOR BLOCKING STANDARD FITTINGS
MINIMUM SURFACE AREA OF CONCRETE BLOCK AGAINST UNDISTURBED EARTH - SQ.FT.

PIPE SIZE	HYDRANT, PLUG, CAP, TEE	90° BEND	45° BEND	22.5° BEND	11.25° BEND
4"	4	4	4	3	2
6"	8	10	10	6	3
8"	12	16	14	12	4
10"	18	26	20	16	5
12"	26	36	28	20	7
14"	36	50	36		9
16"	46	64	36		12

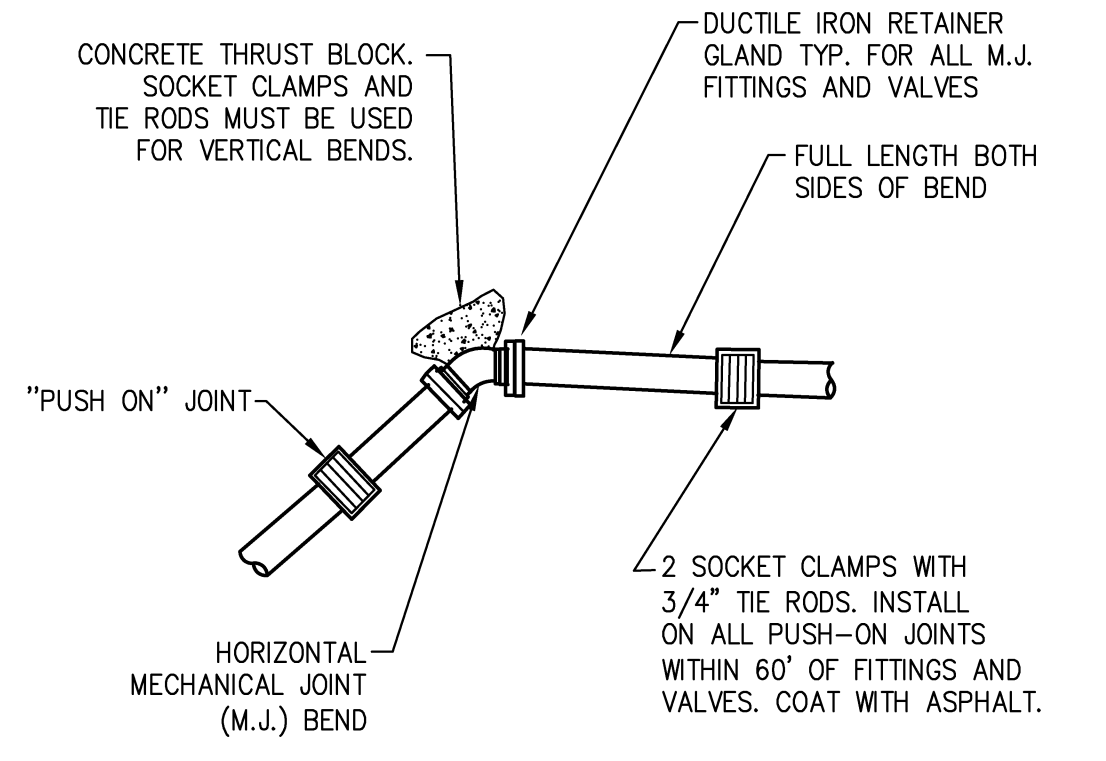

RESTRAINT AT WATER LINE FITTINGS **A2**


NOT TO SCALE

GOULD RESTAURANT

PORTLAND, MAINE
Harriman Project No. 12752
Key Plan

Issues and Revisions

Mark	Date	Description
	5-21-13	75% REVIEW
	5-31-13	ISSUED FOR CONSTRUCTION
	7-26-13	RE-ISSUED FOR CONSTRUCTION
	9-23-13	RE-ISSUED FOR CONSTRUCTION

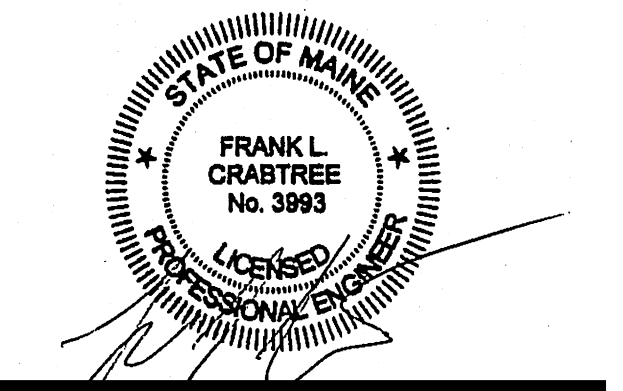

PA / PE: FLC
Drawn By: PLS
© 2013
Harriman Associates

SITE PLAN

C00.1