


Mark	Date	Description
--	05-21-13	75% REVIEW
--	05-31-13	ISSUED FOR CONSTRUCTION
--	07-26-13	RE-ISSUED FOR CONSTRUCTION
--	09-23-13	RE-ISSUED FOR CONSTRUCTION

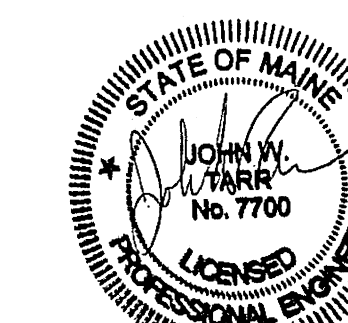


Drawing Scales	0 2' 4' 6'
1/4" = 1'-0"	

PA / PE: JWT	© 2013
Drawn By: DSH	Harriman Associates


ELECTRICAL  
PART PLANS  
POWER & SYSTEMS

LOAD DESCRIPTION	AMP	POLE	DWC CRKT NO.	DWC CRKT NO.	WATTS	WATT LOADS			WATTS	DWC CRKT NO.	DWC CRKT NO.	AMP	LOAD DESCRIPTION	
						PH A	PH B	PH C						
TUB 1 OF 1 - REMARKS:														
SPARE - AFCI	20	1	1	1	0	0	---	---	0	2	2	1	20	SPARE - AFCI
SPARE - AFCI	20	1	3	3	0	---	0	---	0	4	4	1	20	SPARE - AFCI
SPARE	20	1	5	5	0	---	---	0	0	6	6	1	20	SPARE
SPARE	20	1	7	7	0	0	---	---	0	8	8	1	20	SPARE
SPARE	20	1	9	9	0	---	0	---	0	10	10	1	20	SPARE
SPARE	20	1	11	11	0	---	---	0	0	12	12	1	20	SPARE
SPARE	20	1	13	13	0	0	---	---	0	14	14	1	20	SPARE
SPARE	20	1	15	15	0	---	0	---	0	16	16	1	20	SPARE
SPARE	20	1	17	17	0	---	---	0	0	18	18	1	20	SPARE
SPARE	20	1	19	19	0	0	---	---	0	20	20	1	20	SPARE
SPARE	20	1	21	21	0	---	0	---	0	22	22	1	20	SPARE
SPARE	20	1	23	23	0	---	---	0	0	24	24	1	20	SPARE
SPARE	20	1	25	25	0	0	---	---	0	26	26	1	20	SPARE
SPARE	20	1	27	27	0	---	0	---	0	28	28	1	20	SPARE
SPARE	20	1	29	29	0	---	---	0	0	30	30	1	20	SPARE
SPARE	20	1	31	31	0	0	---	---	0	32	32	1	20	SPARE
SPARE	20	1	33	33	0	---	0	---	0	34	34	1	20	SPARE
SPARE	20	1	35	35	0	---	---	0	0	36	36	1	20	SPARE
SPARE	20	1	37	37	0	0	---	---	0	38	38	1	20	SPARE
SPARE	20	1	39	39	0	---	0	---	0	40	40	1	20	SPARE
SPARE	20	1	41	41	0	---	---	0	0	42	42	1	20	SPARE
0						0	0	0	0	0				


REMARKS: PROVIDE (4) ARC-FAULT CIRCUIT INTERRUPTER TYPE BREAKERS  
7/26/2013

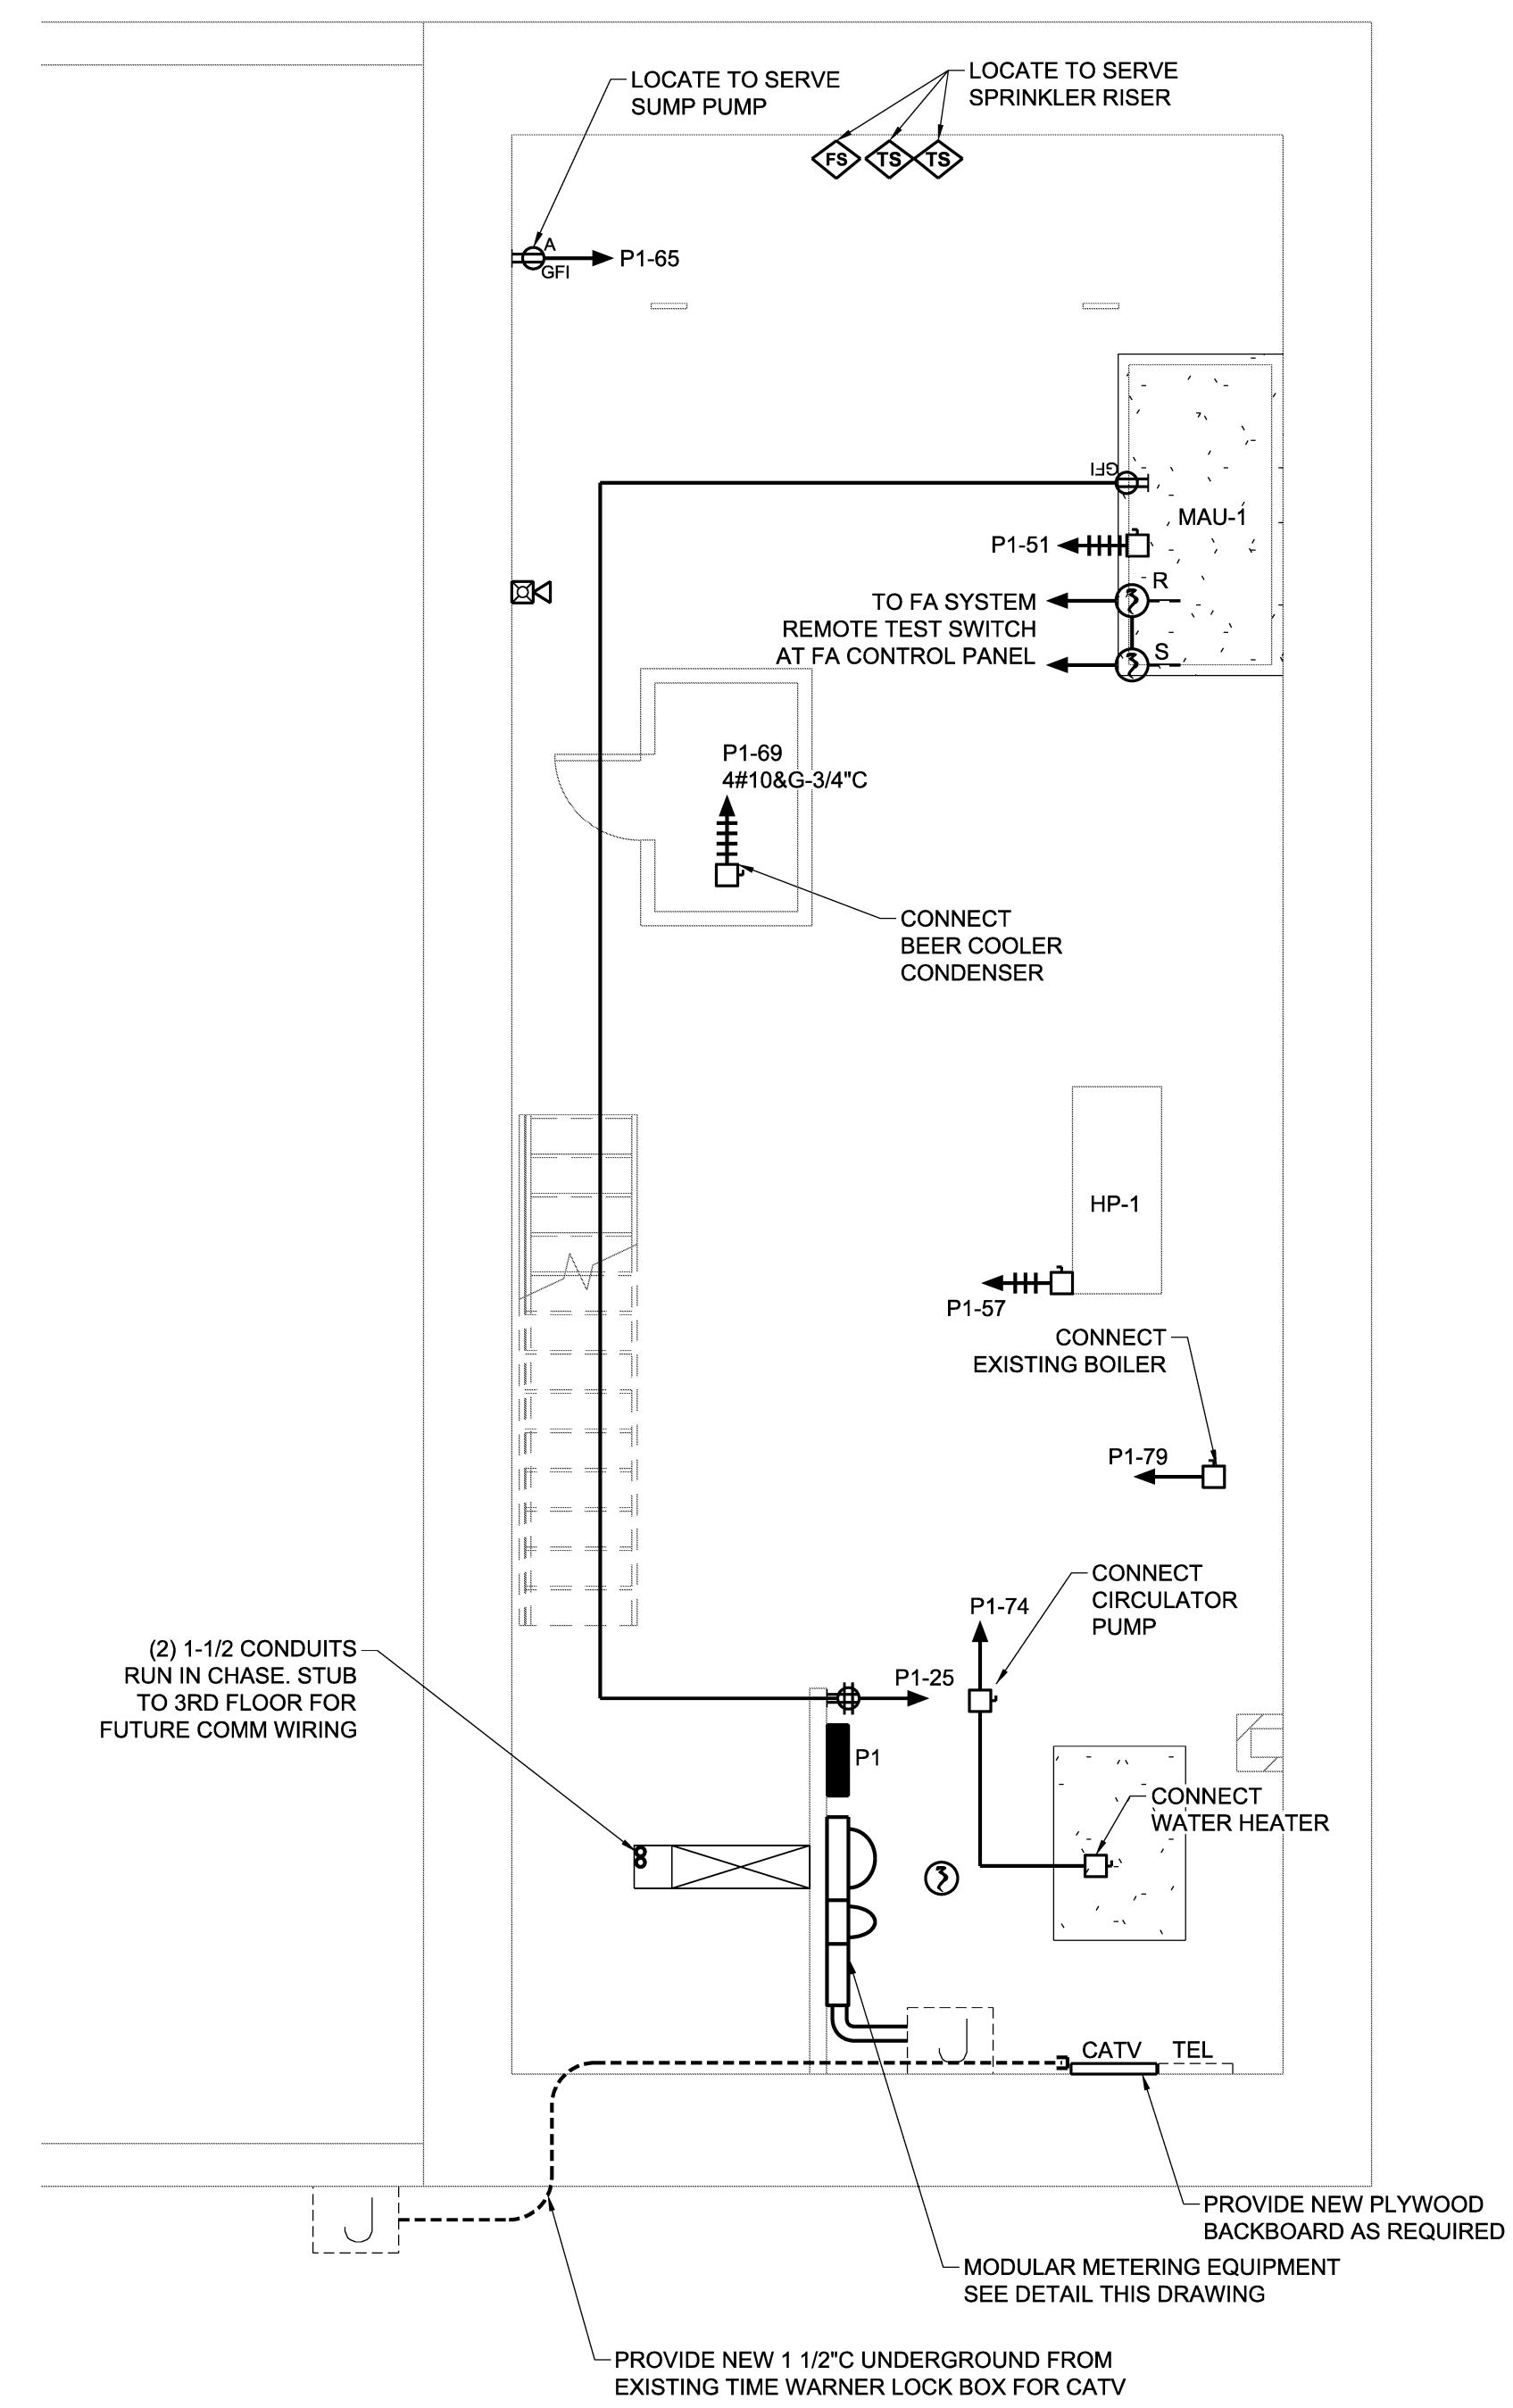

**A1** BASEMENT POWER & SYSTEMS  
SCALE: 1/4" = 1'-0"

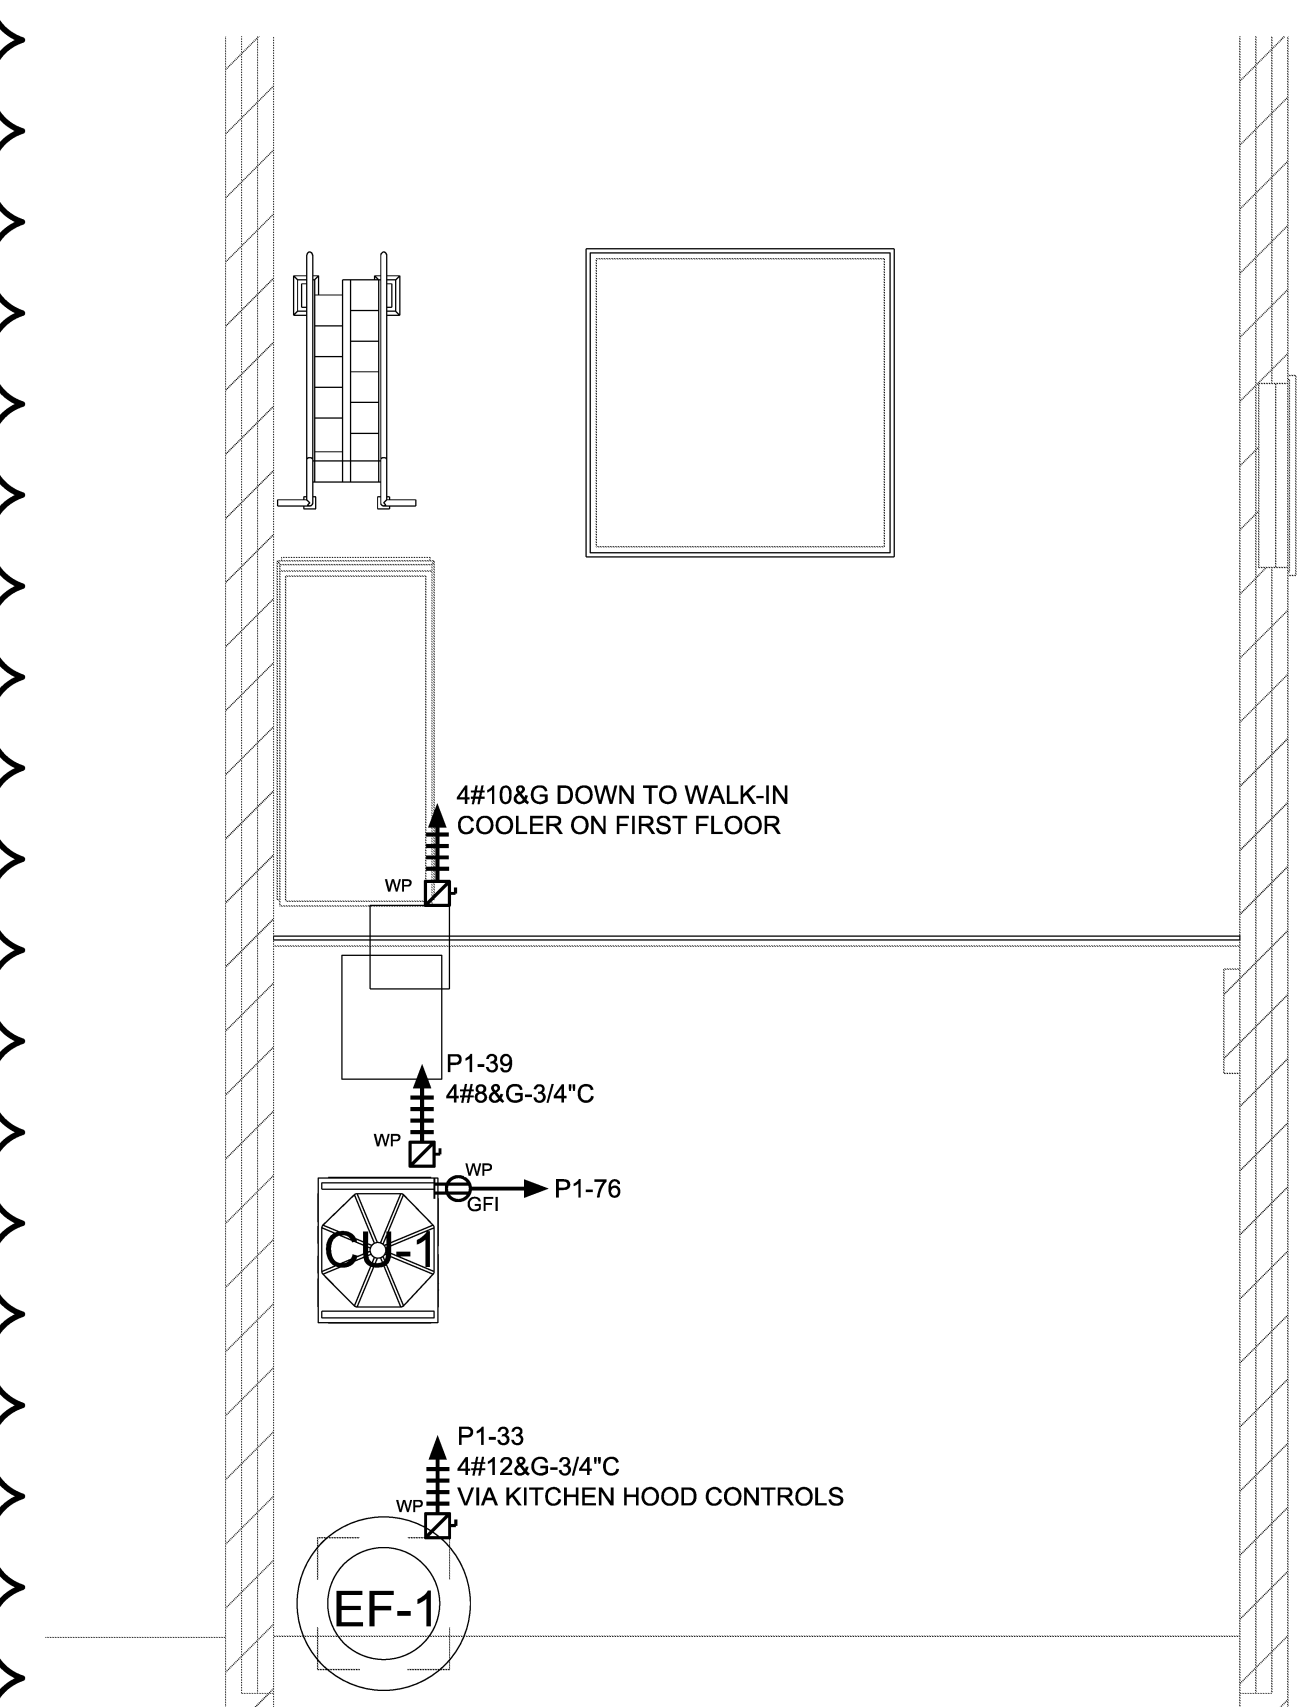

**B2** PART PLAN ROOF POWER  
SCALE: 1/4" = 1'-0"

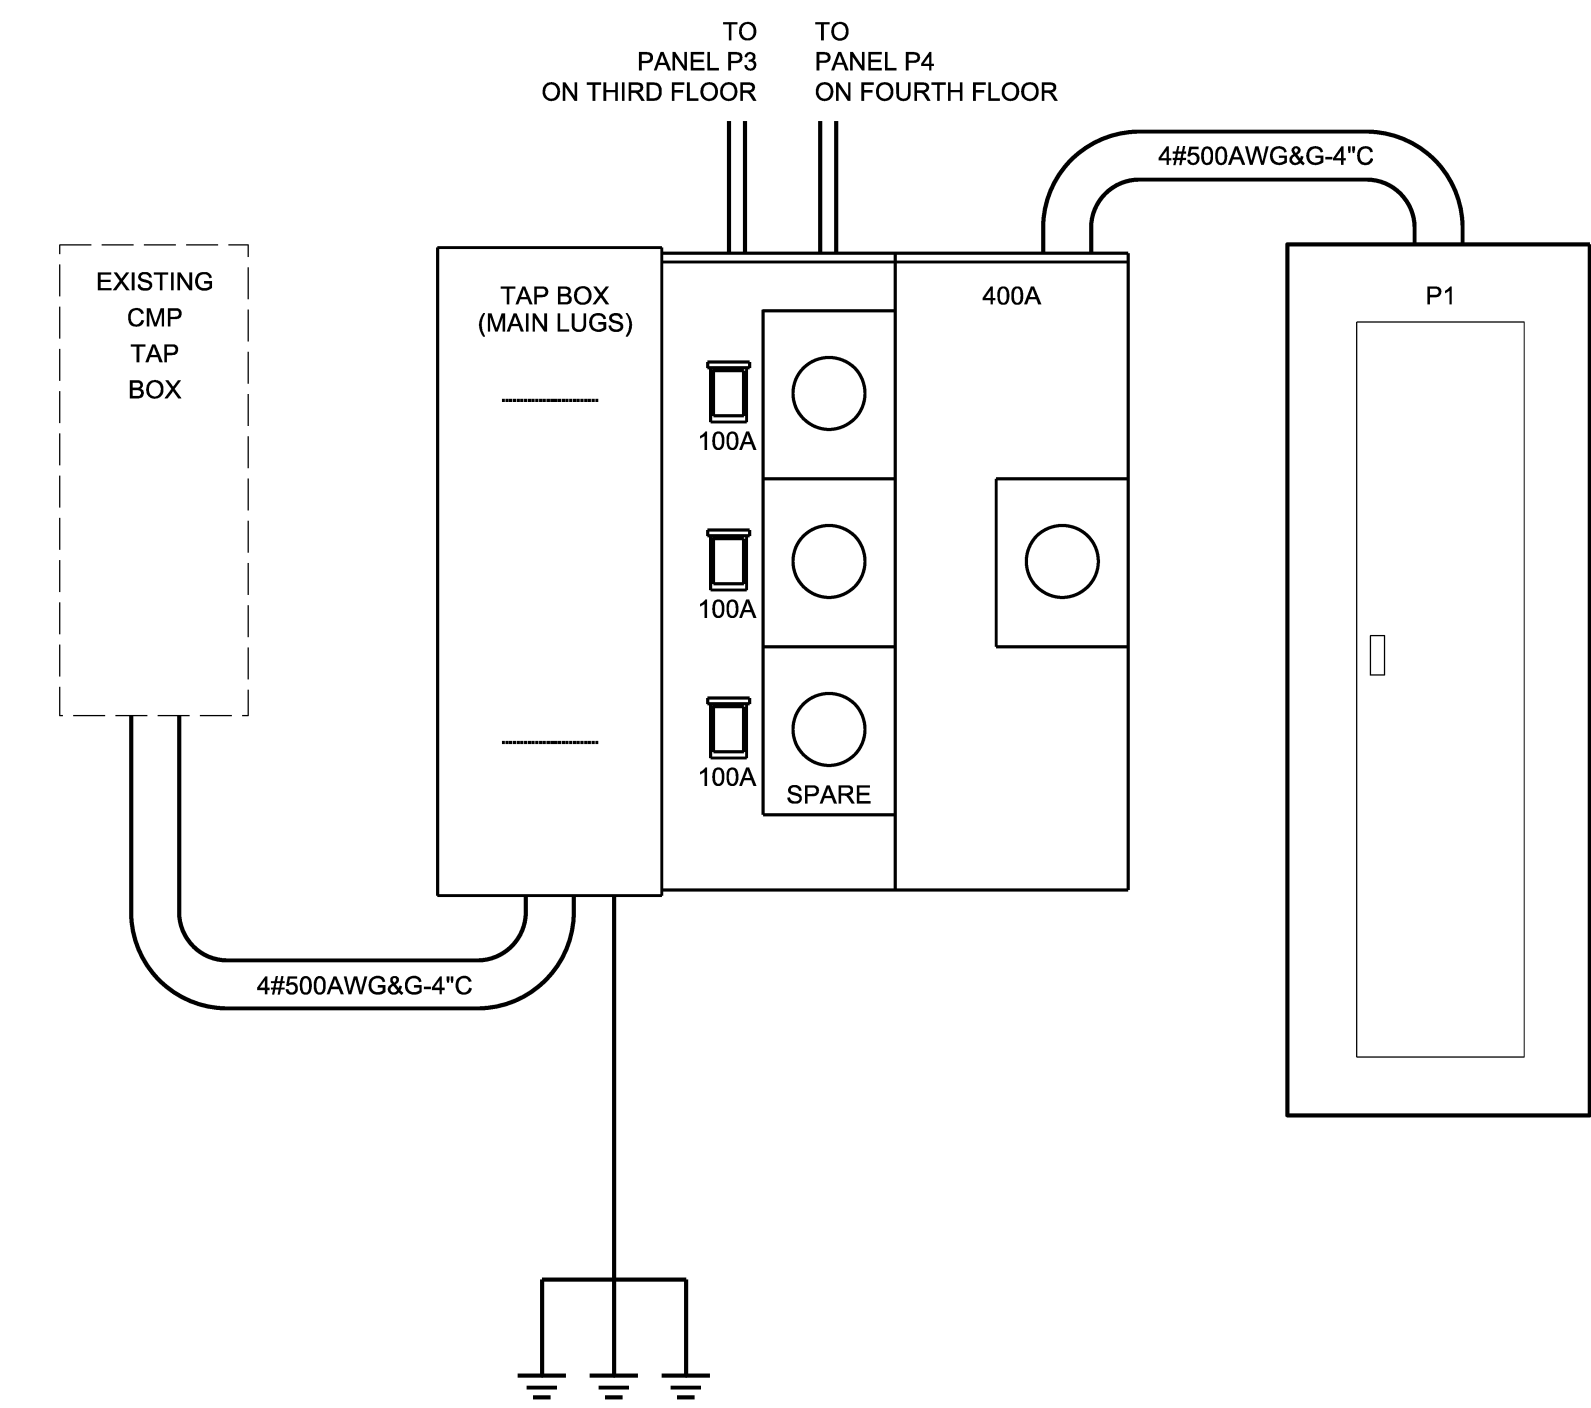

**A2** MODULAR METERING EQUIPMENT DETAIL  
SCALE: NO SCALE