



**... Fire Protection by Computer Design**

HIGH TECH FIRE PROTECTION  
84 HACKETT MILLS ROAD  
P.O. BOX 156  
POLAND, ME 04274  
207-998-2551

Job Name : 420 Fore Street, Wharf Level #3  
Drawing :  
Location : 420 Fore Street Portland Maine  
Remote Area : 3  
Contract :  
Data File : WHARF STREET CALCS.WXF

---

**HYDRAULIC CALCULATIONS**  
**for**

**Project name:** 420 Fore Street, Wharf Level  
**Location:** 420 Fore Street Portland Maine  
**Drawing no:**  
**Date:** 5/22/2015

**Design**

**Remote area number:** 3  
**Remote area location:** Wharf Street Level  
**Occupancy classification:** Ordinary Hazard 2  
**Density:** .2 - Gpm/SqFt  
**Area of application:** 930 - SqFt  
**Coverage per sprinkler:** 100 - SqFt  
**Type of sprinklers calculated:** Commercial  
**No. of sprinklers calculated:** 11  
**In-rack demand:** - GPM  
**Hose streams:** 250 - GPM  
**Total water required (including hose streams):** 538 - GPM @ 86 - Psi  
**Type of system:** Wet System  
**Volume of dry or preaction system:** 0 - Gal

**Water supply information**

**Date:** 05-11-2013  
**Location:** Corner Of Union Street And Fore Street  
**Source:** Portland Water District

**Name of contractor:** HIGH TECH FIRE PROTECTION  
**Address:** P.O. BOX 156 / / MINOT, ME 04258  
**Phone number:** 207-998-2551  
**Name of designer:** Ed Pennell  
**Authority having jurisdiction:** State of Maine / Portland Fire Department  
**Notes: (Include peaking information or gridded systems here.)**


# Water Supply Curve (C)

HIGH TECH FIRE PROTECTION  
420 Fore Street, Wharf Level #3

Page 2  
Date 5/12/2015

City Water Supply:  
C1 - Static Pressure : 101  
C2 - Residual Pressure: 99  
C2 - Residual Flow : 1342

Demand:  
D1 - Elevation : 6.280  
D2 - System Flow : 287.794  
D2 - System Pressure : 85.864  
Hose ( Demand ) : 250  
D3 - System Demand : 537.794  
Safety Margin : 14.768

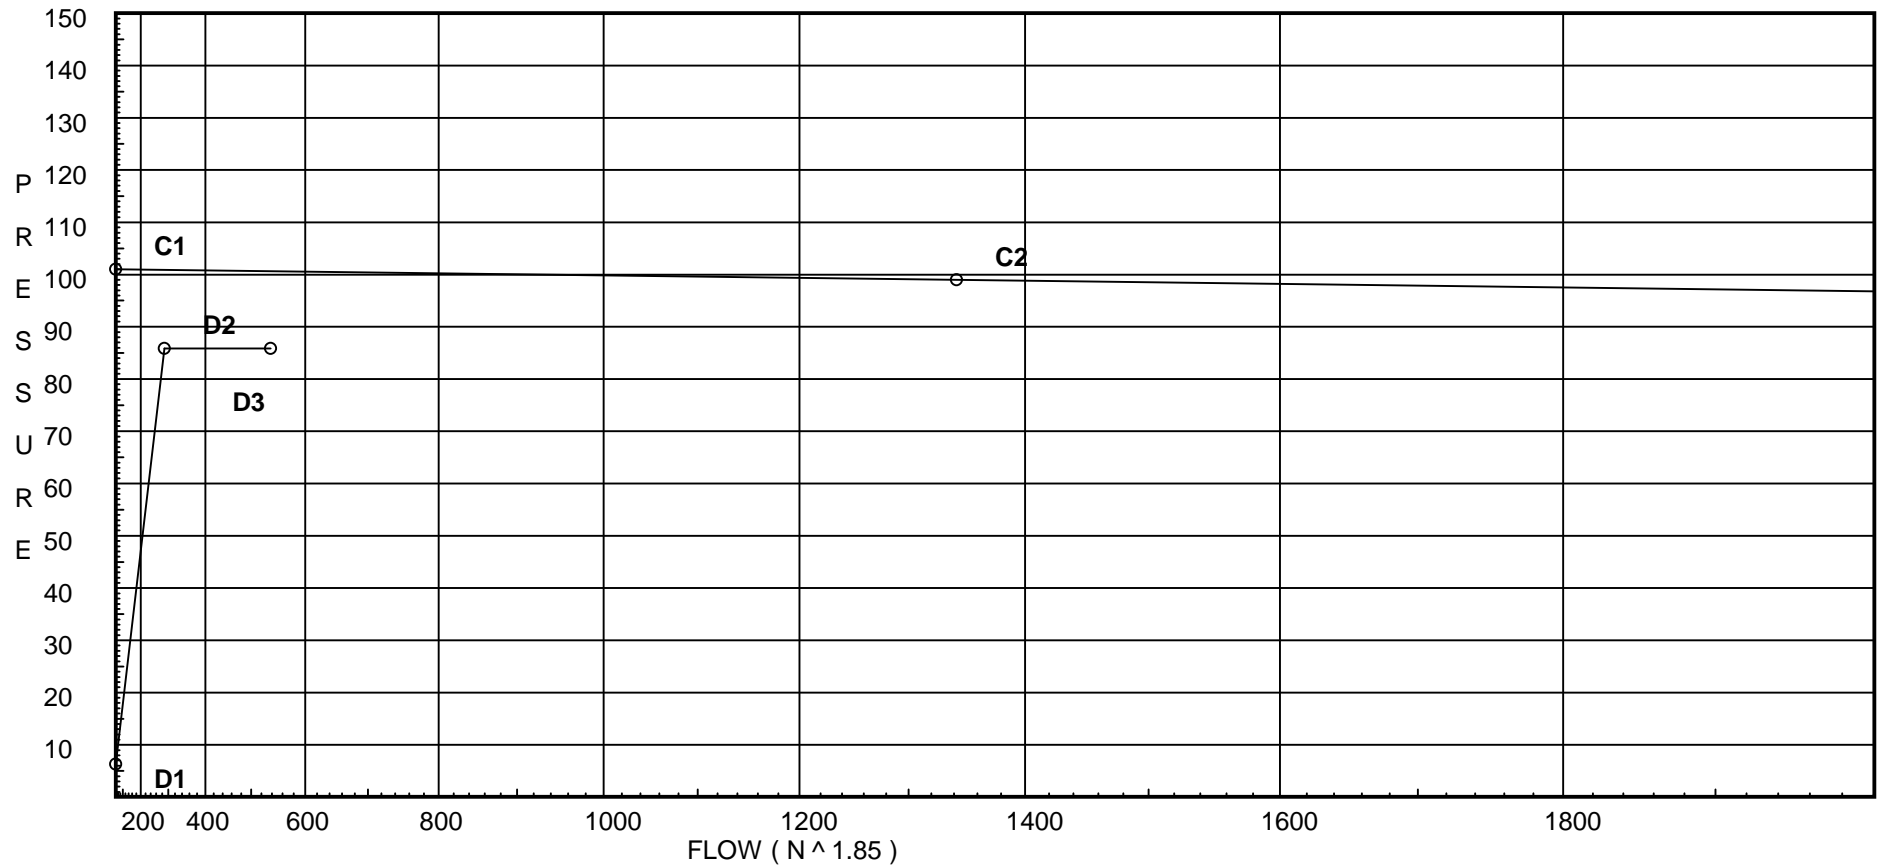

# Fittings Used Summary

HIGH TECH FIRE PROTECTION  
420 Fore Street, Wharf Level #3

Page 3  
Date 5/12/2015

## Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
B	NFPA 13 Butterfly Valve	0	0	0	0	0	6	7	10	0	12	9	10	12	19	21	0	0	0	0	0
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
Fsp	Flow Switch Potter VSR	Fitting generates a Fixed Loss Based on Flow																			
G	NFPA 13 Gate Valve	0	0	0	0	1	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
V	90' Ell Firelock #001	0	0	0	0	0	3.5	4.3	5	0	6.8	8.5	10	13	0	0	0	0	0	0	0

## Units Summary

Diameter Units                   Inches  
Length Units                       Feet  
Flow Units                         US Gallons per Minute  
Pressure Units                   Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with \*. The fittings marked with a \* show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a \* will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

# Pressure / Flow Summary - STANDARD

HIGH TECH FIRE PROTECTION  
420 Fore Street, Wharf Level #3

Page 4  
Date 5/12/2015

Node No.	Elevation	K-Fact	Pt Actual	Pn	Flow Actual	Density	Area	Press Req.
W3	14.5	5.6	20.11	na	25.11	0.2	120	7.0
W4	14.5	5.6	22.09	na	26.32	0.2	120	7.0
W18	14.5		23.52	na				
W5	14.5	5.6	18.37	na	24.0	0.2	120	7.0
W6	14.5	5.6	19.66	na	24.83	0.2	120	7.0
W7	14.5	5.6	20.55	na	25.39	0.2	120	7.0
W20	14.5		22.55	na				
W8	14.5	5.6	20.9	na	25.6	0.2	120	7.0
W9	14.5	5.6	22.96	na	26.83	0.2	120	7.0
W22	14.5		24.43	na				
W10	14.5	5.6	22.05	na	26.29	0.2	120	7.0
W11	14.5	5.6	24.21	na	27.55	0.2	120	7.0
W24	14.5		25.76	na				
W2	14.5	5.6	24.75	na	27.86	0.2	120	7.0
W17	14.5		24.76	na				
W25	14.5		24.88	na				
W19	14.5	5.6	25.0	na	28.0	0.2	120	7.0
W21	14.5		25.72	na				
W23	14.5		27.11	na				
C3	6.4		38.27	na				
C4	6.4		41.31	na				
C5	5.75		49.92	na				
C6	5.75		51.26	na				
TOR	2.0		68.11	na				
BOR	2.0		76.4	na				
H1	10.0		75.02	na				
H2	10.0		78.33	na				
H3	10.0		78.5	na				
H4	10.0		80.34	na	250.0			
TEST	0.0		85.86	na				

The maximum velocity is 16.93 and it occurs in the pipe between nodes W23 and C3

# Final Calculations - Hazen-Williams

HIGH TECH FIRE PROTECTION  
420 Fore Street, Wharf Level #3

Page 5  
Date 5/12/2015

Hyd. Ref. Point	Qa  Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
W3 to W4	25.11	1.049 120.0		0.0 0.0	10.000 0.0	20.112 0.0			K Factor = 5.60	
W4 to W18	25.11	0.1983		0.0	10.000	1.983			Vel = 9.32	
W4 to W18	26.33	1.38 120.0	1E	3.0 0.0	4.250 3.000	22.095 0.0			K Factor = 5.60	
W18 to W17	51.44	0.1964		0.0	7.250	1.424			Vel = 11.03	
W18 to W17	0.0	1.38 120.0	1T	6.0 0.0	0.330 6.000	23.519 0.0				
W17 to W5	51.44	0.1965		0.0	6.330	1.244			Vel = 11.03	
W5 to W6	0.0 51.44					24.763			K Factor = 10.34	
W5 to W6	24.00	1.049 120.0		0.0 0.0	7.100 0.0	18.367 0.0			K Factor = 5.60	
W6 to W7	24.0	0.1824		0.0	7.100	1.295			Vel = 8.91	
W6 to W7	24.83	1.38 120.0		0.0 0.0	5.000 0.0	19.662 0.0			K Factor = 5.60	
W7 to W20	48.83	0.1784		0.0	5.000	0.892			Vel = 10.47	
W7 to W20	25.39	1.38 120.0	1E	3.0 0.0	2.150 3.000	20.554 0.0			K Factor = 5.60	
W20 to W19	74.22	0.3872		0.0	5.150	1.994			Vel = 15.92	
W20 to W19	0.0	1.38 120.0	1T	6.0 0.0	0.330 6.000	22.548 0.0				
W19 to W8	74.22	0.3872		0.0	6.330	2.451			Vel = 15.92	
W8 to W9	0.0 74.22					24.999			K Factor = 14.84	
W8 to W9	25.60	1.049 120.0		0.0 0.0	10.000 0.0	20.902 0.0			K Factor = 5.60	
W9 to W22	25.6	0.2055		0.0	10.000	2.055			Vel = 9.50	
W9 to W22	26.83	1.38 120.0	1E	3.0 0.0	4.250 3.000	22.957 0.0			K Factor = 5.60	
W22 to W21	52.43	0.2036		0.0	7.250	1.476			Vel = 11.25	
W22 to W21	0.0	1.38 120.0	1T	6.0 0.0	0.330 6.000	24.433 0.0				
W21 to W10	52.43	0.2036		0.0	6.330	1.289			Vel = 11.25	
W10 to W11	0.0 52.43					25.722			K Factor = 10.34	
W10 to W11	26.29	1.049 120.0		0.0 0.0	10.000 0.0	22.047 0.0			K Factor = 5.60	
W11 to W24	26.29	0.2159		0.0	10.000	2.159			Vel = 9.76	
W11 to W24	27.56	1.38 120.0	1E	3.0 0.0	4.250 3.000	24.206 0.0			K Factor = 5.60	
W24 to W23	53.85	0.2138		0.0	7.250	1.550			Vel = 11.55	
W24 to W23	0.0	1.38 120.0	1T	6.0 0.0	0.330 6.000	25.756 0.0				
W23 to W2	53.85	0.2139		0.0	6.330	1.354			Vel = 11.55	
W2 to W17	0.0 53.85					27.110			K Factor = 10.34	
W2 to W17	27.86	2.635 120.0		0.0 0.0	6.000 0.0	24.746 0.0			K Factor = 5.60	
W17 to W17	27.86	0.0028		0.0	6.000	0.017			Vel = 1.64	

# Final Calculations - Hazen-Williams

HIGH TECH FIRE PROTECTION  
420 Fore Street, Wharf Level #3

Page 6  
Date 5/12/2015

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftn'g's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
W17	51.43	2.635		0.0	6.300	24.763				
to		120.0		0.0	0.0	0.0				
W25	79.29	0.0187		0.0	6.300	0.118		Vel =	4.66	
W25	0.0	2.635		0.0	6.300	24.881				
to		120.0		0.0	0.0	0.0				
W19	79.29	0.0187		0.0	6.300	0.118		Vel =	4.66	
W19	102.22	2.635		0.0	8.330	24.999		K Factor =	5.60	
to		120.0		0.0	0.0	0.0				
W21	181.51	0.0868		0.0	8.330	0.723		Vel =	10.68	
W21	52.44	2.635		0.0	10.000	25.722				
to		120.0		0.0	0.0	0.0				
W23	233.95	0.1388		0.0	10.000	1.388		Vel =	13.76	
W23	53.84	2.635	1T	16.474	4.660	27.110				
to		120.0	2E	16.474	32.948	3.508				
C3	287.79	0.2036		0.0	37.608	7.656		Vel =	16.93	
	0.0									
	287.79					38.274		K Factor =	46.52	
C3	287.79	2.635	1V	5.903	9.000	38.274				
to		120.0		0.0	5.903	0.0				
C4	287.79	0.2036		0.0	14.903	3.034		Vel =	16.93	
C4	0.0	2.635	2V	11.807	29.100	41.308				
to		120.0		0.0	11.807	0.282				
C5	287.79	0.2036		0.0	40.907	8.328		Vel =	16.93	
C5	0.0	2.635	1V	5.903	0.670	49.918				
to		120.0		0.0	5.903	0.0				
C6	287.79	0.2036		0.0	6.573	1.338		Vel =	16.93	
C6	0.0	2.635	1V	5.903	28.100	51.256				
to		120.0	1T	16.474	31.987	4.624		* Fixed loss =	3	
TOR	287.79	0.2036	1B	9.61	60.087	12.233		Vel =	16.93	
			1Fsp	0.0						
TOR	0.0	2.635	1E	8.237	3.000	68.113				
to		120.0		0.0	8.237	6.000		* Fixed loss =	6	
BOR	287.79	0.2036		0.0	11.237	2.288		Vel =	16.93	
BOR	0.0	2.635	1E	8.237	2.000	76.401				
to		120.0		0.0	8.237	-3.465				
H1	287.79	0.2036		0.0	10.237	2.084		Vel =	16.93	
H1	0.0	2.635	1E	8.237	8.000	75.020				
to		120.0		0.0	8.237	0.0				
H2	287.79	0.2036		0.0	16.237	3.306		Vel =	16.93	
H2	0.0	6.14	1T	22.732	15.000	78.326				
to		100.0		0.0	22.732	0.0				
H3	287.79	0.0046		0.0	37.732	0.175		Vel =	3.12	
H3	0.0	6.14	1T	22.732	375.000	78.501				
to		100.0		0.0	22.732	0.0				
H4	287.79	0.0046		0.0	397.732	1.843		Vel =	3.12	
H4	250.00	6.14	1E	10.608	45.000	80.344		Qa =	250	
to		100.0	1G	2.273	35.613	4.331				
TEST	537.79	0.0147	1T	22.732	80.613	1.189		Vel =	5.83	

# Final Calculations - Hazen-Williams

HIGH TECH FIRE PROTECTION  
420 Fore Street, Wharf Level #3

Page 7  
Date 5/12/2015

Hyd. Ref. Point	Qa  Qt	Dia. "C" Pf/Ft	Fitting or Eqv. Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
	0.0 537.79				85.864			K Factor = 58.04	