



2 CITY CENTER, PORTLAND, ME 04101



214 North Tryon Street
Suite 2320
Charlotte, NC 28202
United States
Tel 704.377.2725
Fax 704.377.2807




URS CORPORATION
MEP ENGINEERS
27777 FRANKLIN ROAD
SUITE 2000
SOUTHFIELD, MI 48034
Tel 248.204.5900
Fax 248.204.5901


MONAGHAN WOODWORKS
100 COMMERCIAL STREET
SUITE #212
PORTLAND, ME 04101
Tel 207.775.2683
Fax 207.772.6735

SHEET NOTES

- D1 REMOVE SECURITY ALARM PANEL FROM WALL BEING REMOVED. REMOVE OCCUPANCY SENSOR ASSOCIATED WITH SECURITY PANEL. TURN OVER TO LANDLORD.
- D2 REMOVE FIRE ALARM PULL STATION AND STROBE HORN AND RELOCATE AS SHOWN ON DRAWING E02-02.
- D3 REMOVE AND REMOUNT EXISTING FIRE ALARM PULL STATION AT 48" AFF.
- D4 REMOVE EXISTING ABOVE COUNTER DUPLEX RECEPTACLES. SEE SHEET NOTES E5 AND E6 ON SHEET E02-02.
- D5 REMOVE ALL ELECTRICAL DEVICES ON INDICATED WALLS IN PROJECT AREA ON THIRD FLOOR. REMOVE WIRING AND RACEWAY BACK TO SOURCE POWER PANEL. FIELD VERIFY EXTENT OF WORK.
- D6 IN THE PROJECT AREA ON THE THIRD FLOOR REMOVE ALL CIRCUITING FROM THE THIRD FLOOR POWER PANEL TO RECEPTACLES IN WALLS FOR CIRCUITS THAT ARE SHARED WITH DEVICES OUTSIDE THE PROJECT AREA. REMOVE WIRING TO COMMON JUNCTION BOXES AND RETAIN CIRCUITING AND POWER TO THESE OTHER AREAS. CIRCUITS THAT ARE EXCLUSIVE TO THE PROJECT AREA SHALL BE REMOVED BACK TO SOURCE THIRD FLOOR POWER PANEL. IF THE EXISTING CONDUITS AND WIRING FOR THESE CIRCUITS BEING REMOVED CAN BE REUSED FOR THE CIRCUITING COMING FROM THE SECOND FLOOR THIS SHALL BE PERMITTED. ALL CIRCUITING TO THE PROJECT AREA SHALL BE FROM THE SECOND FLOOR POWER PANEL. (A FOR METERING PURPOSES). SEE DRAWING E02-02.

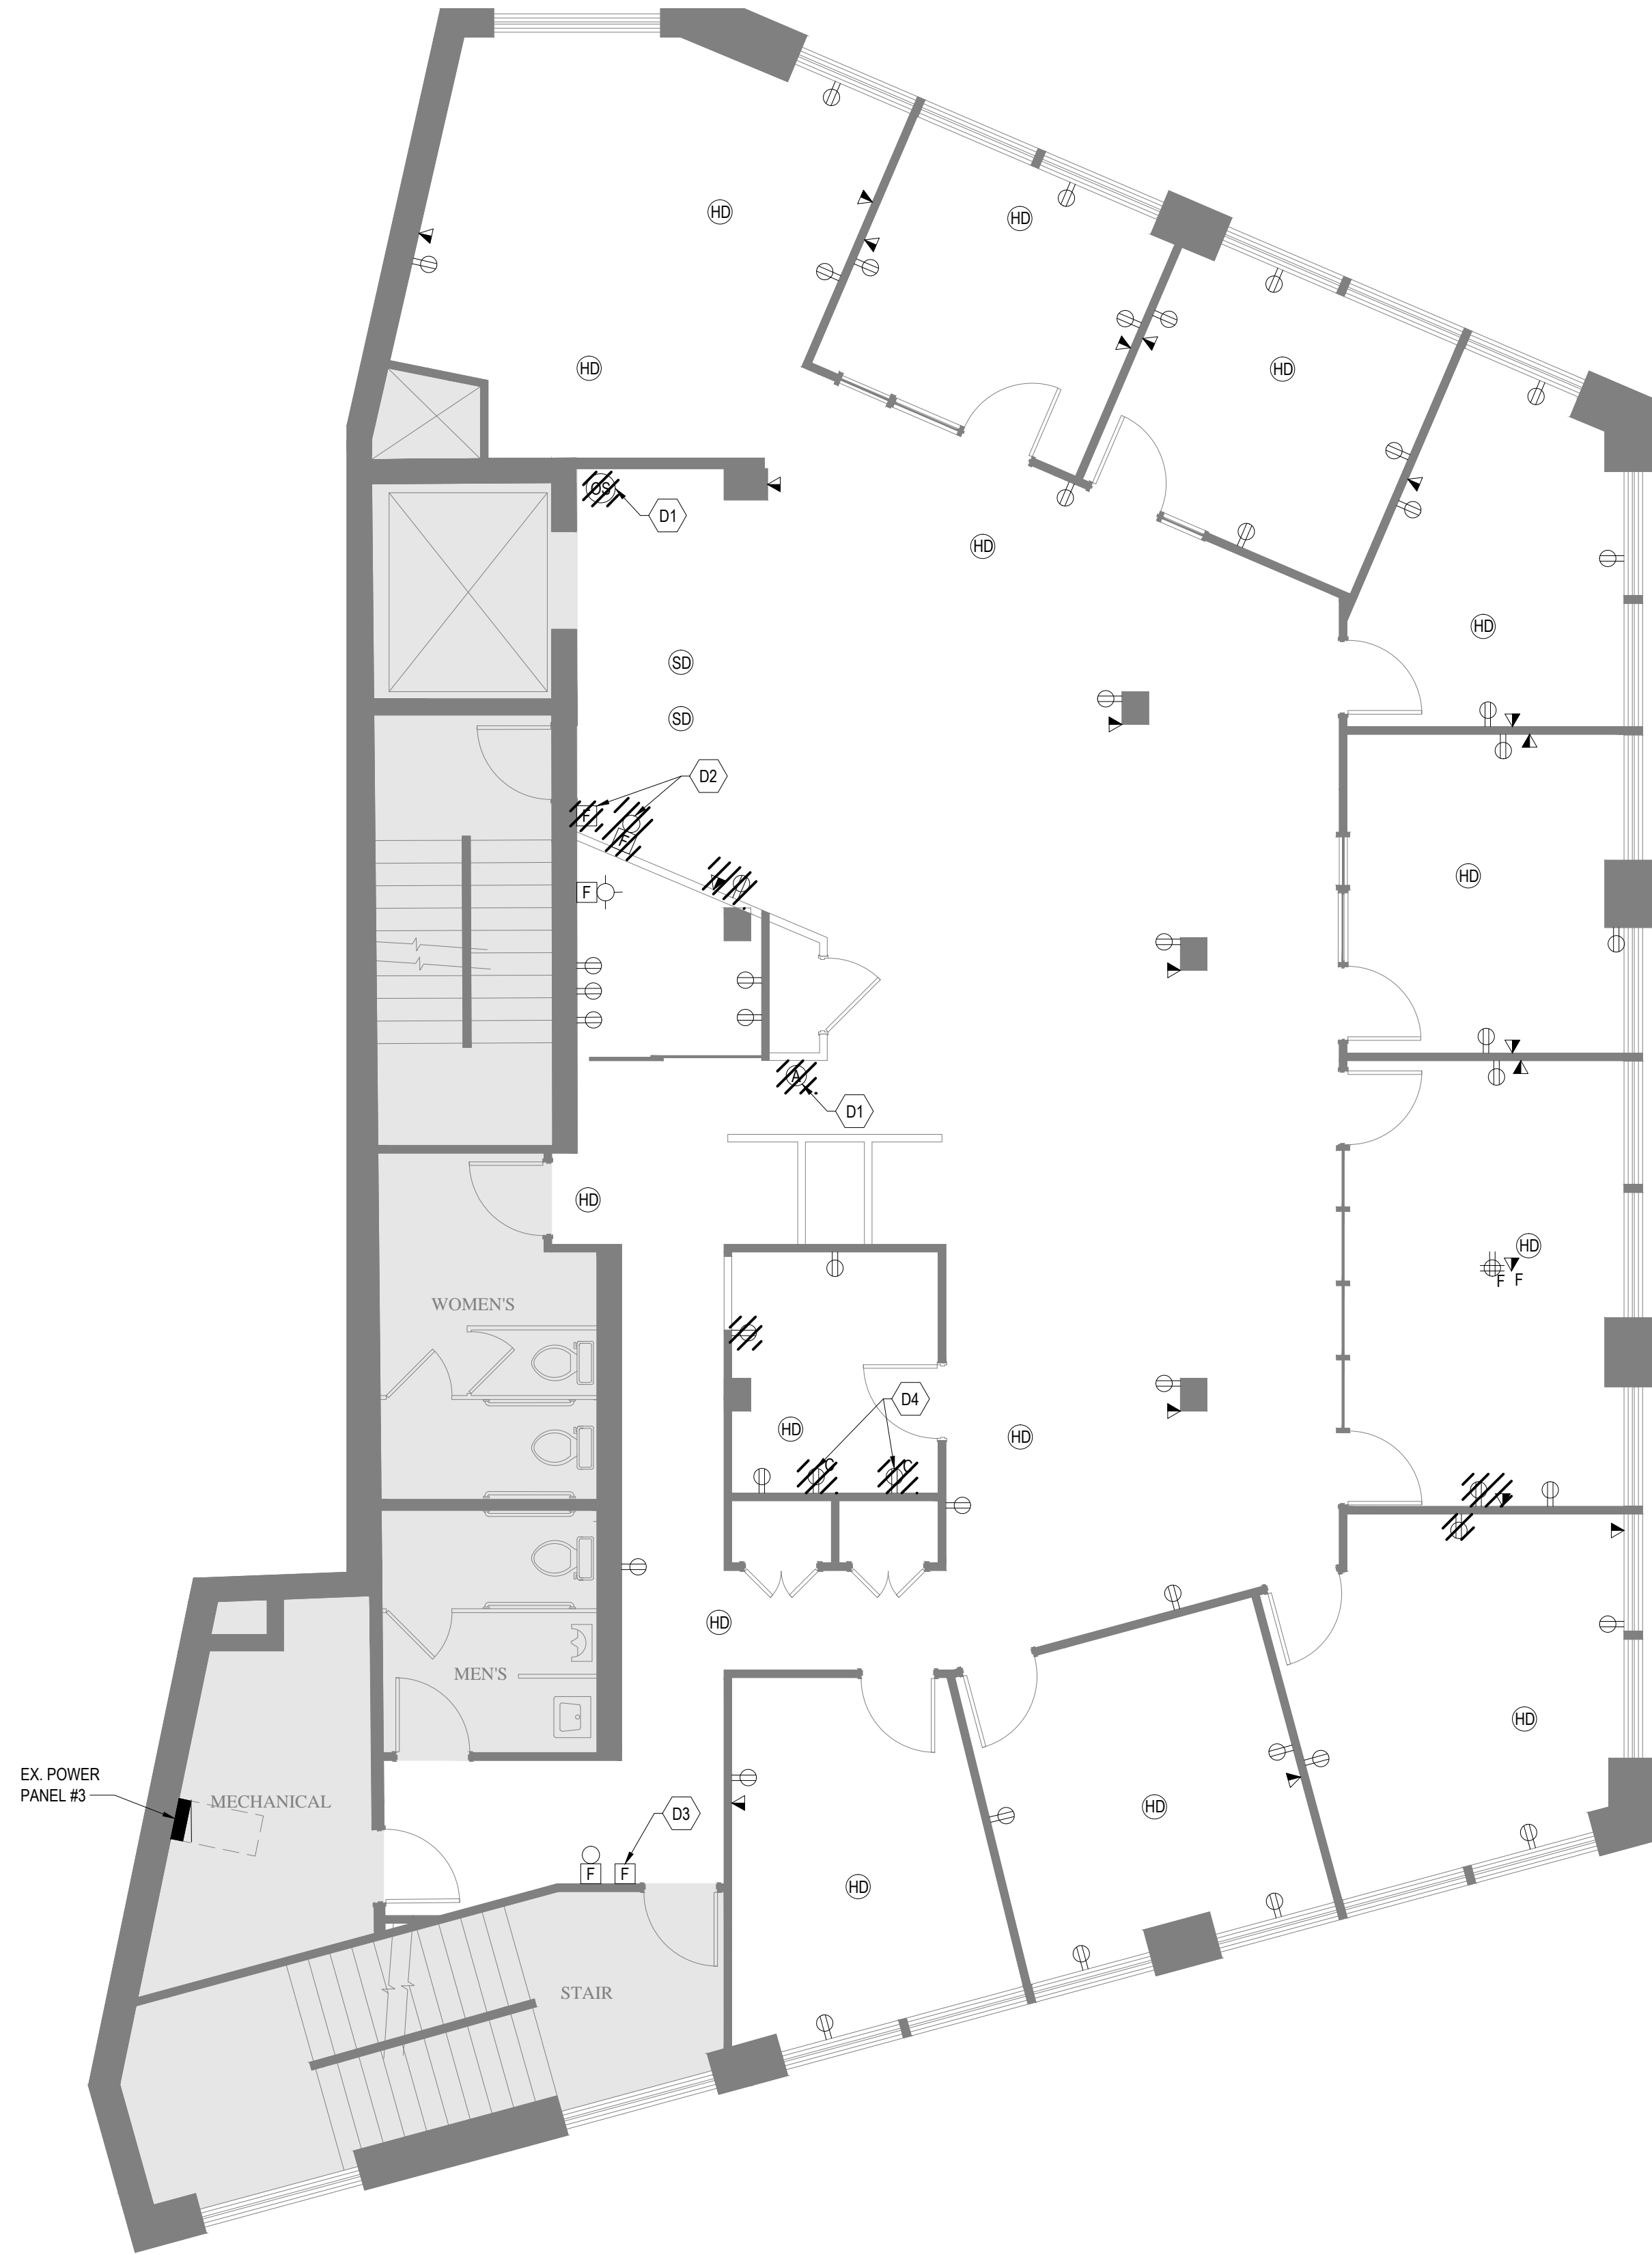

1 SECOND FLOOR POWER DEMOLITION PLAN
SCALE: 3/16"=1'-0"

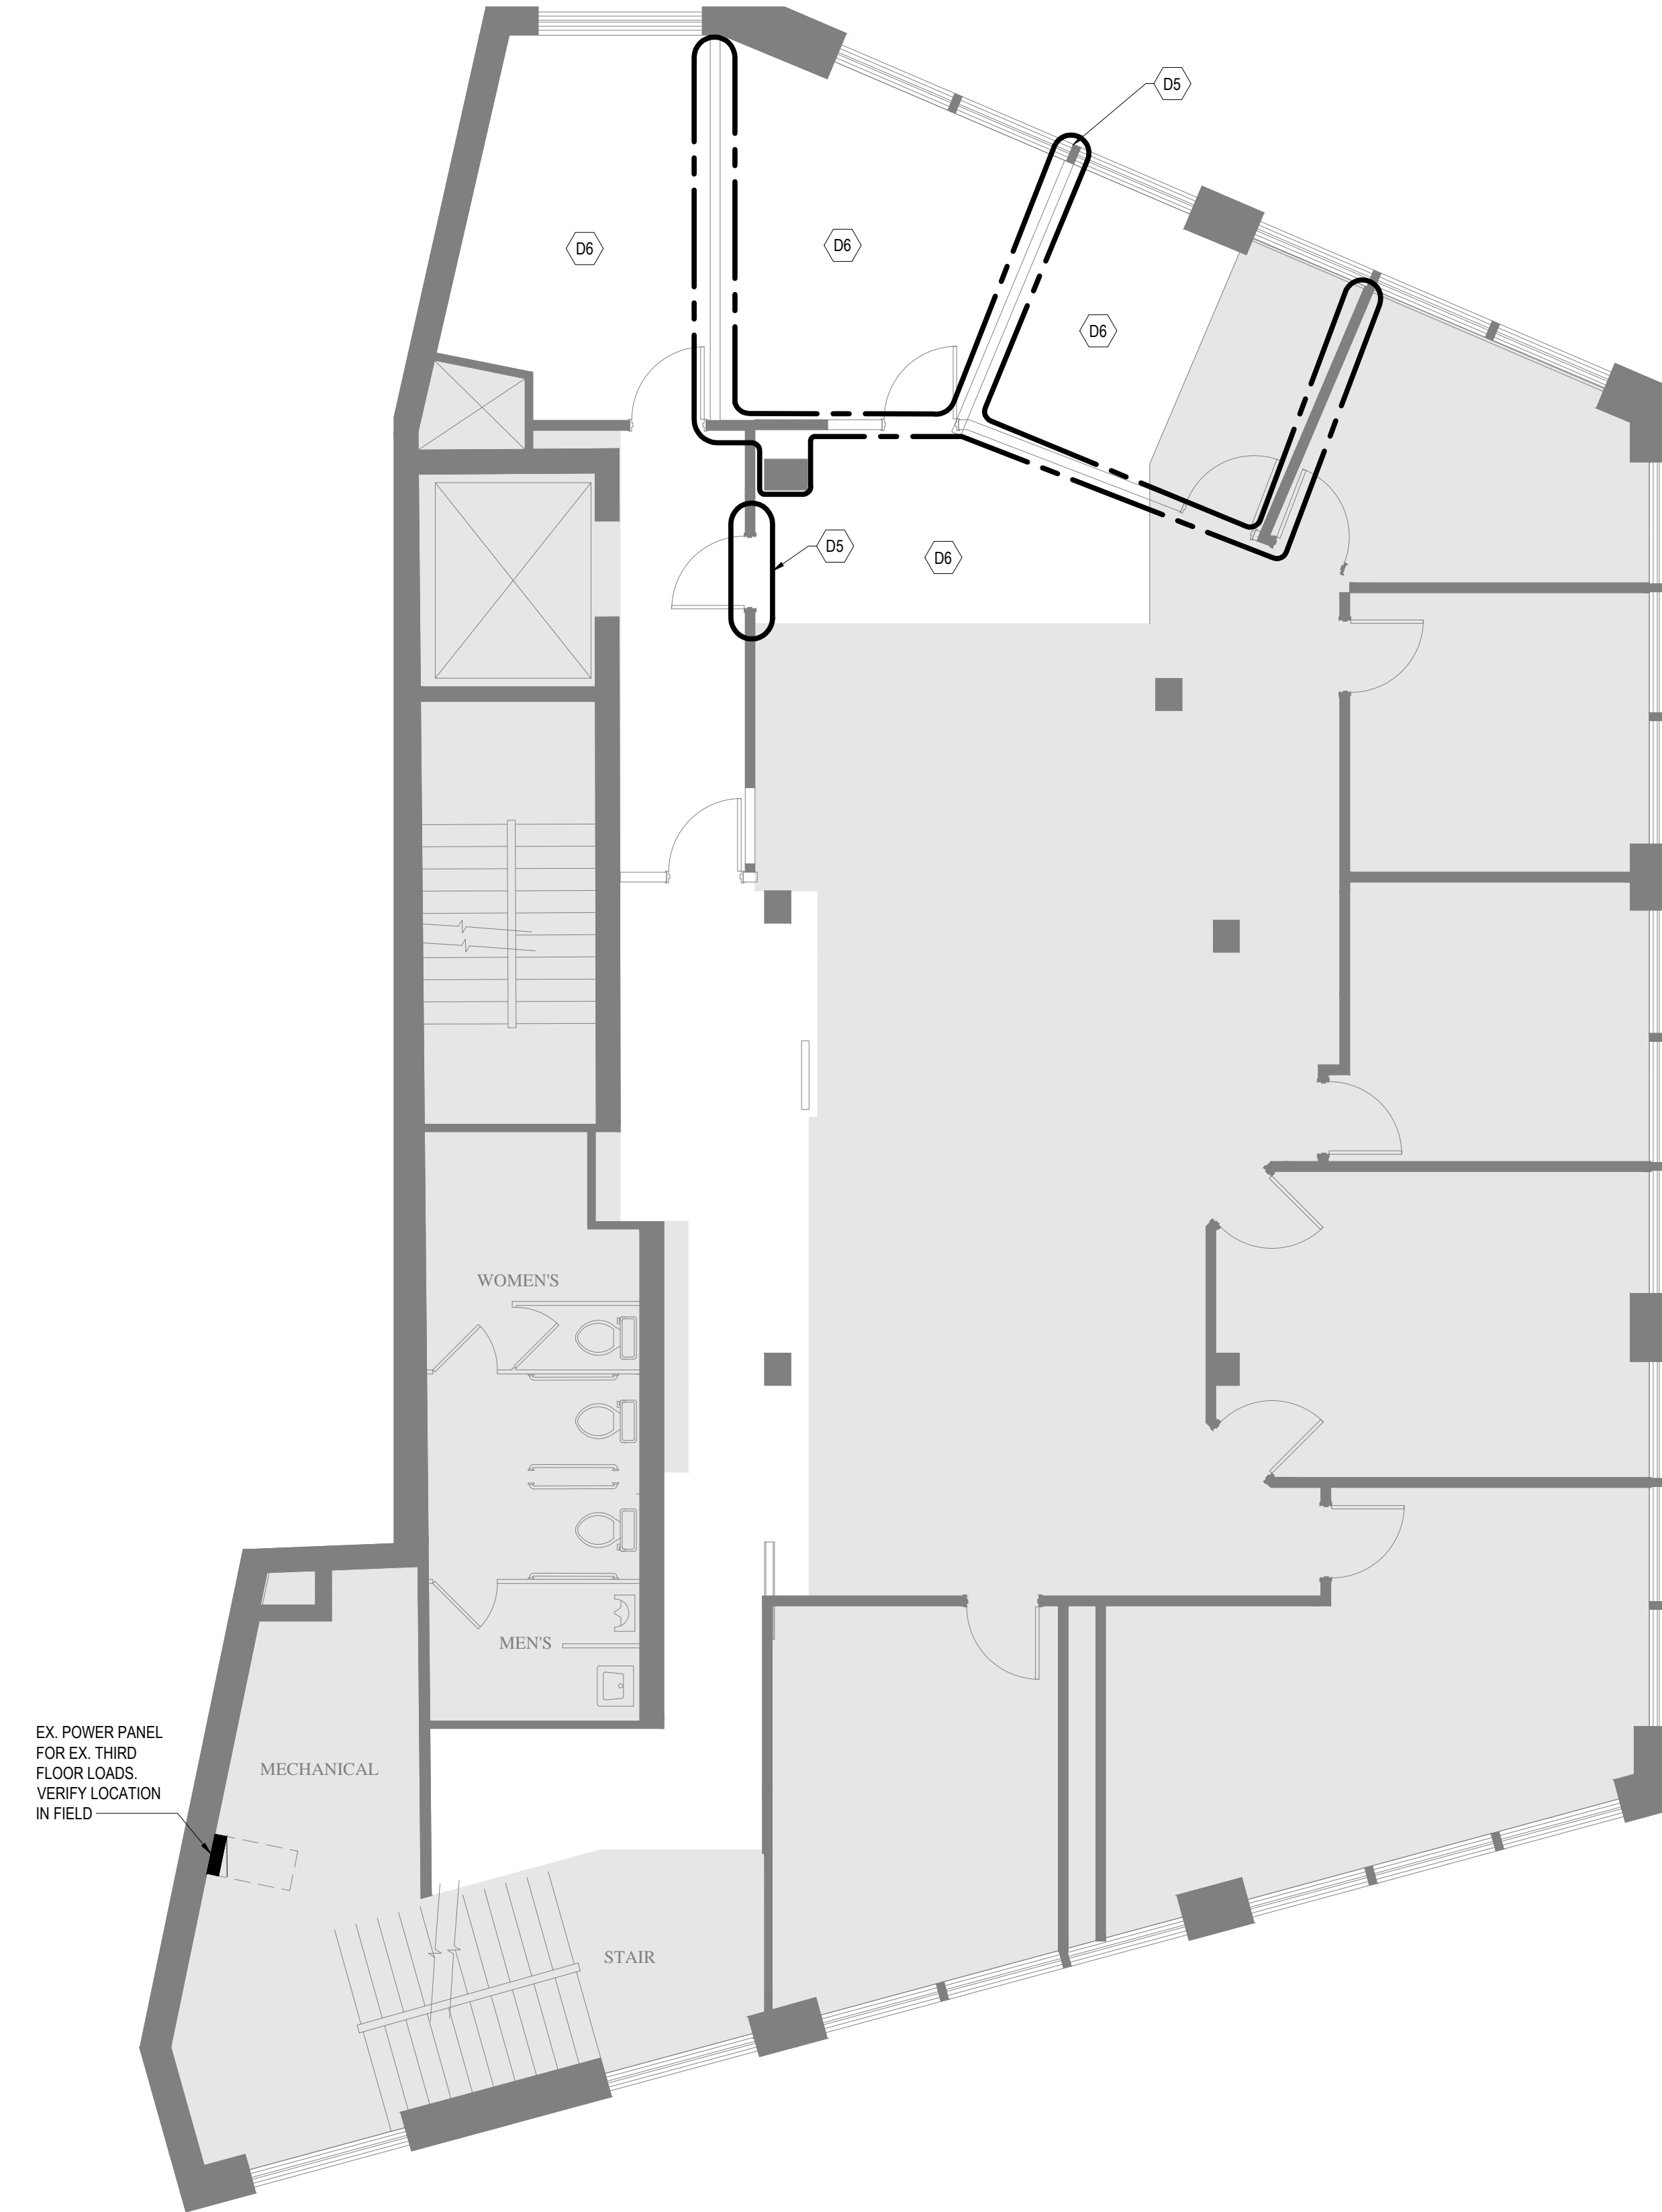

2 THIRD FLOOR POWER DEMOLITION PLAN
SCALE: 3/16"=1'-0"

GENERAL NOTES

Date	Description

Seal / Signature

Project Name

URS - PORTLAND

Project Number

59.6222.900

Scale

As indicated

Description

POWER DEMOLITION PLAN - LEVEL 02 - 03

E01-02