

1 LIFE SAFETY PLAN


SCALE: 1/8" = 1'-0"
 2' 4' 8' 16'

AREA NOT IN CONTRACT

- LIFE SAFETY PLAN KEY**
- EXIT SIGN
 - EMERGENCY LIGHT
 - CEILING MOUNT HORN STROBE
 - FIRE EXTINGUISHER
 - EXIT TRAVEL DISTANCE


IBC 2009 CODE DATA	
SUITE FLOOR AREA	2,740 SF ON ONE STORY
NUMBER OF STORIES	5 (4 PLUS GROUND FLOOR / BASEMENT)
USE AND OCCUPANCY CLASSIFICATION - SECTION 311.2	S-2 MODERATE HAZARD STORAGE
TYPE OF CONSTRUCTION - TABLE 601	III-B
FIRE RESISTANT CONSTRUCTION - TABLE 601:	
STRUCTURAL FRAME	0 HOUR
EXTERIOR BEARING WALLS	2 HOUR
INTERIOR BEARING WALLS	0 HOUR
EXTERIOR NONBEARING WALLS	0 HOUR
INTERIOR NONBEARING WALLS	0 HOUR
FLOOR CONSTRUCTION	0 HOUR
ROOF CONSTRUCTION	0 HOUR
FIRE RATING STAIR ENCLOSURES - SECTION 1022.1.1	0 HOUR - ENCLOSED AT TOP
FIRE ALARM SYSTEM REQUIRED - SECTION 907	NOT REQUIRED, BUT PROVIDED
OCCUPANT LOAD - TABLE 1004.1.1	6
MAXIMUM COMMON PATH OF TRAVEL DISTANCE - NFPA 101-2009 TABLE A7.6	100 FEET
MAXIMUM EXIT TRAVEL DISTANCE - TABLE 1016.1	400 FEET
FIRE RATED CORRIDORS - TABLE 1018.1	0
DEAD END CORRIDOR LENGTH - SECTION 1018.4	50 FEET
MINIMUM NUMBER OF EXITS - TABLE 1021.2	1 IF TRAVEL DISTANCE 100 FEET OR LESS
FIRE EXTINGUISHERS	(2) 3-A 10-B-C
NOTES	

NFPA 101 2009 CODE DATA	
SUITE FLOOR AREA	2,740 SF ON ONE STORY
NUMBER OF STORIES	5 (4 PLUS GROUND FLOOR / BASEMENT)
TYPE OF CONSTRUCTION - NFPA 220	III (200)
FIRE RESISTANT CONSTRUCTION - NFPA 220:	
EXTERIOR BEARING WALLS	2 HOUR
INTERIOR BEARING WALLS	0 HOUR
COLUMNS	0 HOUR
BEAMS, GIRDERS, TRUSSES, AND ARCHES	0 HOUR
FLOOR CONSTRUCTION	0 HOUR
ROOF CONSTRUCTION	0 HOUR
USE GROUP CLASSIFICATION - SECTION 3.3.178.15	STORAGE - ORDINARY HAZARD
EXIT STAIR ENCLOSURES - SECTION 7.1.3.2.1	SEE BELOW
OCCUPANT LOAD - TABLE 7.3.1.2	6
PROTECTION OF VERTICAL OPENINGS - SECTION 42.3.1.1	0 HOURS
MINIMUM NUMBER OF EXITS - SECTION 42.2.4.1 (2)	1
DEAD END CORRIDOR LENGTH - TABLE 42.2.5	100 FEET
MAXIMUM COMMON PATH OF TRAVEL DISTANCE - TABLE 42.2.5	100 FEET
MAXIMUM EXIT TRAVEL DISTANCE - TABLE 42.2.6	400 FEET
FIRE ALARM SYSTEM REQUIRED - SECTION 42.3.4.1.2	NOT REQUIRED BUT PROVIDED
FIRE RATED CORRIDORS - SECTION 42.3.6	0
FIRE EXTINGUISHERS	(2) 3-A 10-B-C
NOTES	

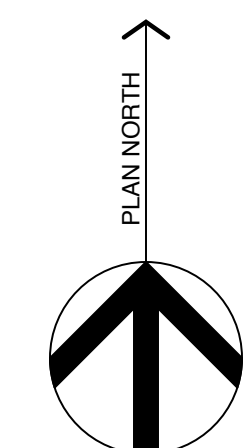

Michael Charek Architects

25 Hartley Street
 Portland, Maine 04103
 (207) 761-0556

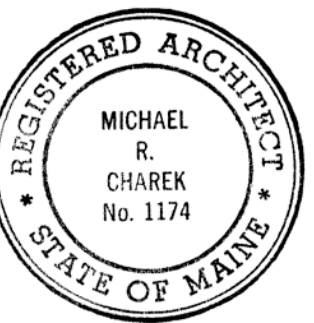

Ground Floor Storage Renovations

6 City Center,
 Portland, ME 04101

Title

LIFE SAFETY PLAN

Scale: AS NOTED

Date: 3/15/17

Revisions

Sheet

A2